

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908059

Luminaire Tested: DFN2DIP-HX3F0-060D060US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908059
REPORT IS A COMBINATION OF REPORTS P900769 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-060D060US840-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11997.2 lumens
Efficiency: N/A
Efficacy: 117.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908059

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US840-FLLONL

Luminous Intensity Polar Plot

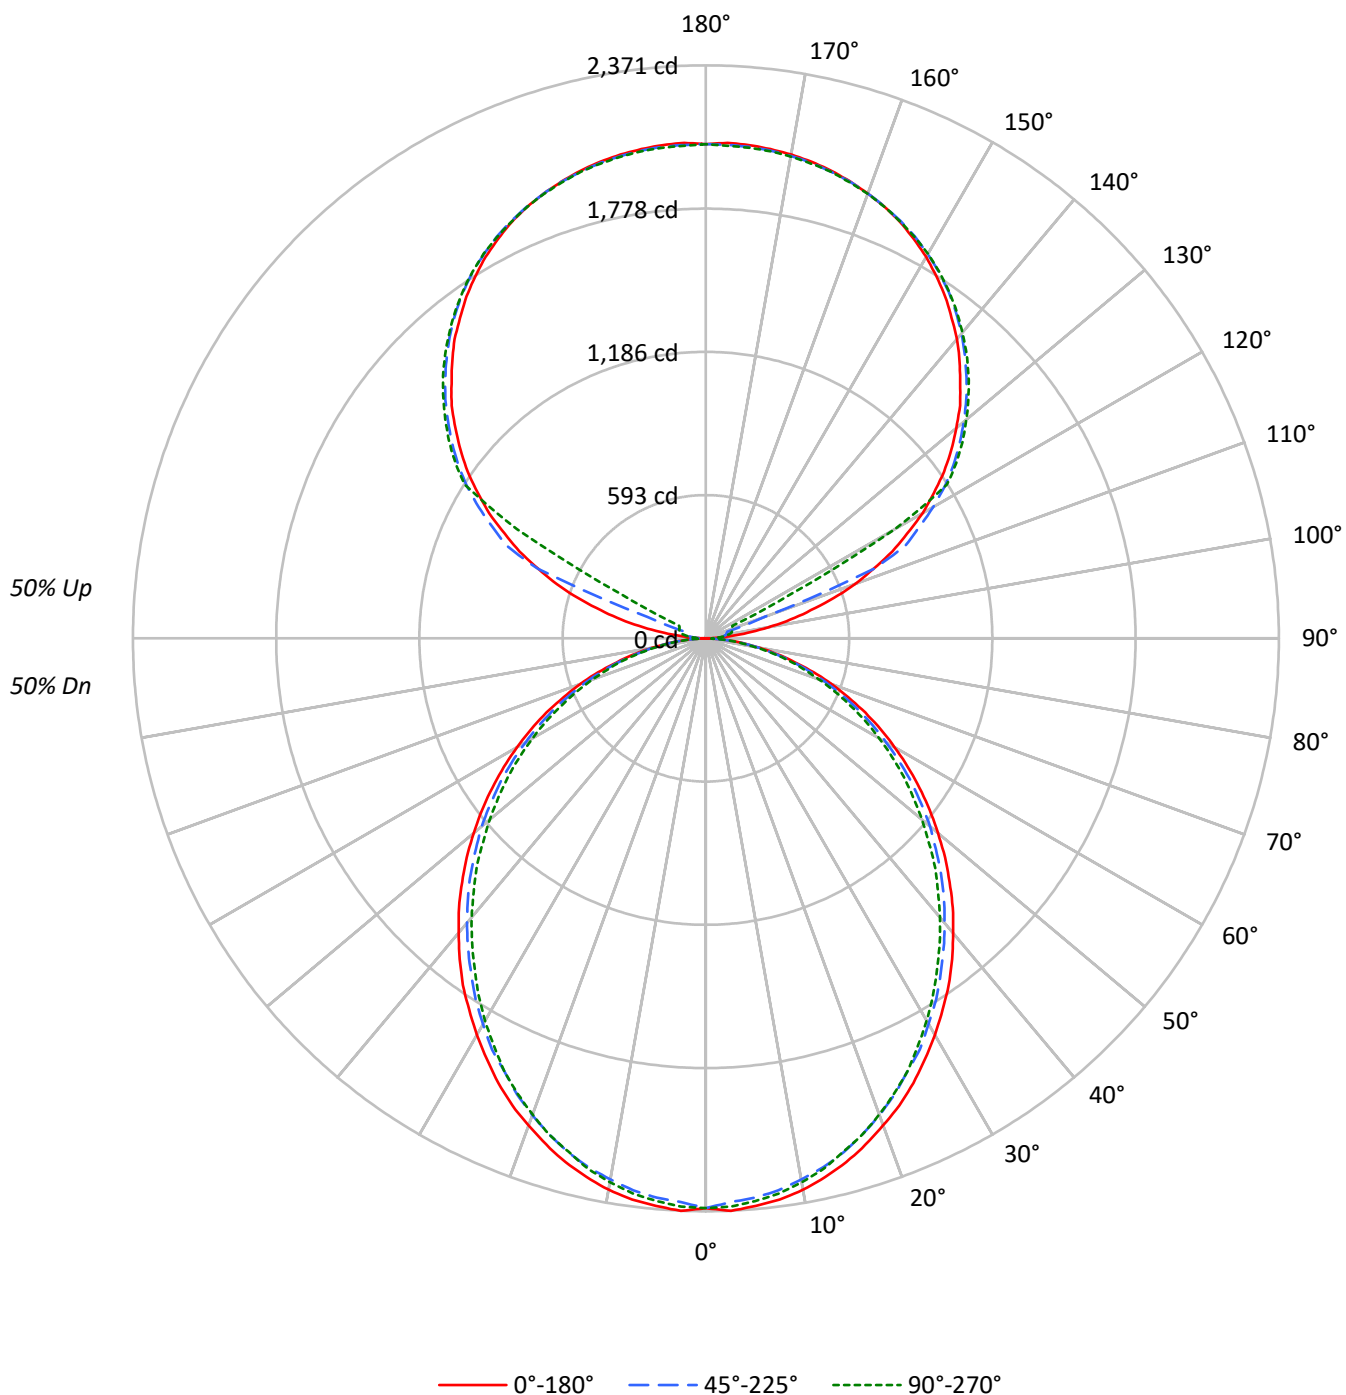

TEST NUMBER: P908059

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2731	2731	2731
5°	2734	2691	2710
10°	2711	2653	2671
15°	2670	2607	2613
20°	2615	2545	2552
25°	2560	2470	2483
30°	2491	2401	2395
35°	2426	2319	2303
40°	2346	2237	2214
45°	2267	2154	2124
50°	2180	2067	2019
55°	2088	1966	1923
60°	1985	1847	1812
65°	1872	1724	1681
70°	1729	1572	1540
75°	1530	1392	1408
80°	1290	1160	1159
85°	914	768	752

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2267 cd/sqm

TEST NUMBER: P908059

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.8
10°-20°	624.4	5.2
20°-30°	917.5	7.6
30°-40°	1065.7	8.9
40°-50°	1064.4	8.9
50°-60°	928.1	7.7
60°-70°	686.1	5.7
70°-80°	388.2	3.2
80°-90°	106.0	0.9
90°-100°	67.4	0.6
100°-110°	251.4	2.1
110°-120°	666.7	5.6
120°-130°	1105.7	9.2
130°-140°	1174.5	9.8
140°-150°	1091.6	9.1
150°-160°	877.6	7.3
160°-170°	565.5	4.7
170°-180°	194.6	1.6
0°-30°	1763.8	14.7
0°-40°	2829.5	23.6
0°-60°	4821.9	40.2
0°-90°	6002.2	50.0
90°-120°	985.5	8.2
90°-150°	4357.2	36.3
90°-180°	5995.0	50.0
0°-180°	11997.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	1	18	30	37	40	11
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P908059

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8



TEST NUMBER: P908059

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P908059

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.72	11.58	11.68	12.56	13.83	10.29	11.15	11.25	12.13	13.40
	3H	12.37	13.15	13.34	14.13	15.42	11.91	12.68	12.87	13.66	14.95
	4H	12.96	13.69	13.94	14.67	15.98	12.49	13.22	13.47	14.21	15.51
	6H	13.35	14.03	14.34	15.02	16.33	12.88	13.55	13.87	14.55	15.86
	8H	13.45	14.09	14.45	15.10	16.41	12.98	13.63	13.98	14.63	15.94
	12H	13.50	14.11	14.50	15.11	16.45	13.02	13.63	14.03	14.63	15.97
4H	2H	11.18	11.91	12.17	12.90	14.20	10.84	11.57	11.83	12.55	13.86
	3H	13.04	13.65	14.04	14.66	15.98	12.65	13.26	13.65	14.27	15.59
	4H	13.75	14.30	14.75	15.31	16.65	13.34	13.90	14.35	14.91	16.25
	6H	14.25	14.74	15.27	15.77	17.10	13.85	14.33	14.87	15.36	16.70
	8H	14.40	14.85	15.42	15.87	17.22	13.99	14.44	15.01	15.47	16.82
	12H	14.47	14.88	15.51	15.91	17.27	14.05	14.46	15.09	15.50	16.85
8H	4H	13.94	14.39	14.96	15.41	16.76	13.58	14.03	14.60	15.06	16.41
	6H	14.56	14.93	15.60	16.00	17.35	14.20	14.57	15.25	15.64	16.99
	8H	14.78	15.10	15.83	16.16	17.52	14.41	14.74	15.46	15.79	17.16
	12H	14.90	15.19	15.96	16.24	17.65	14.52	14.81	15.58	15.86	17.27
12H	4H	13.92	14.33	14.96	15.37	16.73	13.58	13.98	14.61	15.02	16.38
	6H	14.59	14.92	15.64	15.97	17.34	14.24	14.57	15.29	15.62	16.99
	8H	14.83	15.11	15.88	16.16	17.57	14.47	14.76	15.53	15.81	17.22

END OF REPORT