

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910799

Luminaire Tested: DFN2DIP-HX3F0-070D030US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910799
REPORT IS A COMBINATION OF REPORTS P900729 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-070D030US850-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10979.1 lumens
Efficiency: N/A
Efficacy: 119.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 92.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910799

CATALOG NUMBER: DFN2DIP-HX3F0-070D030US850-FLLONL

Luminous Intensity Polar Plot

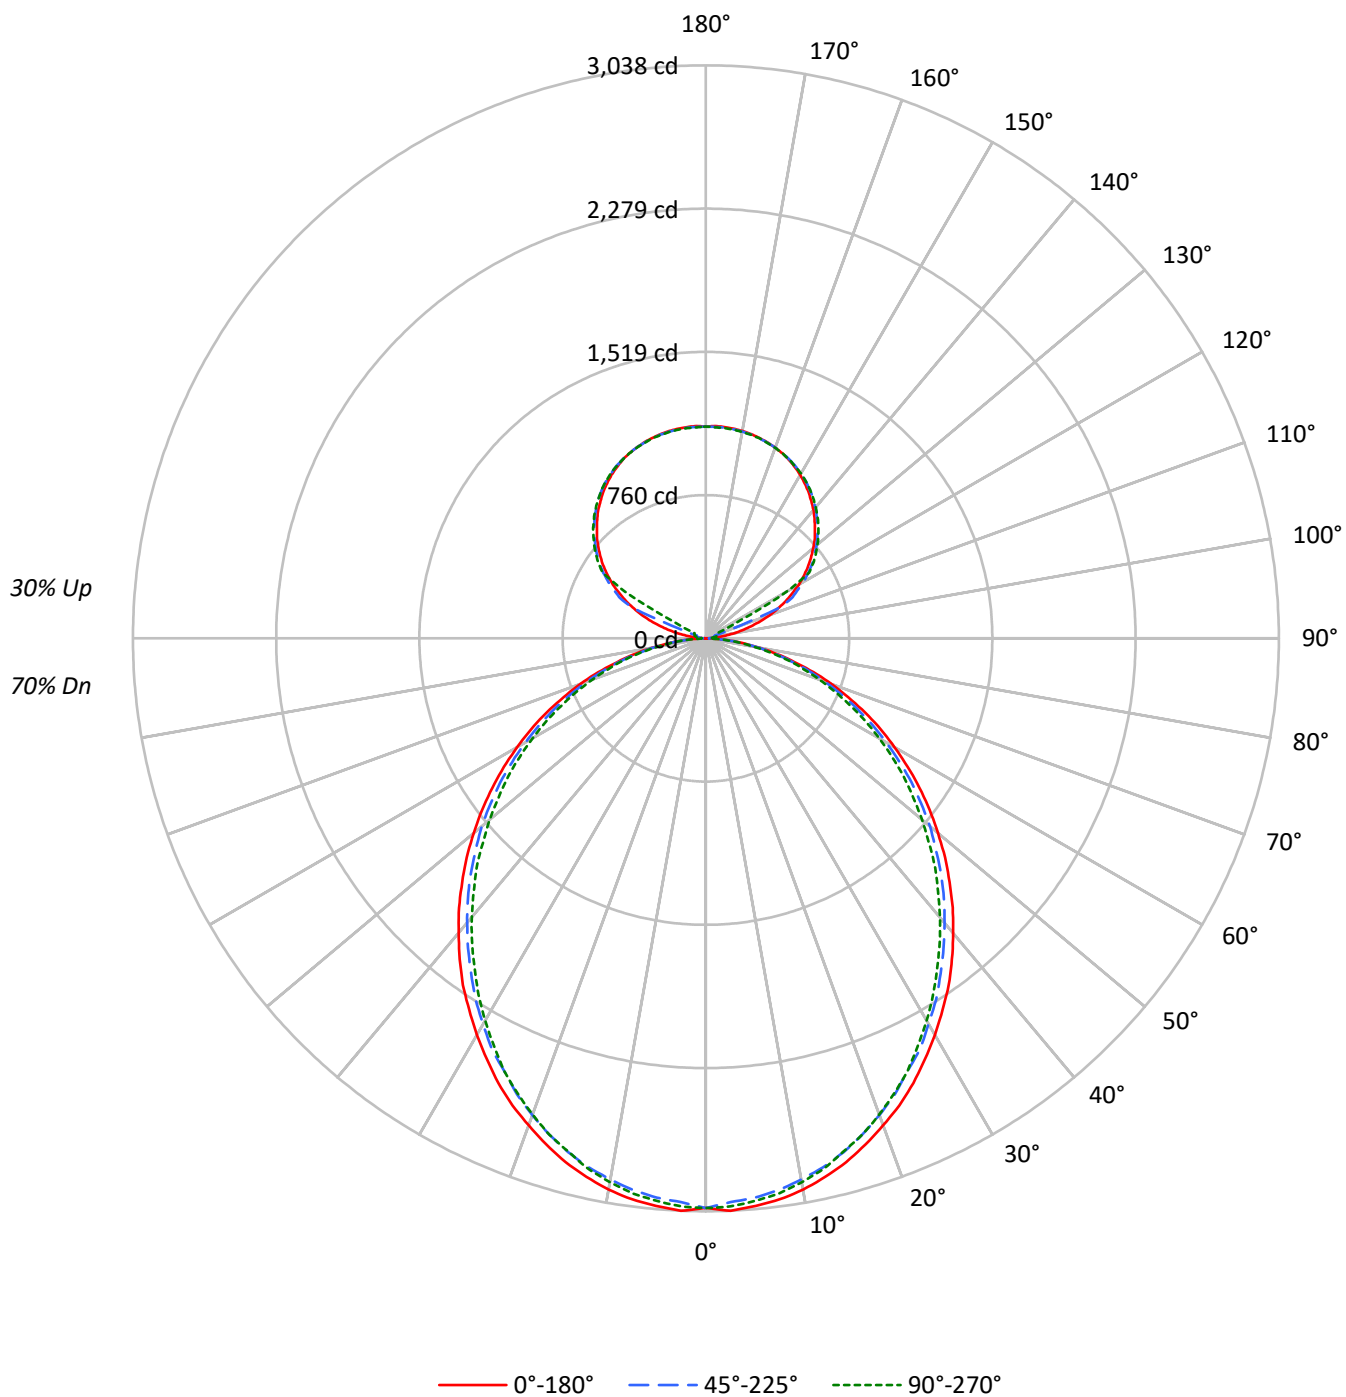

TEST NUMBER: P910799

CATALOG NUMBER: DFN2DIP-HX3F0-070D030US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	84	84	84	75	75	75
1	102	98	94	90	97	93	89	86	83	80	78	74	72	70	66	64	63
2	93	85	79	74	88	81	75	71	73	68	64	65	62	59	58	55	53
3	85	75	68	62	80	71	65	59	64	59	54	58	53	50	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	47	43	46	42	39
5	72	60	51	45	67	57	49	43	51	45	40	46	41	37	41	37	34
6	66	54	45	39	62	51	43	38	46	40	35	42	37	33	38	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	27
8	57	44	36	31	54	42	35	30	38	32	28	35	30	26	32	27	24
9	53	40	33	27	50	39	32	27	35	29	25	32	27	23	29	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3499	3499	3499
5°	3503	3448	3471
10°	3473	3399	3423
15°	3420	3341	3347
20°	3350	3260	3270
25°	3280	3165	3181
30°	3192	3076	3069
35°	3109	2972	2950
40°	3006	2866	2837
45°	2904	2760	2721
50°	2793	2648	2587
55°	2676	2519	2463
60°	2543	2367	2321
65°	2399	2208	2154
70°	2215	2014	1973
75°	1960	1782	1804
80°	1652	1487	1485
85°	1172	985	963

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2904 cd/sqm

TEST NUMBER: P910799

CATALOG NUMBER: DFN2DIP-HX3F0-070D030US850-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	284.3	2.6
10°-20°	799.9	7.3
20°-30°	1175.6	10.7
30°-40°	1365.3	12.4
40°-50°	1363.6	12.4
50°-60°	1189.1	10.8
60°-70°	879.0	8.0
70°-80°	497.3	4.5
80°-90°	133.3	1.2
90°-100°	37.0	0.3
100°-110°	138.0	1.3
110°-120°	366.1	3.3
120°-130°	607.1	5.5
130°-140°	644.9	5.9
140°-150°	599.4	5.5
150°-160°	481.9	4.4
160°-170°	310.5	2.8
170°-180°	106.9	1.0
0°-30°	2259.8	20.6
0°-40°	3625.1	33.0
0°-60°	6177.8	56.3
0°-90°	7687.4	70.0
90°-120°	541.1	4.9
90°-150°	2392.5	21.8
90°-180°	3292.0	30.0
0°-180°	10979.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3021	3021	3021	3021	3021	
5°	3021	3009	2977	3000	2995	287
15°	2876	2858	2820	2832	2818	810
25°	2602	2579	2530	2536	2530	1198
35°	2245	2216	2170	2152	2138	1402
45°	1827	1807	1763	1731	1720	1410
55°	1383	1365	1330	1296	1281	1236
65°	933	915	886	860	845	922
75°	488	482	467	450	456	521
85°	119	116	114	104	102	133
90°	1	10	16	20	22	10
95°	53	26	32	36	35	63
105°	247	271	50	58	62	264
115°	467	481	501	125	67	460
125°	660	671	687	692	695	589
135°	817	830	838	846	844	631
145°	948	947	961	967	963	593
155°	1044	1037	1046	1051	1045	481
165°	1100	1095	1098	1103	1098	311
175°	1125	1120	1121	1127	1119	107
180°	1123	1123	1123	1123	1123	

TEST NUMBER: P910799

CATALOG NUMBER: DFN2DIP-HX3F0-070D030US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3020.6	3020.6	3020.6	3020.6	3020.6
2.5°	3038.2	3023.7	2991.6	3020.6	3015.0
5°	3020.6	3009.3	2977.2	3000.3	2994.7
7.5°	3000.3	2983.0	2950.9	2974.4	2968.6
10°	2968.6	2948.2	2913.3	2936.5	2927.9
12.5°	2924.8	2907.6	2872.8	2887.2	2881.3
15°	2875.5	2858.2	2820.3	2832.1	2817.5
17.5°	2814.4	2797.2	2759.3	2773.8	2759.3
20°	2747.5	2730.4	2689.7	2698.3	2686.9
22.5°	2681.0	2654.8	2616.9	2616.9	2611.0
25°	2602.5	2579.3	2530.1	2535.6	2530.1
27.5°	2515.2	2494.9	2457.3	2448.7	2434.1
30°	2428.4	2404.9	2361.5	2352.9	2341.1
32.5°	2335.2	2318.0	2271.5	2253.9	2242.2
35°	2245.3	2216.3	2169.8	2152.2	2137.7
37.5°	2143.6	2117.4	2070.8	2050.5	2036.0
40°	2039.1	2015.7	1969.1	1943.3	1931.5
42.5°	1937.4	1914.0	1867.8	1838.5	1821.2
45°	1827.1	1806.8	1763.0	1731.3	1719.5
47.5°	1719.5	1699.2	1652.6	1620.6	1603.4
50°	1606.2	1591.6	1550.9	1510.3	1495.8
52.5°	1495.8	1475.5	1437.9	1405.9	1385.5
55°	1382.7	1365.2	1330.4	1295.5	1281.0
57.5°	1269.4	1254.8	1216.9	1182.1	1170.4
60°	1155.9	1144.5	1103.9	1071.8	1063.2
62.5°	1045.6	1025.3	996.3	967.4	955.6
65°	932.6	914.9	886.0	859.8	845.3
67.5°	816.3	801.6	775.6	755.3	743.6
70°	708.8	697.1	670.8	650.5	639.1
72.5°	598.4	586.8	572.2	551.9	543.3
75°	487.8	482.3	467.4	450.3	456.1
77.5°	389.3	377.5	371.6	363.0	354.4
80°	290.6	287.6	281.7	273.0	267.2
82.5°	197.5	197.5	194.7	183.1	183.1
85°	119.0	116.2	113.5	104.5	101.7
87.5°	52.3	46.6	40.7	32.1	28.9
90°	0.8	9.8	16.2	20.4	21.8
92.5°	20.4	17.1	19.5	21.2	21.8
95°	52.8	26.0	31.6	35.8	34.9
97.5°	95.0	28.5	41.4	43.9	44.7
100°	143.8	32.5	46.4	52.8	54.5
102.5°	197.4	195.8	47.9	56.8	59.3
105°	247.0	271.4	49.6	58.4	61.8
107.5°	304.6	324.9	51.2	60.1	63.4
110°	360.0	376.9	142.2	61.0	64.2

TEST NUMBER: P910799

CATALOG NUMBER: DFN2DIP-HX3F0-070D030US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	412.0	426.5	412.8	62.5	65.0
115°	467.1	481.0	501.3	125.1	66.7
117.5°	515.1	531.3	545.2	429.0	216.1
120°	568.7	580.9	595.5	605.3	495.6
122.5°	614.2	627.3	643.6	648.3	649.2
125°	660.5	671.1	686.6	692.2	694.7
127.5°	702.8	714.1	726.4	734.5	735.3
130°	742.6	755.7	764.5	773.4	772.8
132.5°	783.2	793.8	802.7	810.0	809.2
135°	817.3	830.4	837.6	845.8	844.2
137.5°	853.0	862.8	871.0	879.1	876.7
140°	888.0	894.5	903.4	910.7	906.7
142.5°	917.4	923.0	933.6	940.0	936.0
145°	948.2	947.3	961.2	966.8	962.7
147.5°	974.9	972.5	986.3	990.3	987.1
150°	1001.0	995.3	1008.3	1013.1	1009.1
152.5°	1022.8	1016.4	1028.6	1033.5	1027.8
155°	1044.0	1036.8	1046.5	1051.3	1044.9
157.5°	1061.1	1054.7	1062.0	1067.6	1061.1
160°	1075.7	1070.9	1075.7	1080.6	1074.8
162.5°	1088.7	1083.8	1087.9	1093.6	1086.3
165°	1100.0	1095.2	1097.7	1103.3	1097.7
167.5°	1109.0	1104.1	1106.6	1112.3	1105.0
170°	1116.3	1111.4	1113.1	1118.8	1111.4
172.5°	1121.2	1116.3	1118.0	1123.6	1116.3
175°	1125.2	1119.5	1121.2	1126.9	1118.8
177.5°	1126.9	1121.2	1122.1	1127.7	1120.4
180°	1122.9	1122.9	1122.9	1122.9	1122.9

TEST NUMBER: P910799

CATALOG NUMBER: DFN2DIP-HX3F0-070D030US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.25	14.33	14.01	15.11	16.07	12.82	13.90	13.59	14.68	15.64
	3H	14.92	15.89	15.70	16.68	17.66	14.45	15.42	15.23	16.21	17.20
	4H	15.51	16.42	16.31	17.23	18.22	15.04	15.95	15.84	16.76	17.75
	6H	15.92	16.76	16.72	17.57	18.58	15.45	16.29	16.25	17.10	18.11
	8H	16.02	16.83	16.84	17.66	18.67	15.55	16.36	16.37	17.19	18.20
	12H	16.08	16.84	16.90	17.67	18.70	15.60	16.37	16.42	17.19	18.23
4H	2H	13.73	14.65	14.53	15.45	16.45	13.39	14.30	14.19	15.11	16.10
	3H	15.61	16.37	16.42	17.21	18.22	15.22	15.98	16.03	16.82	17.83
	4H	16.33	17.02	17.15	17.86	18.90	15.93	16.62	16.75	17.46	18.50
	6H	16.85	17.45	17.69	18.31	19.35	16.44	17.04	17.28	17.90	18.95
	8H	17.00	17.56	17.84	18.42	19.47	16.59	17.15	17.44	18.01	19.07
	12H	17.08	17.58	17.94	18.46	19.52	16.66	17.17	17.53	18.04	19.11
8H	4H	16.54	17.10	17.38	17.96	19.01	16.18	16.74	17.03	17.60	18.66
	6H	17.17	17.63	18.04	18.53	19.59	16.81	17.28	17.68	18.17	19.23
	8H	17.39	17.80	18.27	18.69	19.77	17.02	17.43	17.91	18.33	19.40
	12H	17.52	17.89	18.41	18.77	19.90	17.14	17.51	18.03	18.39	19.52
12H	4H	16.53	17.04	17.40	17.92	18.98	16.18	16.69	17.05	17.57	18.63
	6H	17.20	17.61	18.08	18.51	19.58	16.85	17.26	17.73	18.16	19.23
	8H	17.45	17.81	18.33	18.69	19.82	17.09	17.46	17.98	18.34	19.47

END OF REPORT