

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913441

Luminaire Tested: DFN2DIP-HX3F0-030D050US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913441
REPORT IS A COMBINATION OF REPORTS P900750 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-030D050US927-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5941.4 lumens
Efficiency: N/A
Efficacy: 98.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 60.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913441

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US927-RLLONL

Luminous Intensity Polar Plot

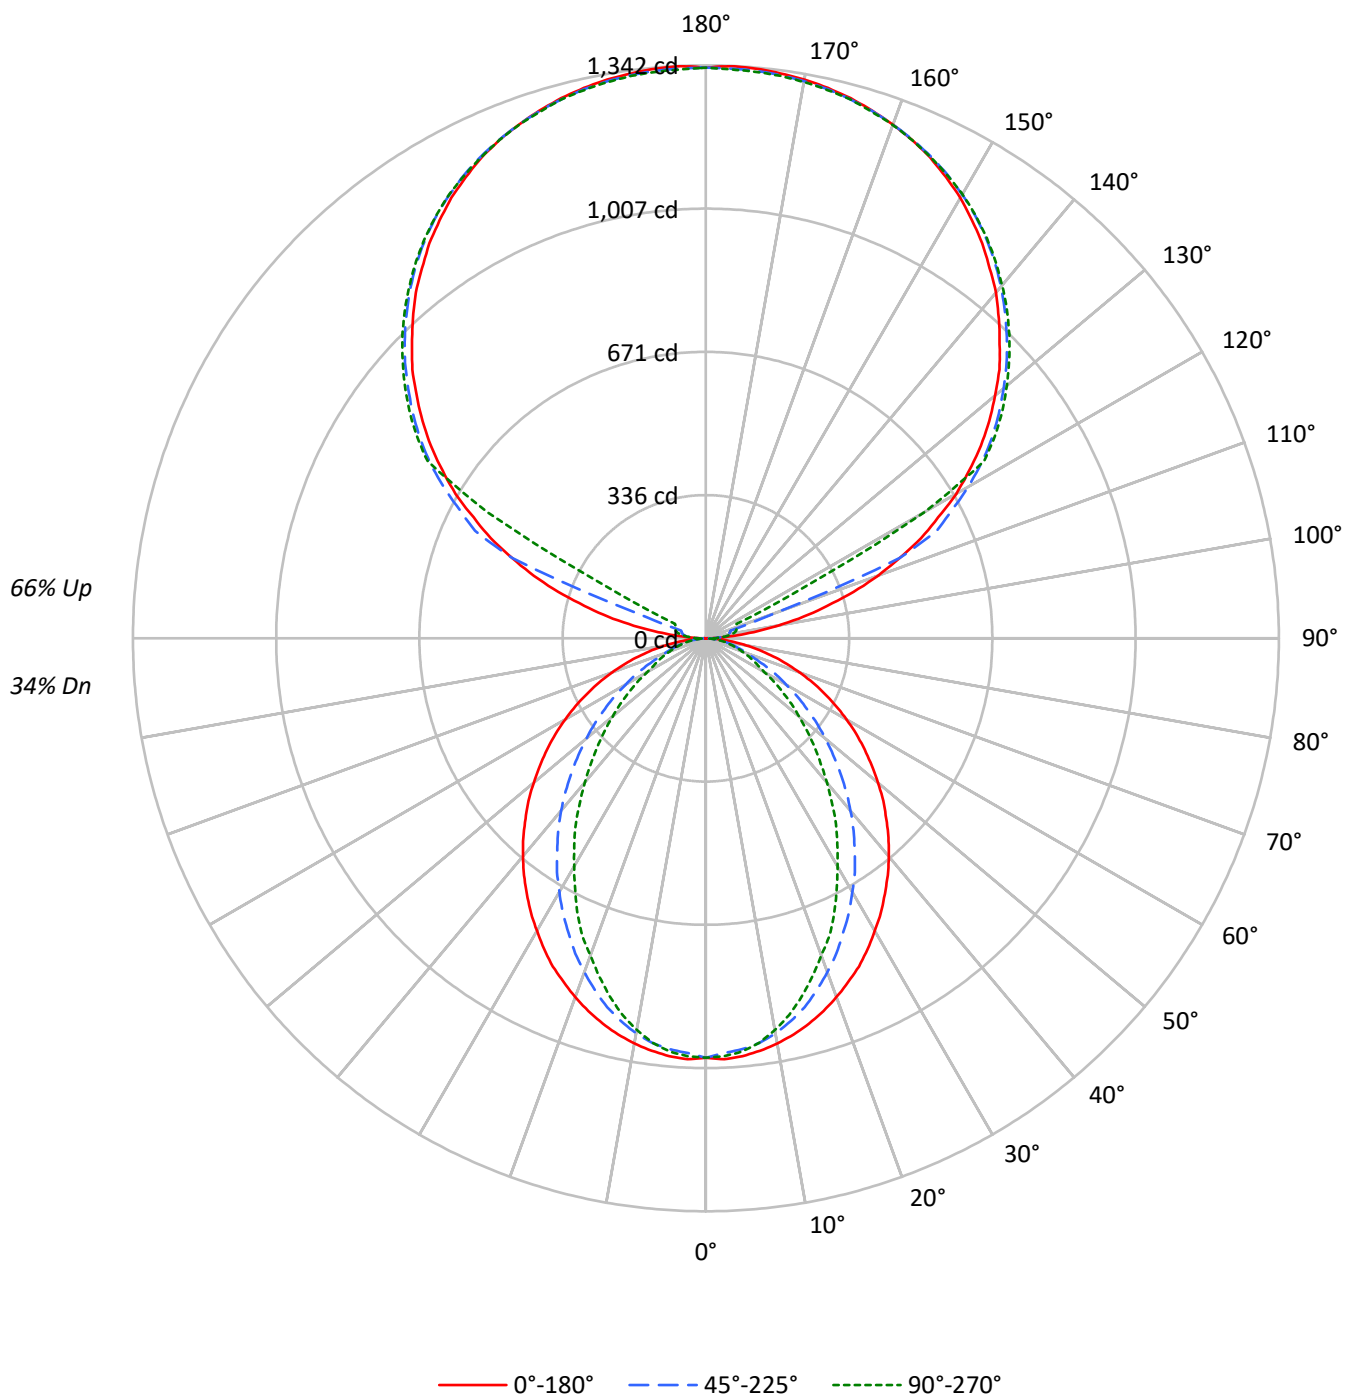

TEST NUMBER: P913441

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	95	90	87	83	85	82	79	76	66	64	62	51	49	48	37	36	36
2	86	79	74	69	78	72	67	63	58	54	52	45	43	41	33	32	30
3	79	70	63	58	71	63	58	53	51	47	44	40	37	35	30	28	26
4	72	62	55	49	65	56	50	45	46	41	37	36	33	30	27	25	23
5	66	55	48	42	60	50	44	39	41	36	32	32	29	26	24	22	20
6	61	50	42	36	55	45	39	34	37	32	28	29	26	23	22	20	18
7	57	45	37	32	51	41	34	30	34	29	25	27	23	20	20	18	16
8	52	41	33	28	47	37	31	26	31	26	22	24	21	18	19	16	14
9	49	37	30	25	44	34	28	23	28	23	20	22	19	16	17	15	13
10	46	34	27	22	41	31	25	21	26	21	18	21	17	15	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1138	1138	1138
5°	1139	1119	1126
10°	1127	1096	1089
15°	1111	1059	1032
20°	1090	1008	962
25°	1069	952	894
30°	1040	894	809
35°	1012	831	734
40°	983	767	648
45°	950	696	570
50°	915	624	493
55°	879	547	420
60°	837	467	346
65°	789	385	310
70°	731	310	280
75°	657	271	253
80°	551	225	217
85°	376	147	160

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 950 cd/sqm

TEST NUMBER: P913441

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US927-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	92.1	1.5
10°-20°	252.7	4.3
20°-30°	354.8	6.0
30°-40°	386.8	6.5
40°-50°	355.5	6.0
50°-60°	279.2	4.7
60°-70°	181.7	3.1
70°-80°	93.5	1.6
80°-90°	26.2	0.4
90°-100°	44.1	0.7
100°-110°	164.3	2.8
110°-120°	435.8	7.3
120°-130°	722.8	12.2
130°-140°	767.8	12.9
140°-150°	713.6	12.0
150°-160°	573.7	9.7
160°-170°	369.7	6.2
170°-180°	127.2	2.1
0°-30°	699.6	11.8
0°-40°	1086.3	18.3
0°-60°	1720.9	29.0
0°-90°	2022.4	34.0
90°-120°	644.2	10.8
90°-150°	2848.4	47.9
90°-180°	3919.0	66.0
0°-180°	5941.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	982	982	982	982	982	
5°	982	978	966	974	972	93
15°	934	924	894	877	868	263
25°	848	820	761	724	711	390
35°	731	685	607	551	532	457
45°	597	538	444	381	360	461
55°	454	385	289	236	219	406
65°	307	235	155	124	122	304
75°	164	101	71	65	64	173
85°	38	20	17	17	17	44
90°	1	12	19	24	26	6
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P913441

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	982.2	982.2	982.2	982.2	982.2
2.5°	986.7	982.2	972.4	981.4	979.6
5°	982.2	977.8	966.2	974.2	971.5
7.5°	974.2	968.9	956.5	960.0	955.5
10°	963.5	957.4	939.6	936.8	931.6
12.5°	950.2	942.2	918.2	912.9	903.1
15°	934.2	924.4	894.2	877.3	868.5
17.5°	915.5	901.3	864.0	844.5	830.2
20°	894.2	876.4	831.9	809.8	790.2
22.5°	871.2	850.6	799.1	768.9	755.6
25°	848.0	819.5	760.9	724.4	711.1
27.5°	820.5	790.2	725.3	683.6	663.1
30°	791.2	757.3	686.2	641.0	616.9
32.5°	762.6	721.8	649.0	595.6	573.3
35°	730.7	685.3	607.1	551.1	531.6
37.5°	699.6	650.6	568.0	506.6	484.5
40°	666.7	613.4	527.1	464.0	440.9
42.5°	632.9	576.1	486.2	420.4	398.2
45°	597.4	537.7	444.5	381.3	360.0
47.5°	563.6	500.5	404.5	341.3	321.8
50°	526.2	463.1	365.4	304.0	285.3
52.5°	489.7	423.1	328.0	269.3	252.5
55°	454.2	384.8	288.8	235.6	218.7
57.5°	417.8	346.7	254.3	204.5	190.2
60°	380.4	309.3	217.8	172.5	158.3
62.5°	344.0	272.9	186.6	144.0	137.0
65°	306.7	234.6	154.6	124.5	121.8
67.5°	271.2	199.1	124.5	109.3	106.6
70°	233.8	164.5	103.1	94.2	90.6
72.5°	198.2	132.4	86.2	79.1	77.3
75°	163.5	101.3	71.1	64.9	64.0
77.5°	128.9	71.9	56.0	52.4	50.6
80°	96.9	51.6	42.6	39.1	39.1
82.5°	67.5	34.7	29.3	27.6	27.6
85°	38.2	19.5	16.9	16.9	16.9
87.5°	14.3	7.1	7.1	6.3	6.3
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P913441

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P913441

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.85	6.56	6.94	7.65	9.13	1.82	2.54	2.91	3.62	5.11
	3H	7.51	8.15	8.61	9.24	10.74	3.00	3.64	4.10	4.73	6.23
	4H	8.11	8.71	9.21	9.81	11.31	3.44	4.05	4.55	5.14	6.65
	6H	8.52	9.07	9.63	10.17	11.69	3.75	4.31	4.87	5.40	6.92
	8H	8.63	9.16	9.75	10.28	11.79	3.84	4.37	4.96	5.48	6.99
	12H	8.69	9.19	9.81	10.30	11.83	3.87	4.38	5.00	5.48	7.02
4H	2H	5.85	6.46	6.96	7.55	9.06	2.40	3.01	3.52	4.10	5.61
	3H	7.66	8.16	8.78	9.28	10.80	3.73	4.24	4.85	5.36	6.88
	4H	8.34	8.80	9.47	9.91	11.45	4.27	4.74	5.40	5.85	7.39
	6H	8.84	9.24	9.97	10.37	11.90	4.68	5.08	5.81	6.21	7.74
	8H	9.01	9.38	10.14	10.51	12.05	4.81	5.18	5.94	6.30	7.85
	12H	9.10	9.43	10.24	10.57	12.12	4.86	5.20	6.01	6.33	7.89
8H	4H	8.30	8.67	9.43	9.79	11.34	4.54	4.91	5.67	6.03	7.58
	6H	8.85	9.16	10.00	10.32	11.87	5.05	5.35	6.20	6.52	8.06
	8H	9.06	9.33	10.22	10.48	12.04	5.24	5.50	6.39	6.65	8.21
	12H	9.19	9.43	10.35	10.57	12.17	5.35	5.58	6.51	6.72	8.32
12H	4H	8.25	8.58	9.39	9.72	11.27	4.54	4.87	5.69	6.01	7.56
	6H	8.83	9.09	9.99	10.24	11.81	5.09	5.36	6.25	6.51	8.07
	8H	9.04	9.27	10.20	10.41	12.02	5.30	5.53	6.46	6.67	8.27

END OF REPORT