

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913521

Luminaire Tested: DFN2DIP-HX3F0-060D070US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913521
REPORT IS A COMBINATION OF REPORTS P900784 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-060D070US927-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9529.9 lumens
Efficiency: N/A
Efficacy: 86.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913521

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US927-RLLONL

Luminous Intensity Polar Plot

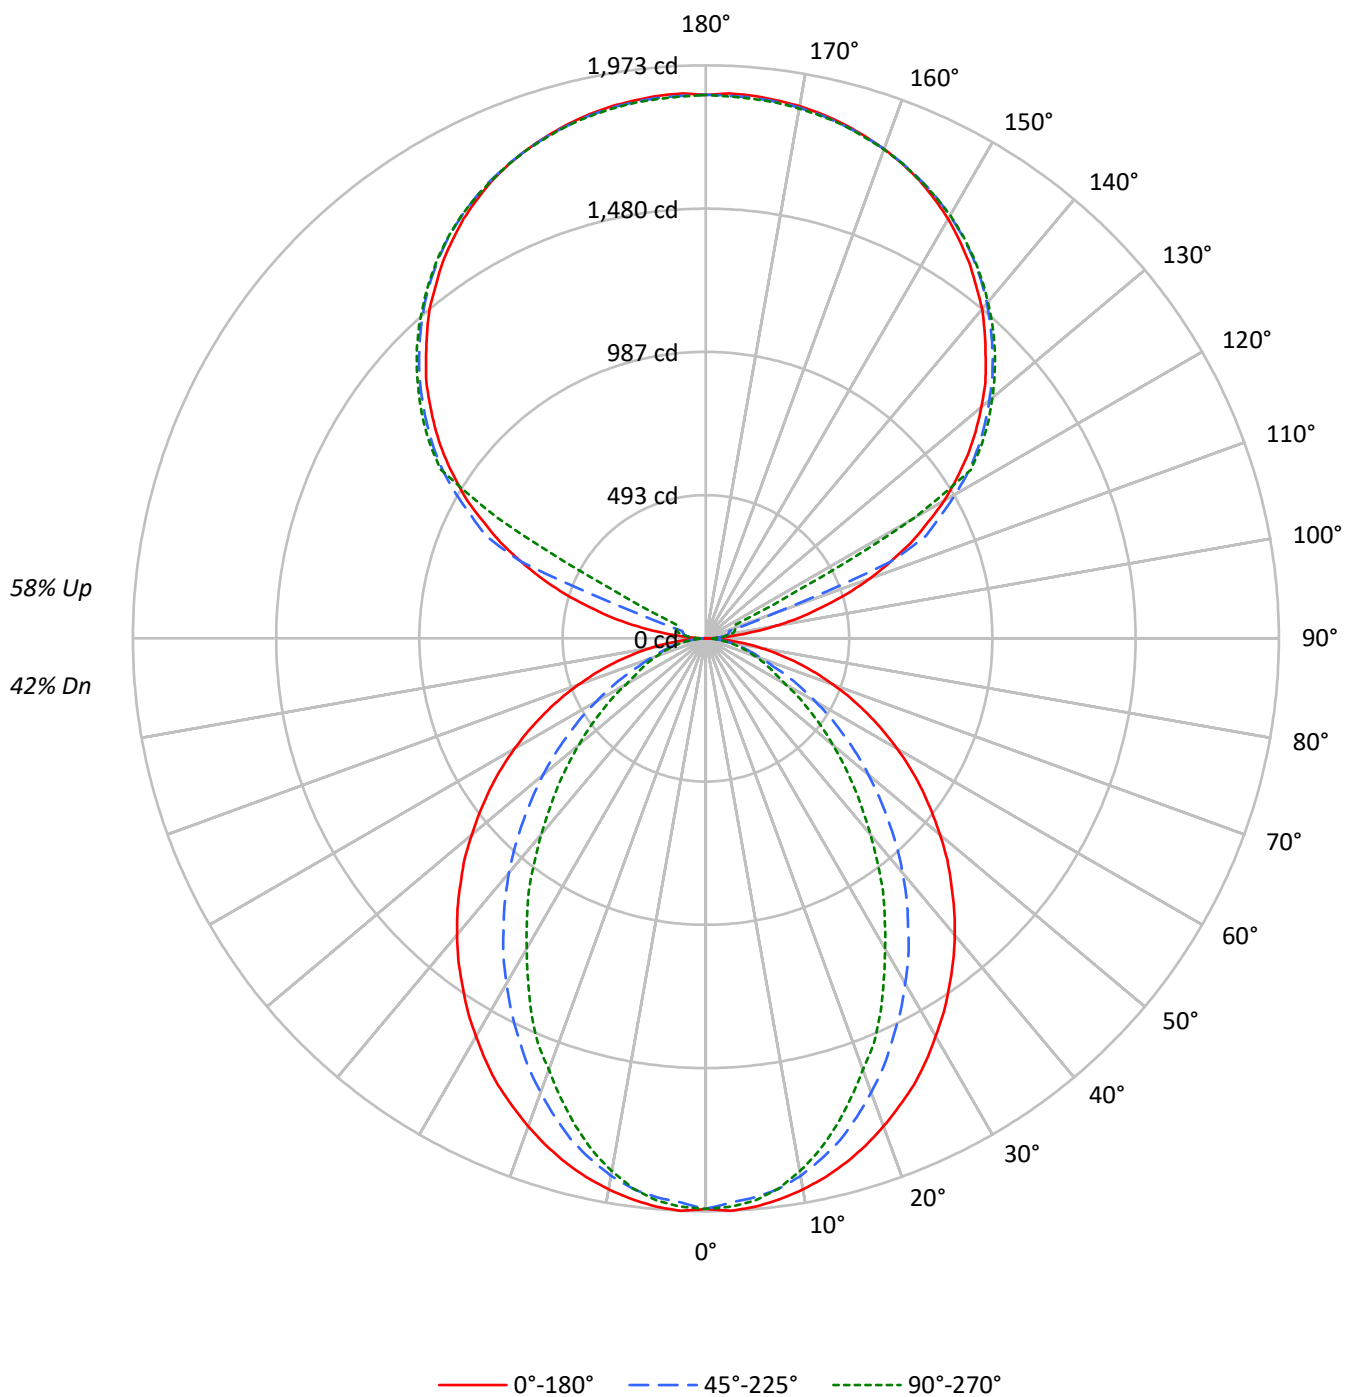

TEST NUMBER: P913521

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	89	85	88	85	81	79	70	68	66	56	55	54	44	43	42
2	88	81	75	70	80	74	69	65	62	58	55	50	48	45	39	38	36
3	81	72	65	59	74	66	60	55	55	50	47	45	42	39	35	33	31
4	74	64	56	50	67	59	52	47	49	44	40	40	36	34	32	29	27
5	68	57	49	43	62	52	46	40	44	39	35	36	32	29	29	26	24
6	63	51	43	38	57	47	40	35	40	34	31	33	29	26	26	23	21
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	35	29	49	39	32	28	33	28	24	27	24	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	21	18	16
10	47	35	28	24	43	33	26	22	28	23	20	23	20	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2276	2276	2276
5°	2278	2238	2252
10°	2255	2192	2178
15°	2222	2118	2063
20°	2180	2017	1923
25°	2137	1904	1788
30°	2080	1788	1617
35°	2023	1663	1467
40°	1966	1534	1295
45°	1899	1392	1139
50°	1830	1248	987
55°	1758	1094	841
60°	1674	934	691
65°	1578	771	620
70°	1461	619	560
75°	1314	542	507
80°	1101	450	435
85°	753	292	319

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1899 cd/sqm

TEST NUMBER: P913521

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	1.9
10°-20°	505.4	5.3
20°-30°	709.6	7.4
30°-40°	773.5	8.1
40°-50°	710.9	7.5
50°-60°	558.3	5.9
60°-70°	363.4	3.8
70°-80°	187.1	2.0
80°-90°	51.0	0.5
90°-100°	61.7	0.6
100°-110°	230.0	2.4
110°-120°	610.1	6.4
120°-130°	1011.9	10.6
130°-140°	1074.9	11.3
140°-150°	999.0	10.5
150°-160°	803.2	8.4
160°-170°	517.5	5.4
170°-180°	178.1	1.9
0°-30°	1399.1	14.7
0°-40°	2172.6	22.8
0°-60°	3441.9	36.1
0°-90°	4043.4	42.4
90°-120°	901.9	9.5
90°-150°	3987.7	41.8
90°-180°	5487.0	57.6
0°-180°	9529.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	1	16	27	34	36	9
95°	88	43	53	60	58	104
105°	412	452	83	97	103	440
115°	779	802	836	209	111	767
125°	1101	1119	1144	1154	1158	982
135°	1362	1384	1396	1410	1407	1052
145°	1580	1579	1602	1612	1605	988
155°	1740	1728	1744	1752	1742	802
165°	1834	1826	1830	1839	1830	518
175°	1876	1866	1869	1878	1865	178
180°	1871	1871	1871	1871	1871	

TEST NUMBER: P913521

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	1.3	16.2	27.0	33.9	36.5
92.5°	33.9	28.4	32.5	35.3	36.5
95°	87.9	43.3	52.8	59.7	58.2
97.5°	158.4	47.5	69.0	73.2	74.5
100°	239.8	54.2	77.2	87.9	90.7
102.5°	329.0	326.5	79.9	94.7	98.9
105°	411.7	452.3	82.6	97.4	102.9
107.5°	507.8	541.6	85.4	100.2	105.7
110°	600.0	628.3	237.0	101.6	106.9

TEST NUMBER: P913521

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	686.7	710.9	687.9	104.2	108.4
115°	778.6	801.6	835.5	208.6	111.1
117.5°	858.6	885.6	908.7	714.9	360.2
120°	947.9	968.2	992.7	1008.9	826.1
122.5°	1023.7	1045.4	1072.6	1080.6	1082.0
125°	1100.9	1118.6	1144.3	1153.8	1157.8
127.5°	1171.3	1190.3	1210.7	1224.2	1225.5
130°	1237.7	1259.4	1274.2	1289.2	1287.9
132.5°	1305.4	1323.1	1337.9	1350.1	1348.8
135°	1362.3	1384.0	1396.1	1409.8	1407.1
137.5°	1421.8	1438.1	1451.8	1465.3	1461.3
140°	1480.0	1491.0	1505.8	1518.0	1511.2
142.5°	1528.9	1538.4	1555.9	1566.7	1560.0
145°	1580.4	1579.0	1601.9	1611.5	1604.7
147.5°	1624.9	1621.0	1643.9	1650.7	1645.4
150°	1668.3	1658.9	1680.6	1688.6	1681.9
152.5°	1704.9	1694.1	1714.4	1722.5	1713.1
155°	1740.1	1728.0	1744.2	1752.3	1741.5
157.5°	1768.5	1757.8	1770.0	1779.5	1768.5
160°	1793.0	1784.8	1793.0	1801.0	1791.5
162.5°	1814.6	1806.5	1813.2	1822.7	1810.5
165°	1833.5	1825.5	1829.5	1839.0	1829.5
167.5°	1848.5	1840.2	1844.4	1853.9	1841.7
170°	1860.7	1852.5	1855.2	1864.7	1852.5
172.5°	1868.8	1860.7	1863.4	1872.9	1860.7
175°	1875.5	1866.0	1868.8	1878.2	1864.7
177.5°	1878.2	1868.8	1870.2	1879.7	1867.4
180°	1871.4	1871.4	1871.4	1871.4	1871.4

TEST NUMBER: P913521

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.21	9.98	10.24	11.01	12.39	5.19	5.96	6.21	6.99	8.36
	3H	10.87	11.56	11.91	12.60	14.00	6.37	7.06	7.40	8.09	9.49
	4H	11.48	12.13	12.52	13.17	14.57	6.81	7.46	7.86	8.50	9.91
	6H	11.89	12.49	12.95	13.53	14.95	7.13	7.73	8.18	8.77	10.19
	8H	12.01	12.58	13.07	13.64	15.05	7.21	7.78	8.27	8.84	10.26
	12H	12.07	12.61	13.13	13.66	15.10	7.25	7.79	8.32	8.85	10.28
4H	2H	9.22	9.87	10.27	10.91	12.32	5.77	6.42	6.82	7.46	8.87
	3H	11.03	11.58	12.10	12.65	14.06	7.11	7.65	8.17	8.72	10.14
	4H	11.72	12.22	12.79	13.28	14.72	7.65	8.15	8.72	9.21	10.65
	6H	12.22	12.65	13.30	13.73	15.17	8.06	8.49	9.14	9.57	11.01
	8H	12.39	12.79	13.47	13.87	15.32	8.19	8.59	9.27	9.66	11.11
	12H	12.48	12.84	13.58	13.93	15.38	8.25	8.61	9.34	9.70	11.15
8H	4H	11.68	12.08	12.76	13.15	14.60	7.92	8.32	9.00	9.40	10.85
	6H	12.24	12.57	13.34	13.68	15.13	8.43	8.76	9.53	9.88	11.33
	8H	12.45	12.74	13.55	13.84	15.30	8.62	8.91	9.73	10.01	11.47
	12H	12.58	12.83	13.69	13.93	15.43	8.73	8.99	9.84	10.08	11.59
12H	4H	11.63	11.99	12.72	13.08	14.53	7.92	8.28	9.02	9.37	10.83
	6H	12.21	12.50	13.32	13.60	15.07	8.48	8.77	9.59	9.87	11.33
	8H	12.42	12.68	13.53	13.77	15.28	8.68	8.94	9.79	10.03	11.54

END OF REPORT