

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916319

Luminaire Tested: DFN2DIP-HX3F0-090D070US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916319
REPORT IS A COMBINATION OF REPORTS P900789 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-090D070US930-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12914.3 lumens
Efficiency: N/A
Efficacy: 88.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 146.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916319

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US930-FLLONL

Luminous Intensity Polar Plot

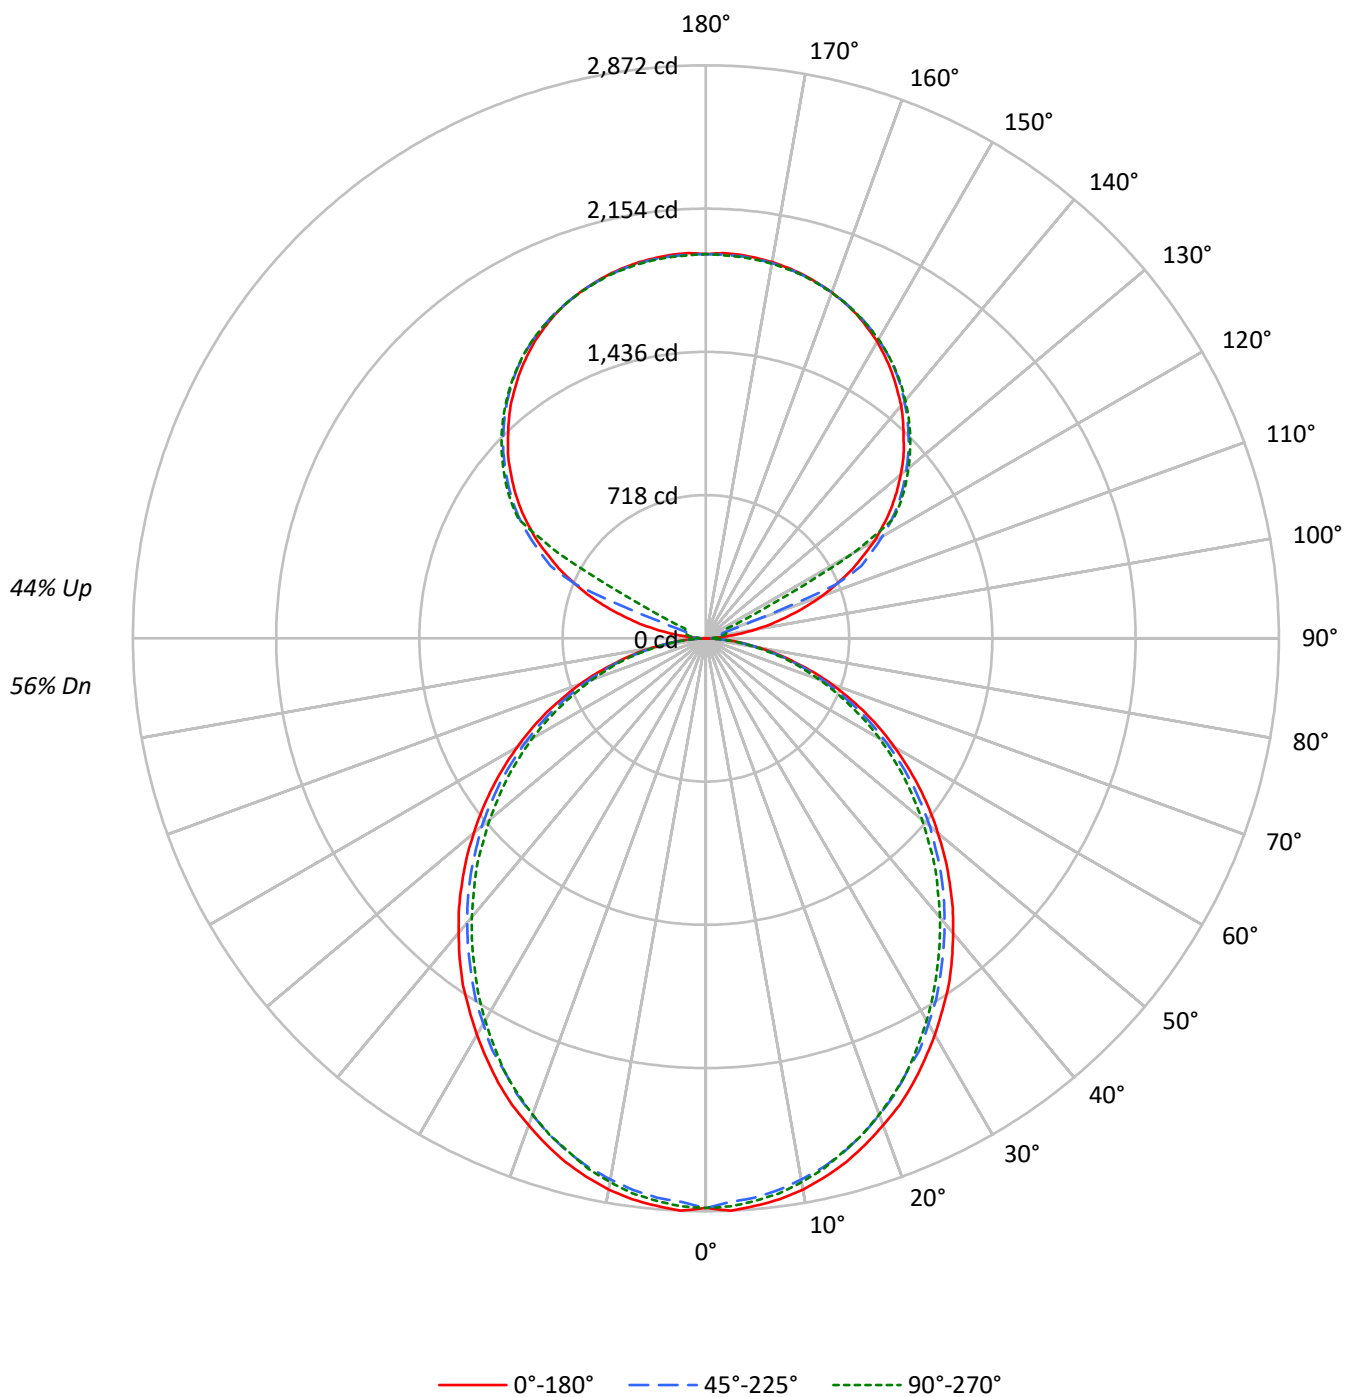

TEST NUMBER: P916319

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	109	109	109	109		101	101	101	101		87	87	87		74	74	74		62	62	62
1	99	95	91	87		92	88	85	82		76	74	71		65	63	62		55	53	52
2	90	83	77	71		84	77	72	67		67	63	59		57	54	51		48	46	44
3	82	73	65	59		76	68	61	56		59	54	50		51	47	44		43	40	38
4	75	64	56	50		70	60	53	48		52	47	42		45	41	37		38	35	32
5	69	58	49	43		64	54	46	41		47	41	37		40	36	32		34	31	28
6	64	52	43	38		59	48	41	36		42	36	32		37	32	28		31	28	25
7	59	47	39	33		55	44	37	31		38	33	28		33	29	25		29	25	22
8	55	42	35	29		51	40	33	28		35	29	25		30	26	22		26	23	20
9	51	39	31	26		48	36	30	25		32	26	23		28	23	20		24	21	18
10	48	36	28	23		44	34	27	22		30	24	20		26	21	18		22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3307	3307	3307
5°	3311	3259	3281
10°	3283	3213	3235
15°	3233	3158	3164
20°	3166	3082	3091
25°	3100	2992	3007
30°	3017	2907	2901
35°	2938	2809	2788
40°	2842	2709	2682
45°	2745	2608	2572
50°	2640	2503	2445
55°	2529	2381	2328
60°	2404	2237	2194
65°	2267	2087	2036
70°	2093	1904	1865
75°	1853	1685	1705
80°	1562	1405	1404
85°	1107	930	910

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2745 cd/sqm

TEST NUMBER: P916319

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US930-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	268.7	2.1
10°-20°	756.1	5.9
20°-30°	1111.2	8.6
30°-40°	1290.5	10.0
40°-50°	1288.9	10.0
50°-60°	1123.9	8.7
60°-70°	830.8	6.4
70°-80°	470.1	3.6
80°-90°	127.4	1.0
90°-100°	63.5	0.5
100°-110°	236.8	1.8
110°-120°	627.9	4.9
120°-130°	1041.5	8.1
130°-140°	1106.3	8.6
140°-150°	1028.1	8.0
150°-160°	826.6	6.4
160°-170°	532.6	4.1
170°-180°	183.3	1.4
0°-30°	2136.0	16.5
0°-40°	3426.5	26.5
0°-60°	5839.4	45.2
0°-90°	7267.7	56.3
90°-120°	928.2	7.2
90°-150°	4104.1	31.8
90°-180°	5647.0	43.7
0°-180°	12914.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2855	2855	2855	2855	2855	
5°	2855	2844	2814	2836	2831	271
15°	2718	2702	2666	2677	2663	765
25°	2460	2438	2391	2397	2391	1132
35°	2122	2095	2051	2034	2021	1325
45°	1727	1708	1666	1636	1625	1333
55°	1307	1290	1257	1225	1211	1169
65°	881	865	837	813	799	871
75°	461	456	442	426	431	492
85°	112	110	107	99	96	125
90°	1	17	28	35	38	12
95°	90	44	54	61	60	107
105°	424	466	85	100	106	453
115°	801	825	860	215	114	789
125°	1133	1151	1178	1188	1192	1010
135°	1402	1424	1437	1451	1448	1083
145°	1626	1625	1649	1658	1652	1017
155°	1791	1778	1795	1803	1792	825
165°	1887	1879	1883	1893	1883	533
175°	1930	1920	1923	1933	1919	184
180°	1926	1926	1926	1926	1926	

TEST NUMBER: P916319

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2855.1	2855.1	2855.1	2855.1	2855.1
2.5°	2871.7	2858.0	2827.8	2855.1	2849.9
5°	2855.1	2844.3	2814.1	2835.9	2830.6
7.5°	2835.9	2819.6	2789.3	2811.5	2805.9
10°	2805.9	2786.7	2753.8	2775.6	2767.4
12.5°	2764.5	2748.2	2715.4	2729.0	2723.5
15°	2718.0	2701.7	2665.8	2676.9	2663.2
17.5°	2660.2	2643.9	2608.1	2621.8	2608.1
20°	2597.1	2580.7	2542.3	2550.4	2539.7
22.5°	2534.1	2509.4	2473.5	2473.5	2468.0
25°	2459.8	2438.0	2391.4	2396.7	2391.4
27.5°	2377.4	2358.2	2322.7	2314.6	2300.9
30°	2295.3	2273.1	2232.0	2223.9	2212.9
32.5°	2207.3	2191.0	2147.0	2130.5	2119.4
35°	2122.3	2094.9	2050.9	2034.3	2020.6
37.5°	2026.2	2001.4	1957.4	1938.2	1924.5
40°	1927.4	1905.3	1861.2	1836.8	1825.8
42.5°	1831.2	1809.1	1765.4	1737.8	1721.5
45°	1727.0	1707.8	1666.4	1636.4	1625.4
47.5°	1625.4	1606.1	1562.1	1531.9	1515.6
50°	1518.2	1504.5	1466.0	1427.6	1413.9
52.5°	1413.9	1394.6	1359.1	1328.9	1309.6
55°	1307.0	1290.4	1257.4	1224.6	1210.9
57.5°	1199.8	1186.1	1150.3	1117.4	1106.3
60°	1092.6	1081.8	1043.3	1013.1	1004.9
62.5°	988.3	969.1	941.7	914.4	903.3
65°	881.4	864.8	837.4	812.7	799.0
67.5°	771.6	757.7	733.1	714.0	702.9
70°	669.9	658.8	634.1	614.9	604.1
72.5°	565.7	554.6	540.9	521.7	513.6
75°	461.1	455.8	441.9	425.6	431.1
77.5°	367.9	356.9	351.3	343.2	335.0
80°	274.7	271.7	266.2	258.0	252.6
82.5°	186.7	186.7	184.1	173.0	173.0
85°	112.4	109.8	107.2	98.7	96.1
87.5°	49.5	43.9	38.5	30.3	27.4
90°	1.3	16.7	27.8	34.9	37.6
92.5°	34.9	29.3	33.4	36.3	37.6
95°	90.5	44.5	54.3	61.4	59.9
97.5°	163.0	48.8	71.0	75.3	76.6
100°	246.8	55.8	79.4	90.5	93.4
102.5°	338.6	336.0	82.3	97.5	101.7
105°	423.7	465.5	85.0	100.3	105.9
107.5°	522.6	557.4	87.9	103.1	108.8
110°	617.5	646.6	243.9	104.6	110.1

TEST NUMBER: P916319

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	706.7	731.6	708.0	107.2	111.5
115°	801.4	825.0	859.9	214.7	114.4
117.5°	883.6	911.4	935.2	735.8	370.7
120°	975.6	996.5	1021.7	1038.4	850.2
122.5°	1053.5	1075.9	1103.9	1112.1	1113.6
125°	1133.0	1151.2	1177.7	1187.5	1191.6
127.5°	1205.5	1225.0	1246.0	1260.0	1261.3
130°	1273.8	1296.2	1311.4	1326.8	1325.5
132.5°	1343.5	1361.7	1377.0	1389.5	1388.2
135°	1402.1	1424.4	1436.9	1450.9	1448.1
137.5°	1463.3	1480.1	1494.1	1508.1	1503.9
140°	1523.2	1534.5	1549.7	1562.3	1555.3
142.5°	1573.5	1583.3	1601.3	1612.4	1605.5
145°	1626.5	1625.1	1648.7	1658.5	1651.5
147.5°	1672.3	1668.3	1691.9	1698.8	1693.4
150°	1717.0	1707.3	1729.7	1737.9	1731.0
152.5°	1754.6	1743.5	1764.4	1772.8	1763.1
155°	1790.9	1778.4	1795.1	1803.4	1792.4
157.5°	1820.2	1809.1	1821.6	1831.4	1820.2
160°	1845.3	1836.9	1845.3	1853.6	1843.8
162.5°	1867.5	1859.2	1866.1	1875.9	1863.4
165°	1887.0	1878.8	1882.8	1892.6	1882.8
167.5°	1902.4	1893.9	1898.3	1908.0	1895.5
170°	1915.0	1906.6	1909.3	1919.1	1906.6
172.5°	1923.3	1915.0	1917.8	1927.5	1915.0
175°	1930.2	1920.4	1923.3	1933.0	1919.1
177.5°	1933.0	1923.3	1924.8	1934.5	1921.9
180°	1926.1	1926.1	1926.1	1926.1	1926.1

TEST NUMBER: P916319

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.94	12.87	12.85	13.79	14.97	11.52	12.44	12.42	13.36	14.54
	3H	13.60	14.43	14.51	15.36	16.56	13.13	13.96	14.05	14.89	16.09
	4H	14.19	14.97	15.12	15.90	17.12	13.72	14.50	14.65	15.44	16.65
	6H	14.58	15.30	15.52	16.25	17.47	14.11	14.83	15.05	15.78	17.00
	8H	14.69	15.37	15.63	16.33	17.56	14.22	14.90	15.17	15.86	17.09
	12H	14.73	15.39	15.69	16.34	17.59	14.26	14.91	15.21	15.87	17.11
4H	2H	12.41	13.19	13.34	14.13	15.34	12.07	12.85	13.00	13.78	15.00
	3H	14.27	14.93	15.22	15.89	17.12	13.88	14.54	14.83	15.50	16.73
	4H	14.98	15.58	15.94	16.54	17.79	14.58	15.18	15.54	16.14	17.39
	6H	15.49	16.01	16.46	16.99	18.24	15.09	15.60	16.06	16.59	17.84
	8H	15.64	16.12	16.61	17.10	18.37	15.24	15.72	16.20	16.69	17.96
	12H	15.71	16.15	16.70	17.14	18.41	15.30	15.73	16.29	16.73	18.00
8H	4H	15.18	15.66	16.15	16.64	17.90	14.82	15.30	15.79	16.28	17.55
	6H	15.81	16.20	16.80	17.22	18.49	15.45	15.84	16.44	16.86	18.13
	8H	16.02	16.37	17.03	17.38	18.66	15.66	16.01	16.66	17.02	18.30
	12H	16.15	16.46	17.16	17.46	18.79	15.77	16.08	16.78	17.08	18.41
12H	4H	15.17	15.60	16.16	16.60	17.87	14.82	15.25	15.81	16.25	17.52
	6H	15.84	16.19	16.84	17.19	18.48	15.49	15.84	16.49	16.85	18.13
	8H	16.07	16.38	17.08	17.38	18.71	15.72	16.03	16.73	17.03	18.36