

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926883

Luminaire Tested: DFN2DIP-HX4F0-040D070US830-FLLFLL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P926883
REPORT IS A COMBINATION OF REPORTS P899353 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-040D070US830-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9571.1 lumens
Efficiency: N/A
Efficacy: 110.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 86.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926883

CATALOG NUMBER: DFN2DIP-HX4F0-040D070US830-FLLFLL

Luminous Intensity Polar Plot

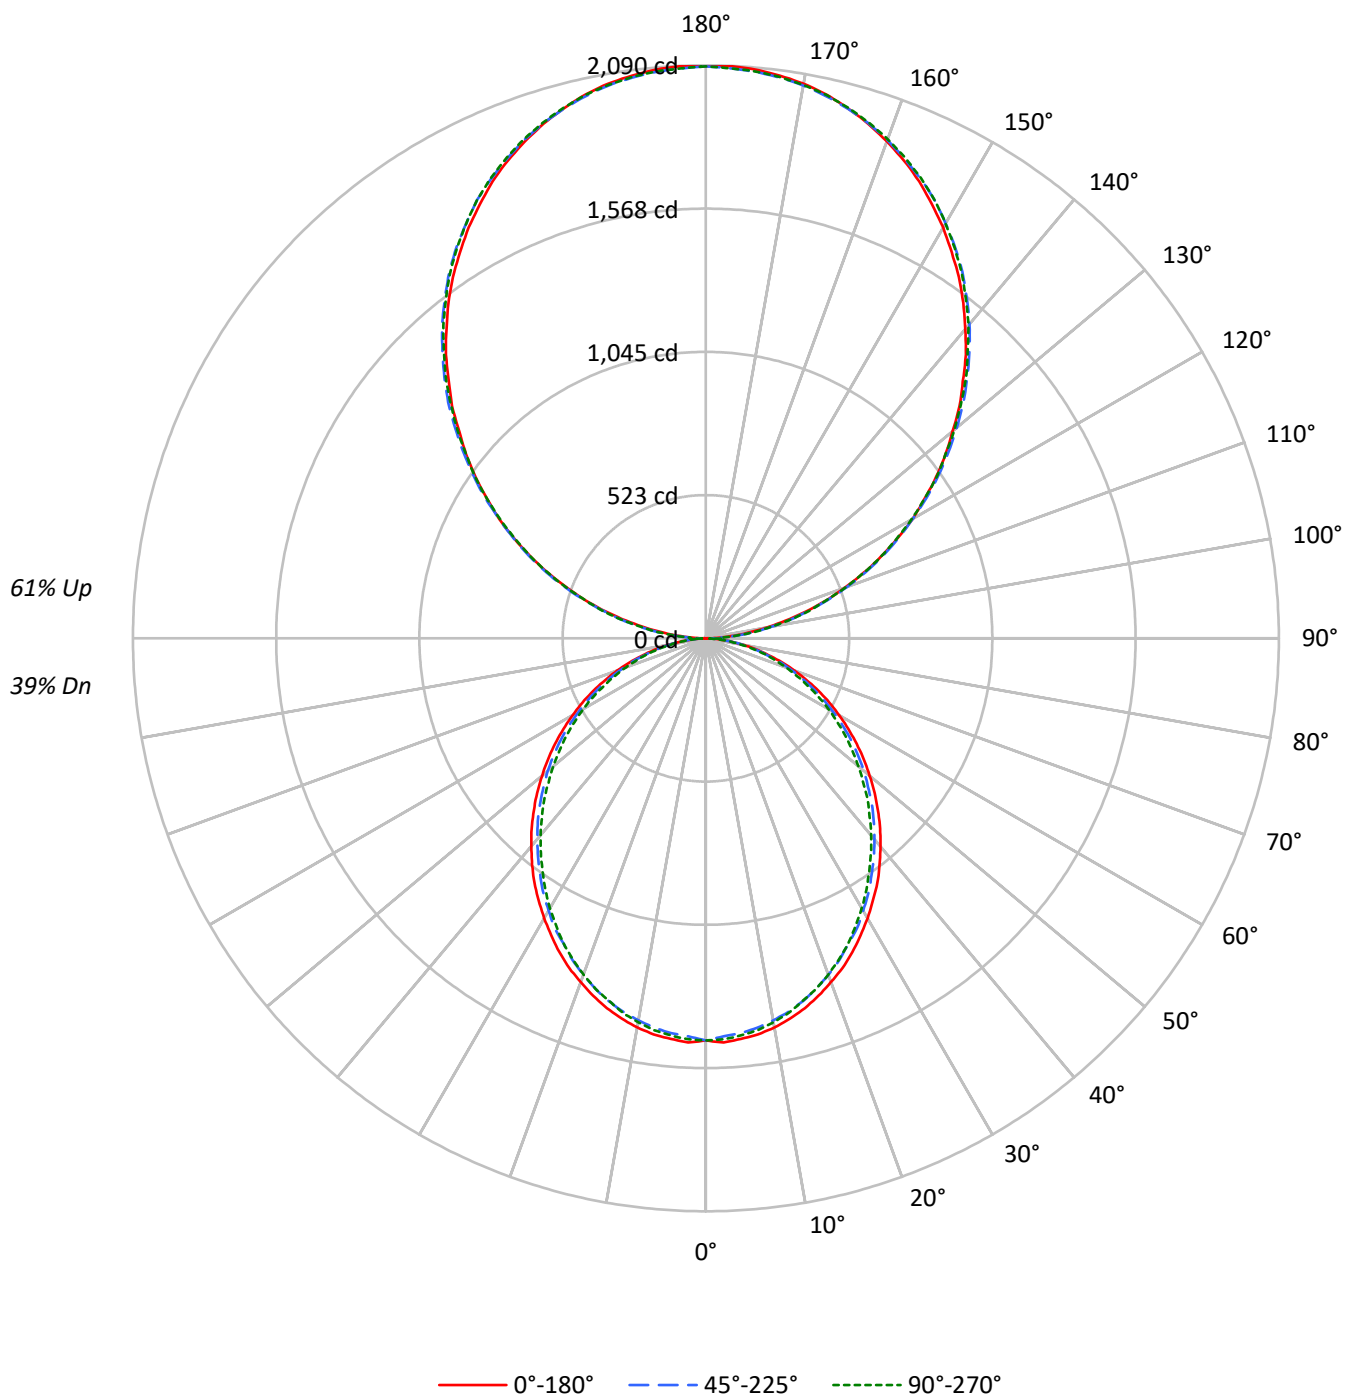

TEST NUMBER: P926883

CATALOG NUMBER: DFN2DIP-HX4F0-040D070US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	95	91	87	84	86	83	80	77	68	65	63	54	52	51	41	40	39
2	87	79	73	68	79	72	67	63	59	56	52	47	45	42	36	34	33
3	79	70	63	57	72	64	58	53	52	48	44	42	38	36	32	30	28
4	72	62	54	48	65	56	50	44	46	41	37	37	33	31	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	29	27	26	23	21
6	61	49	41	36	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	37	31	51	41	34	29	34	28	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	26	31	26	22	25	21	18	19	17	15
9	49	37	29	24	44	34	27	23	28	23	19	23	19	16	18	15	13
10	45	34	26	22	41	31	25	20	26	21	18	21	17	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1091	1091	1091
5°	1093	1076	1083
10°	1084	1061	1068
15°	1068	1044	1045
20°	1046	1020	1022
25°	1025	991	995
30°	998	964	960
35°	973	932	924
40°	942	900	889
45°	911	868	854
50°	877	834	813
55°	841	795	775
60°	801	749	732
65°	757	701	681
70°	701	643	626
75°	624	573	576
80°	531	484	479
85°	385	329	319

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1574 cd/sqm

TEST NUMBER: P926883

CATALOG NUMBER: DFN2DIP-HX4F0-040D070US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.1	1.4
10°-20°	388.5	4.1
20°-30°	570.9	6.0
30°-40°	663.1	6.9
40°-50°	662.2	6.9
50°-60°	577.4	6.0
60°-70°	426.9	4.5
70°-80°	241.5	2.5
80°-90°	69.7	0.7
90°-100°	129.1	1.3
100°-110°	410.2	4.3
110°-120°	702.0	7.3
120°-130°	923.3	9.6
130°-140°	1036.4	10.8
140°-150°	1016.3	10.6
150°-160°	852.5	8.9
160°-170°	565.4	5.9
170°-180°	197.6	2.1
0°-30°	1097.4	11.5
0°-40°	1760.5	18.4
0°-60°	3000.2	31.3
0°-90°	3738.2	39.1
90°-120°	1241.4	13.0
90°-150°	4217.4	44.1
90°-180°	5833.0	60.9
0°-180°	9571.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1467	1467	1467	1467	1467	
5°	1467	1461	1446	1457	1454	139
15°	1396	1388	1370	1375	1368	393
25°	1264	1253	1229	1231	1229	582
35°	1090	1076	1054	1045	1038	681
45°	887	878	856	841	835	685
55°	672	663	646	629	622	600
65°	453	444	430	418	411	448
75°	237	234	227	219	222	253
85°	58	56	55	51	49	64
90°	2	23	62	58	60	9
95°	92	109	113	113	109	102
105°	379	384	388	391	391	400
115°	704	715	712	710	704	697
125°	1025	1040	1035	1030	1028	916
135°	1325	1345	1349	1347	1342	1024
145°	1609	1622	1632	1634	1627	1005
155°	1840	1845	1851	1860	1854	847
165°	2002	2000	2000	2012	2004	565
175°	2083	2078	2074	2086	2076	198
180°	2086	2086	2086	2086	2086	

TEST NUMBER: P926883

CATALOG NUMBER: DFN2DIP-HX4F0-040D070US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1466.9	1466.9	1466.9	1466.9	1466.9
2.5°	1475.5	1468.4	1452.9	1466.9	1464.3
5°	1466.9	1461.3	1445.8	1457.0	1454.4
7.5°	1457.0	1448.6	1433.1	1444.5	1441.6
10°	1441.6	1431.8	1414.9	1426.1	1421.9
12.5°	1420.3	1412.0	1395.1	1402.2	1399.2
15°	1396.4	1388.0	1369.6	1375.3	1368.3
17.5°	1366.8	1358.4	1340.0	1347.0	1340.0
20°	1334.3	1325.9	1306.2	1310.4	1304.9
22.5°	1302.0	1289.2	1270.9	1270.9	1268.0
25°	1263.8	1252.6	1228.6	1231.4	1228.6
27.5°	1221.5	1211.6	1193.4	1189.2	1182.2
30°	1179.3	1167.9	1146.8	1142.6	1136.9
32.5°	1134.1	1125.7	1103.1	1094.6	1088.9
35°	1090.4	1076.3	1053.7	1045.2	1038.2
37.5°	1041.0	1028.3	1005.6	995.8	988.8
40°	990.3	978.9	956.3	943.7	938.1
42.5°	940.9	929.5	907.1	892.8	884.4
45°	887.3	877.5	856.2	840.8	835.1
47.5°	835.1	825.2	802.6	787.1	778.7
50°	780.0	772.9	753.2	733.5	726.4
52.5°	726.4	716.6	698.3	682.7	672.9
55°	671.5	663.0	646.1	629.1	622.1
57.5°	616.4	609.4	590.9	574.1	568.4
60°	561.4	555.8	536.1	520.5	516.3
62.5°	507.8	497.9	483.9	469.7	464.1
65°	452.9	444.3	430.3	417.5	410.6
67.5°	396.4	389.3	376.7	366.8	361.2
70°	344.2	338.5	325.8	315.9	310.4
72.5°	290.7	284.9	277.9	268.0	263.8
75°	236.9	234.2	227.0	218.7	221.5
77.5°	189.0	183.3	180.5	176.2	172.1
80°	141.1	139.6	136.8	132.6	129.8
82.5°	95.9	95.9	94.6	88.9	88.9
85°	57.8	56.5	55.0	50.7	49.4
87.5°	25.4	22.6	19.8	15.6	14.0
90°	1.9	22.6	61.6	57.9	59.8
92.5°	39.0	52.9	54.8	56.6	56.6
95°	91.8	109.4	112.6	112.6	109.4
97.5°	152.9	169.2	176.2	176.2	176.2
100°	223.3	237.8	242.8	242.8	240.9
102.5°	297.5	308.2	315.2	317.1	315.2
105°	378.7	383.7	387.5	390.7	390.7
107.5°	459.2	466.7	466.7	468.0	459.2
110°	537.2	547.3	547.3	547.3	542.2

TEST NUMBER: P926883

CATALOG NUMBER: DFN2DIP-HX4F0-040D070US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	621.5	632.2	630.3	625.3	621.5
115°	704.5	714.6	711.5	709.6	704.5
117.5°	786.9	800.7	792.0	786.9	781.9
120°	869.9	883.8	869.9	869.9	864.3
122.5°	945.4	963.0	954.3	949.2	945.4
125°	1024.7	1040.4	1035.4	1029.8	1027.9
127.5°	1102.1	1121.6	1114.7	1107.2	1102.1
130°	1174.4	1197.1	1194.0	1190.2	1183.2
132.5°	1255.6	1273.2	1274.4	1265.7	1260.6
135°	1325.4	1344.9	1348.7	1346.7	1341.7
137.5°	1403.4	1419.1	1422.2	1421.0	1413.5
140°	1472.0	1487.7	1496.5	1496.5	1489.6
142.5°	1542.4	1558.1	1563.1	1565.0	1558.1
145°	1609.1	1621.7	1631.8	1633.6	1626.8
147.5°	1668.9	1684.6	1692.2	1695.3	1688.4
150°	1730.5	1741.2	1748.1	1753.8	1748.1
152.5°	1785.2	1795.9	1804.7	1811.7	1804.7
155°	1839.9	1844.9	1850.7	1859.5	1853.8
157.5°	1887.2	1890.9	1894.0	1906.7	1897.8
160°	1929.3	1933.1	1935.0	1945.6	1938.1
162.5°	1968.3	1968.3	1970.2	1982.1	1973.3
165°	2001.6	1999.7	1999.7	2012.3	2003.5
167.5°	2031.8	2026.2	2026.2	2038.7	2030.0
170°	2054.5	2049.5	2047.6	2060.1	2049.5
172.5°	2070.2	2065.1	2063.2	2075.9	2065.1
175°	2082.7	2077.7	2074.0	2086.5	2075.9
177.5°	2089.7	2084.6	2080.9	2091.6	2080.9
180°	2086.5	2086.5	2086.5	2086.5	2086.5

TEST NUMBER: P926883

CATALOG NUMBER: DFN2DIP-HX4F0-040D070US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.47	7.24	7.51	8.29	9.71	6.04	6.81	7.08	7.86	9.28
	3H	8.12	8.81	9.18	9.87	11.31	7.65	8.34	8.70	9.40	10.84
	4H	8.71	9.36	9.77	10.42	11.87	8.23	8.89	9.30	9.95	11.39
	6H	9.10	9.71	10.18	10.77	12.23	8.63	9.23	9.70	10.29	11.75
	8H	9.20	9.78	10.29	10.86	12.31	8.73	9.30	9.81	10.38	11.84
	12H	9.25	9.80	10.34	10.87	12.35	8.77	9.31	9.85	10.39	11.87
4H	2H	6.92	7.57	7.99	8.64	10.08	6.57	7.23	7.65	8.29	9.74
	3H	8.78	9.32	9.86	10.41	11.87	8.38	8.93	9.47	10.02	11.48
	4H	9.49	9.99	10.58	11.07	12.55	9.08	9.59	10.17	10.66	12.14
	6H	10.00	10.43	11.09	11.53	13.01	9.59	10.02	10.69	11.12	12.60
	8H	10.15	10.55	11.24	11.64	13.13	9.74	10.14	10.83	11.23	12.72
	12H	10.22	10.58	11.33	11.69	13.18	9.79	10.16	10.91	11.27	12.76
8H	4H	9.68	10.08	10.77	11.18	12.66	9.32	9.72	10.41	10.82	12.30
	6H	10.31	10.64	11.42	11.78	13.26	9.94	10.28	11.06	11.41	12.90
	8H	10.53	10.82	11.65	11.94	13.44	10.16	10.45	11.28	11.57	13.07
	12H	10.66	10.91	11.78	12.03	13.57	10.27	10.53	11.40	11.64	13.19
12H	4H	9.66	10.02	10.77	11.13	12.63	9.31	9.67	10.42	10.78	12.27
	6H	10.34	10.63	11.46	11.75	13.25	9.99	10.28	11.11	11.40	12.90
	8H	10.58	10.83	11.70	11.95	13.49	10.22	10.47	11.35	11.59	13.13

END OF REPORT