

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924750

Luminaire Tested: DFN2DIP-PN2F0-050D060US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924750
REPORT IS A COMBINATION OF REPORTS P899508 AND P896349
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN2F0-050D060US950-RLLFLL
Description: 2 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9120.3 lumens
Efficiency: N/A
Efficacy: 87.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.17' x L: 2.29' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 103.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924750

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US950-RLLFLL

Luminous Intensity Polar Plot

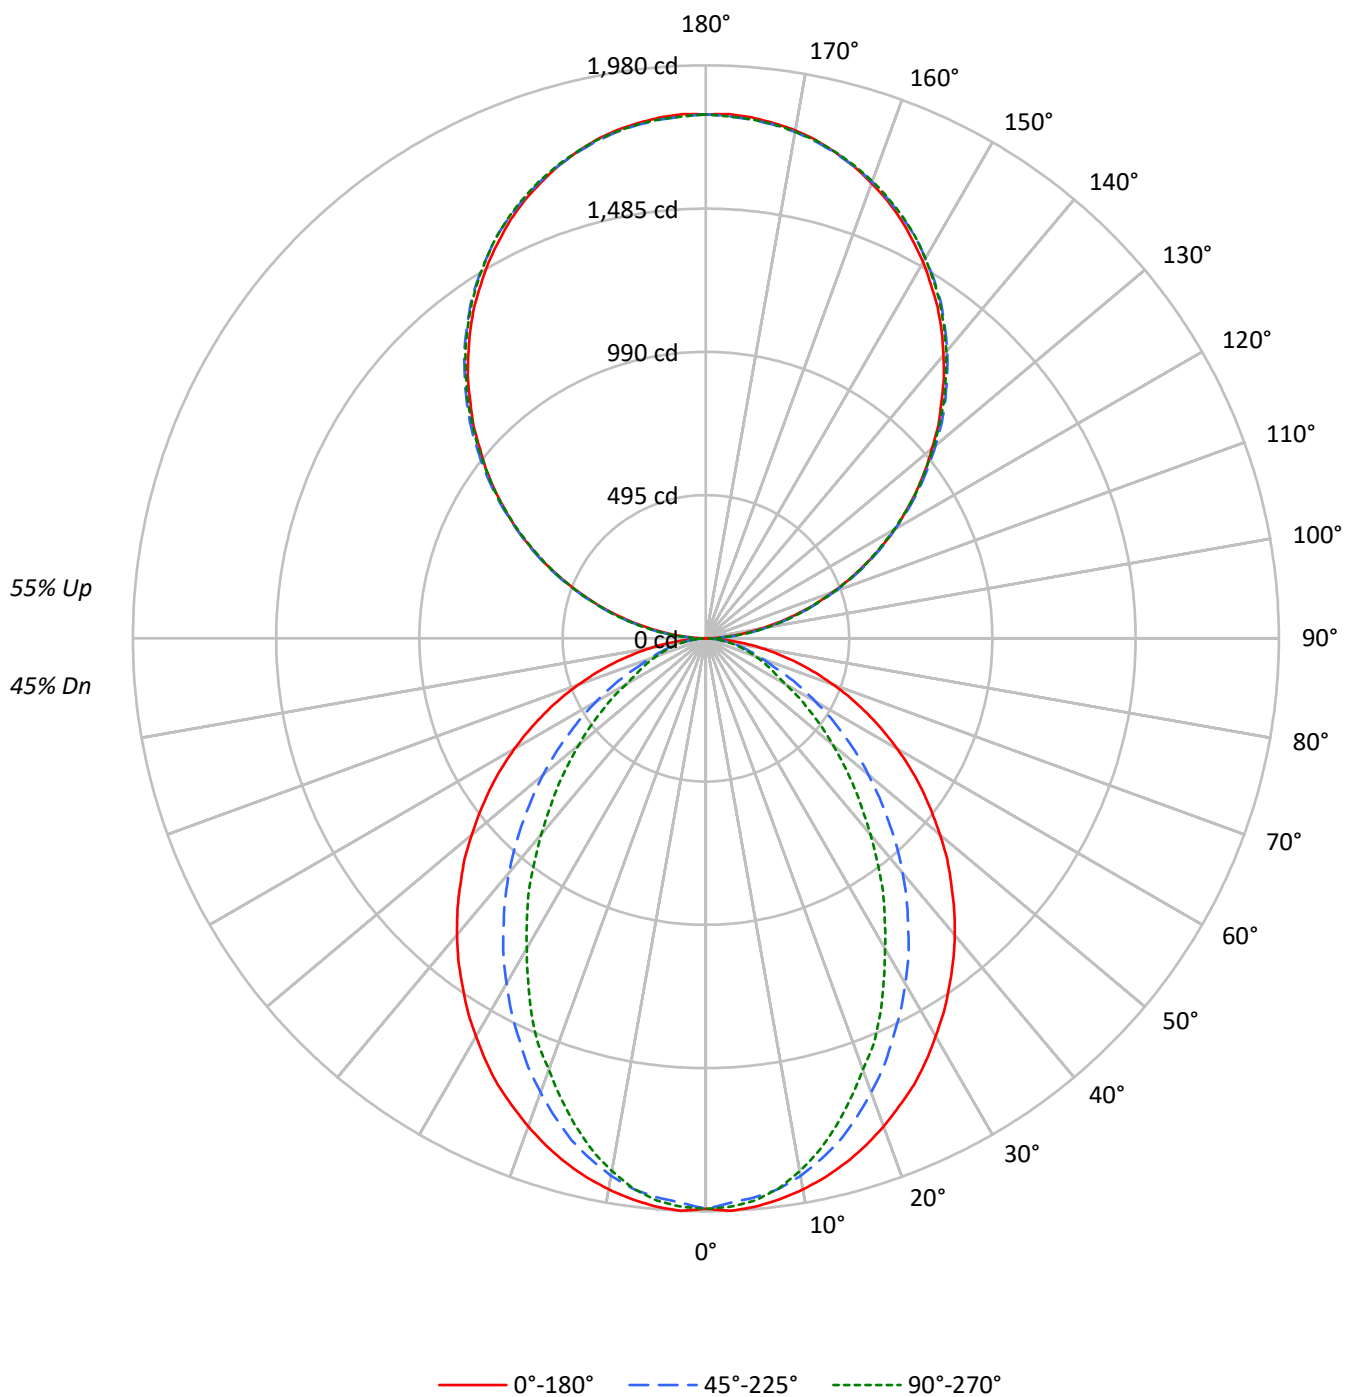

TEST NUMBER: P924750

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	93	89	86	89	85	82	79	71	69	67	58	56	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	51	49	47	41	39	38
3	81	72	65	59	74	66	60	55	56	51	47	46	43	40	37	34	33
4	74	64	56	51	68	59	52	47	50	45	41	41	37	35	33	30	28
5	68	57	49	44	63	53	46	41	45	39	35	37	33	30	30	27	25
6	63	51	44	38	58	48	41	36	40	35	31	34	30	27	27	24	22
7	58	47	39	33	54	43	36	31	37	31	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	31	27	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	36	29	24	43	33	27	23	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4270	4270	4270
5°	4270	4193	4223
10°	4221	4102	4079
15°	4156	3957	3861
20°	4072	3762	3595
25°	3986	3545	3339
30°	3873	3323	3016
35°	3762	3085	2733
40°	3649	2840	2409
45°	3519	2569	2116
50°	3383	2297	1830
55°	3240	2007	1555
60°	3075	1706	1274
65°	2884	1400	1140
70°	2653	1116	1023
75°	2362	965	918
80°	1943	785	777
85°	1271	488	552

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3519 cd/sqm

TEST NUMBER: P924750

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	2.0
10°-20°	507.2	5.6
20°-30°	712.1	7.8
30°-40°	776.3	8.5
40°-50°	713.5	7.8
50°-60°	560.3	6.1
60°-70°	364.7	4.0
70°-80°	187.7	2.1
80°-90°	53.1	0.6
90°-100°	112.0	1.2
100°-110°	355.9	3.9
110°-120°	609.1	6.7
120°-130°	801.1	8.8
130°-140°	899.2	9.9
140°-150°	881.7	9.7
150°-160°	739.6	8.1
160°-170°	490.5	5.4
170°-180°	171.4	1.9
0°-30°	1404.1	15.4
0°-40°	2180.4	23.9
0°-60°	3454.1	37.9
0°-90°	4059.7	44.5
90°-120°	1077.0	11.8
90°-150°	3659.0	40.1
90°-180°	5061.0	55.5
0°-180°	9120.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	2	20	54	50	52	9
95°	80	95	98	98	95	89
105°	329	333	336	339	339	347
115°	611	620	617	616	611	605
125°	889	903	898	893	892	794
135°	1150	1167	1170	1168	1164	889
145°	1396	1407	1416	1417	1411	872
155°	1596	1601	1606	1613	1608	735
165°	1737	1735	1735	1746	1738	490
175°	1807	1803	1799	1810	1801	172
180°	1810	1810	1810	1810	1810	

TEST NUMBER: P924750

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	1.6	19.7	53.5	50.2	51.8
92.5°	33.9	45.9	47.5	49.1	49.1
95°	79.7	94.9	97.7	97.7	94.9
97.5°	132.6	146.8	152.8	152.8	152.8
100°	193.8	206.3	210.6	210.6	209.0
102.5°	258.2	267.4	273.4	275.0	273.4
105°	328.6	332.9	336.2	339.0	339.0
107.5°	398.4	405.0	405.0	406.0	398.4
110°	466.1	474.8	474.8	474.8	470.4

TEST NUMBER: P924750

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	539.2	548.5	546.8	542.4	539.2
115°	611.2	620.0	617.2	615.6	611.2
117.5°	682.8	694.8	687.1	682.8	678.4
120°	754.8	766.8	754.8	754.8	749.8
122.5°	820.2	835.5	827.9	823.6	820.2
125°	889.0	902.7	898.3	893.4	891.8
127.5°	956.2	973.1	967.1	960.6	956.2
130°	1019.0	1038.6	1035.9	1032.6	1026.6
132.5°	1089.4	1104.6	1105.7	1098.1	1093.7
135°	1150.0	1166.8	1170.1	1168.5	1164.1
137.5°	1217.6	1231.2	1234.0	1232.9	1226.4
140°	1277.1	1290.8	1298.4	1298.4	1292.4
142.5°	1338.2	1351.8	1356.2	1357.8	1351.8
145°	1396.1	1407.0	1415.7	1417.4	1411.3
147.5°	1447.9	1461.5	1468.1	1470.8	1464.8
150°	1501.4	1510.7	1516.7	1521.5	1516.7
152.5°	1548.8	1558.2	1565.8	1571.8	1565.8
155°	1596.3	1600.7	1605.6	1613.3	1608.3
157.5°	1637.3	1640.6	1643.3	1654.2	1646.6
160°	1673.9	1677.1	1678.8	1688.0	1681.5
162.5°	1707.7	1707.7	1709.3	1719.7	1712.0
165°	1736.6	1734.9	1734.9	1745.9	1738.3
167.5°	1762.8	1757.9	1757.9	1768.8	1761.2
170°	1782.5	1778.1	1776.4	1787.3	1778.1
172.5°	1796.1	1791.7	1790.1	1801.0	1791.7
175°	1807.0	1802.7	1799.3	1810.3	1801.0
177.5°	1813.0	1808.7	1805.3	1814.6	1805.3
180°	1810.3	1810.3	1810.3	1810.3	1810.3

TEST NUMBER: P924750

CATALOG NUMBER: DFN2DIP-PN2F0-050D060US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.54	12.32	12.55	13.34	14.69	7.50	8.29	8.51	9.31	10.66
	3H	13.19	13.89	14.21	14.92	16.29	8.67	9.38	9.69	10.40	11.77
	4H	13.78	14.45	14.82	15.48	16.85	9.11	9.78	10.14	10.80	12.18
	6H	14.19	14.80	15.23	15.83	17.22	9.41	10.03	10.46	11.06	12.45
	8H	14.30	14.89	15.35	15.93	17.32	9.49	10.08	10.54	11.12	12.51
	12H	14.35	14.91	15.41	15.95	17.36	9.53	10.08	10.58	11.12	12.53
4H	2H	11.55	12.21	12.58	13.24	14.62	8.08	8.75	9.12	9.78	11.15
	3H	13.35	13.90	14.39	14.96	16.35	9.41	9.96	10.46	11.02	12.41
	4H	14.02	14.53	15.07	15.58	16.99	9.94	10.45	10.99	11.50	12.91
	6H	14.52	14.95	15.58	16.02	17.43	10.34	10.78	11.40	11.84	13.25
	8H	14.68	15.08	15.74	16.15	17.57	10.46	10.86	11.52	11.93	13.35
	12H	14.76	15.13	15.84	16.20	17.63	10.51	10.88	11.59	11.95	13.38
8H	4H	13.98	14.39	15.05	15.45	16.87	10.21	10.61	11.27	11.67	13.10
	6H	14.52	14.86	15.61	15.96	17.38	10.70	11.04	11.79	12.14	13.56
	8H	14.73	15.02	15.82	16.11	17.55	10.88	11.17	11.97	12.26	13.70
	12H	14.85	15.11	15.95	16.19	17.67	10.98	11.24	12.08	12.32	13.80
12H	4H	13.93	14.30	15.01	15.37	16.80	10.21	10.57	11.29	11.65	13.08
	6H	14.50	14.79	15.59	15.88	17.32	10.74	11.04	11.84	12.13	13.57
	8H	14.70	14.96	15.80	16.04	17.52	10.94	11.20	12.03	12.28	13.76

END OF REPORT