

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902989

Luminaire Tested: DFN2DIP-PN3F0-040D060US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902989
REPORT IS A COMBINATION OF REPORTS P901075 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D060US830-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9331.2 lumens
Efficiency: N/A
Efficacy: 115.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 80.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902989

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US830-FLLONL

Luminous Intensity Polar Plot

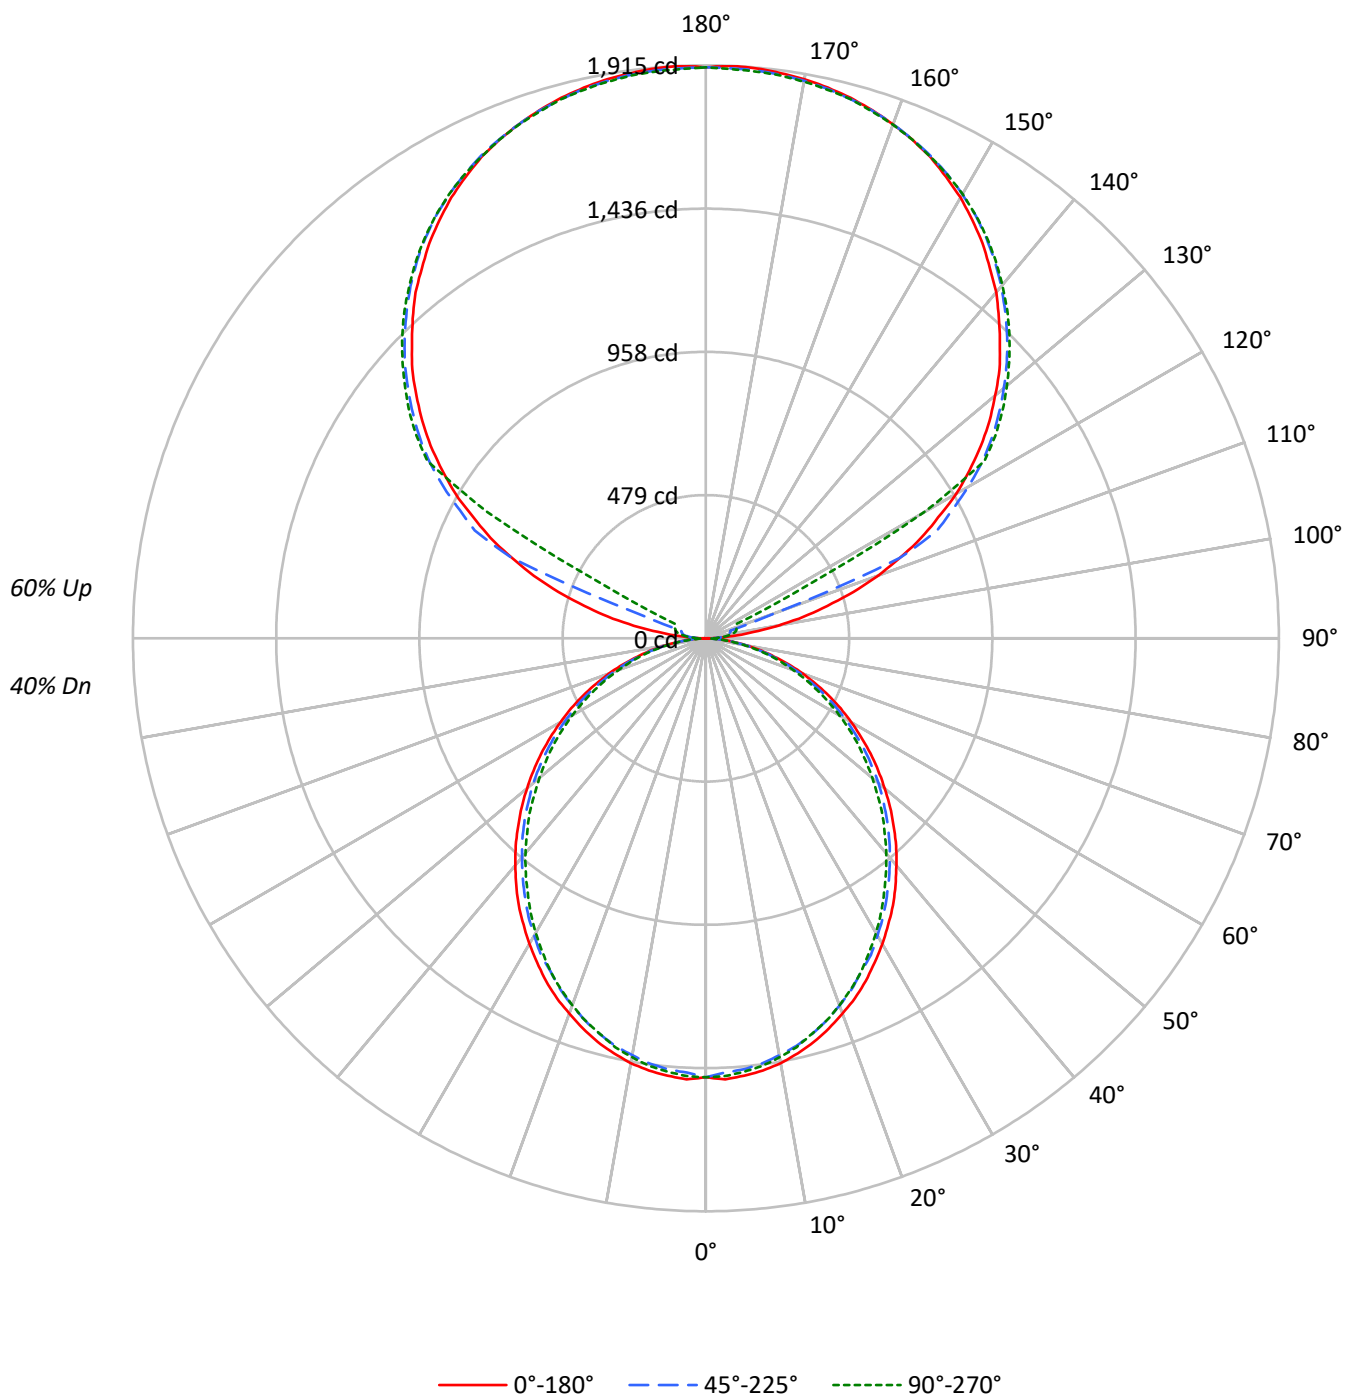

TEST NUMBER: P902989

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1715	1715	1715
5°	1717	1690	1702
10°	1702	1666	1678
15°	1676	1637	1641
20°	1641	1598	1604
25°	1606	1551	1560
30°	1563	1508	1505
35°	1522	1456	1447
40°	1472	1404	1392
45°	1421	1352	1335
50°	1366	1298	1270
55°	1309	1235	1210
60°	1243	1160	1140
65°	1172	1082	1059
70°	1081	987	971
75°	956	874	888
80°	803	728	733
85°	567	481	478

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1421 cd/sqm

TEST NUMBER: P902989

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.1	1.5
10°-20°	388.5	4.2
20°-30°	570.9	6.1
30°-40°	663.1	7.1
40°-50°	662.3	7.1
50°-60°	577.5	6.2
60°-70°	426.9	4.6
70°-80°	241.5	2.6
80°-90°	67.1	0.7
90°-100°	62.9	0.7
100°-110°	234.6	2.5
110°-120°	622.2	6.7
120°-130°	1032.0	11.1
130°-140°	1096.2	11.7
140°-150°	1018.8	10.9
150°-160°	819.1	8.8
160°-170°	527.8	5.7
170°-180°	181.7	1.9
0°-30°	1097.5	11.8
0°-40°	1760.6	18.9
0°-60°	3000.3	32.2
0°-90°	3735.8	40.0
90°-120°	919.8	9.9
90°-150°	4066.8	43.6
90°-180°	5595.0	60.0
0°-180°	9331.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1467	1467	1467	1467	1467	
5°	1467	1461	1446	1457	1454	139
15°	1396	1388	1370	1375	1368	393
25°	1264	1253	1229	1231	1229	582
35°	1090	1076	1054	1045	1038	681
45°	887	878	856	841	835	685
55°	672	663	646	629	622	600
65°	453	444	430	418	411	448
75°	237	234	227	219	222	253
85°	58	56	55	51	49	64
90°	1	17	28	35	37	9
95°	90	44	54	61	59	106
105°	420	461	84	99	105	449
115°	794	818	852	213	113	782
125°	1123	1141	1167	1177	1181	1001
135°	1389	1412	1424	1438	1435	1073
145°	1612	1610	1634	1643	1636	1008
155°	1775	1762	1779	1787	1776	818
165°	1870	1862	1866	1876	1866	528
175°	1913	1903	1906	1915	1902	182
180°	1909	1909	1909	1909	1909	

TEST NUMBER: P902989

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1467.0	1467.0	1467.0	1467.0	1467.0
2.5°	1475.5	1468.5	1452.9	1467.0	1464.3
5°	1467.0	1461.4	1445.9	1457.1	1454.4
7.5°	1457.1	1448.7	1433.1	1444.5	1441.7
10°	1441.7	1431.8	1414.9	1426.2	1421.9
12.5°	1420.4	1412.0	1395.2	1402.2	1399.3
15°	1396.5	1388.1	1369.7	1375.4	1368.4
17.5°	1366.9	1358.5	1340.1	1347.1	1340.1
20°	1334.4	1326.0	1306.3	1310.4	1304.9
22.5°	1302.0	1289.3	1270.9	1270.9	1268.1
25°	1263.9	1252.6	1228.7	1231.4	1228.7
27.5°	1221.5	1211.6	1193.4	1189.2	1182.2
30°	1179.3	1168.0	1146.9	1142.6	1137.0
32.5°	1134.2	1125.8	1103.2	1094.7	1088.9
35°	1090.4	1076.4	1053.8	1045.3	1038.2
37.5°	1041.0	1028.3	1005.7	995.9	988.8
40°	990.3	978.9	956.3	943.8	938.1
42.5°	940.9	929.5	907.1	892.9	884.5
45°	887.3	877.5	856.2	840.8	835.1
47.5°	835.1	825.2	802.7	787.1	778.7
50°	780.0	773.0	753.3	733.5	726.4
52.5°	726.4	716.6	698.3	682.8	672.9
55°	671.6	663.0	646.1	629.1	622.2
57.5°	616.4	609.4	591.0	574.1	568.4
60°	561.4	555.8	536.1	520.6	516.3
62.5°	507.8	497.9	483.9	469.8	464.1
65°	452.9	444.3	430.3	417.5	410.6
67.5°	396.4	389.3	376.7	366.8	361.2
70°	344.2	338.6	325.8	315.9	310.4
72.5°	290.7	284.9	278.0	268.1	263.8
75°	237.0	234.2	227.1	218.7	221.5
77.5°	189.0	183.3	180.5	176.3	172.1
80°	141.1	139.6	136.8	132.6	129.8
82.5°	96.0	96.0	94.6	88.9	88.9
85°	57.8	56.5	55.0	50.7	49.4
87.5°	25.4	22.6	19.8	15.6	14.0
90°	1.3	16.6	27.5	34.6	37.2
92.5°	34.6	29.0	33.1	35.9	37.2
95°	89.7	44.1	53.8	60.9	59.4
97.5°	161.6	48.4	70.3	74.6	76.0
100°	244.5	55.2	78.7	89.7	92.5
102.5°	335.5	332.9	81.5	96.6	100.9
105°	419.8	461.3	84.3	99.3	105.0
107.5°	517.9	552.3	87.1	102.2	107.7
110°	611.9	640.7	241.8	103.7	109.1

TEST NUMBER: P902989

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	700.2	725.0	701.5	106.2	110.6
115°	794.1	817.6	852.2	212.7	113.3
117.5°	875.5	903.1	926.7	729.2	367.3
120°	966.8	987.4	1012.4	1028.9	842.4
122.5°	1044.0	1066.1	1093.8	1102.0	1103.5
125°	1122.8	1140.8	1167.0	1176.7	1180.7
127.5°	1194.6	1213.9	1234.7	1248.5	1249.8
130°	1262.3	1284.4	1299.5	1314.8	1313.4
132.5°	1331.3	1349.3	1364.4	1376.9	1375.5
135°	1389.4	1411.6	1423.8	1437.8	1434.9
137.5°	1450.0	1466.6	1480.5	1494.3	1490.3
140°	1509.4	1520.6	1535.7	1548.1	1541.2
142.5°	1559.2	1569.0	1586.9	1597.8	1590.9
145°	1611.7	1610.2	1633.7	1643.4	1636.5
147.5°	1657.2	1653.0	1676.5	1683.4	1678.0
150°	1701.5	1691.8	1713.9	1722.1	1715.2
152.5°	1738.7	1727.7	1748.3	1756.7	1747.0
155°	1774.6	1762.3	1778.9	1787.1	1776.0
157.5°	1803.6	1792.6	1805.1	1814.8	1803.6
160°	1828.5	1820.1	1828.5	1836.7	1827.1
162.5°	1850.5	1842.3	1849.2	1858.9	1846.4
165°	1869.9	1861.7	1865.8	1875.5	1865.8
167.5°	1885.1	1876.8	1881.0	1890.7	1878.2
170°	1897.6	1889.2	1892.1	1901.7	1889.2
172.5°	1905.8	1897.6	1900.4	1910.1	1897.6
175°	1912.7	1903.0	1905.8	1915.4	1901.7
177.5°	1915.4	1905.8	1907.2	1916.9	1904.5
180°	1908.6	1908.6	1908.6	1908.6	1908.6

TEST NUMBER: P902989

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.11	8.89	9.15	9.93	11.34	7.67	8.45	8.71	9.49	10.90
	3H	9.76	10.46	10.81	11.51	12.93	9.28	9.97	10.32	11.03	12.45
	4H	10.34	11.00	11.40	12.05	13.49	9.85	10.51	10.91	11.57	13.00
	6H	10.73	11.34	11.80	12.40	13.84	10.24	10.85	11.31	11.91	13.35
	8H	10.83	11.41	11.90	12.48	13.92	10.34	10.92	11.41	11.99	13.43
	12H	10.87	11.42	11.95	12.49	13.96	10.37	10.93	11.45	11.99	13.46
4H	2H	8.56	9.22	9.62	10.27	11.71	8.21	8.87	9.27	9.92	11.36
	3H	10.41	10.96	11.48	12.04	13.49	10.01	10.56	11.08	11.64	13.09
	4H	11.11	11.62	12.19	12.69	14.16	10.70	11.20	11.78	12.28	13.75
	6H	11.62	12.05	12.71	13.15	14.61	11.20	11.63	12.29	12.73	14.19
	8H	11.76	12.17	12.85	13.26	14.74	11.34	11.74	12.43	12.83	14.31
	12H	11.83	12.20	12.94	13.30	14.78	11.39	11.76	12.50	12.86	14.34
8H	4H	11.30	11.71	12.39	12.80	14.27	10.93	11.34	12.02	12.43	13.90
	6H	11.92	12.26	13.03	13.39	14.86	11.55	11.88	12.66	13.01	14.49
	8H	12.14	12.43	13.25	13.54	15.04	11.75	12.05	12.87	13.16	14.65
	12H	12.26	12.52	13.38	13.63	15.16	11.86	12.12	12.98	13.23	14.76
12H	4H	11.28	11.65	12.39	12.75	14.23	10.92	11.29	12.03	12.39	13.87
	6H	11.95	12.24	13.07	13.35	14.85	11.58	11.88	12.70	12.99	14.49
	8H	12.18	12.44	13.30	13.55	15.08	11.81	12.07	12.93	13.18	14.71

END OF REPORT