

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922089

Luminaire Tested: DFN2DIP-PN3F0-040D070US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922089
REPORT IS A COMBINATION OF REPORTS P901089 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D070US940-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9710.8 lumens
Efficiency: N/A
Efficacy: 109.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 89
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922089

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US940-FLLONL

Luminous Intensity Polar Plot

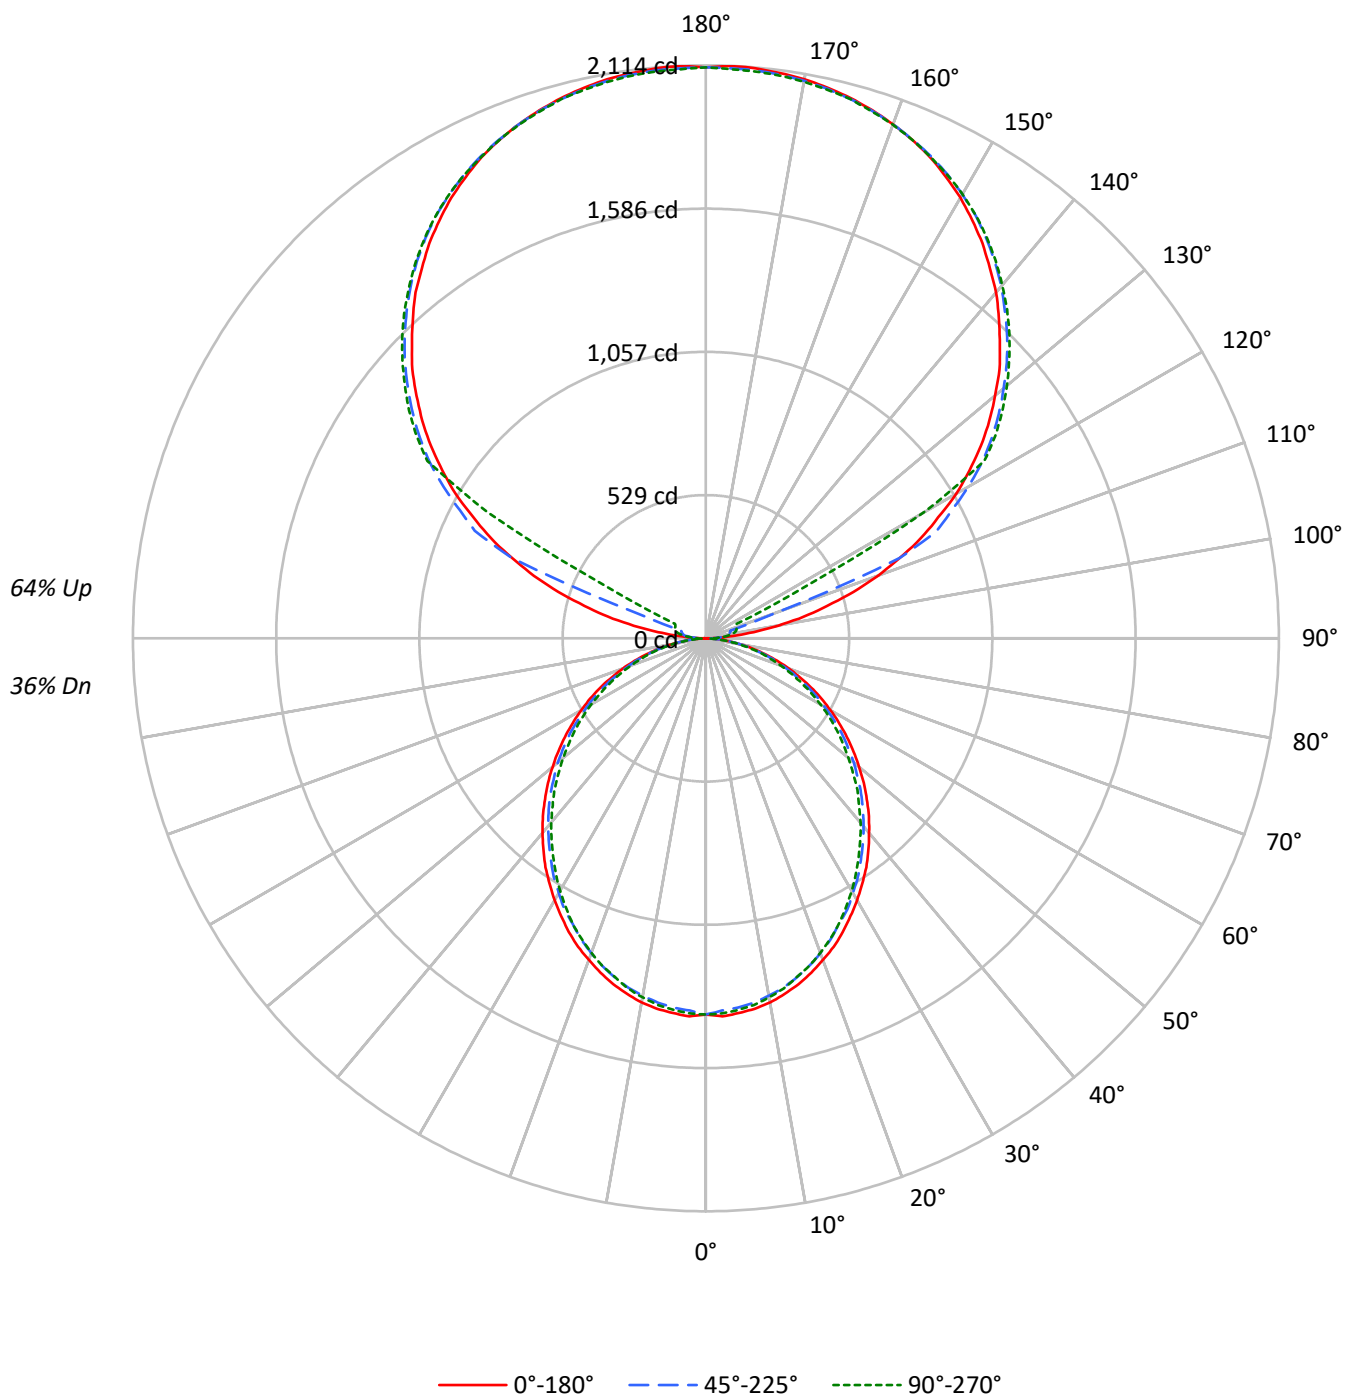

TEST NUMBER: P922089

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	90	87	83	86	82	79	76	66	64	62	52	50	49	39	38	37
2	86	79	73	68	78	72	67	62	58	54	51	46	43	41	34	32	31
3	79	69	62	57	71	63	57	52	51	47	43	40	37	35	30	28	26
4	72	61	54	48	65	56	49	44	45	41	37	36	32	30	27	25	23
5	66	55	47	41	59	50	43	38	41	35	32	32	28	26	24	22	20
6	61	49	41	35	55	45	38	33	37	31	27	29	25	22	22	19	17
7	56	44	36	31	51	40	33	29	33	28	24	26	23	20	20	17	15
8	52	40	32	27	47	37	30	25	30	25	21	24	20	18	18	16	14
9	48	36	29	24	44	33	27	22	28	23	19	22	18	16	17	14	12
10	45	33	26	21	41	31	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1622	1622	1622
5°	1624	1599	1610
10°	1610	1576	1587
15°	1585	1549	1553
20°	1552	1512	1517
25°	1519	1467	1476
30°	1479	1426	1424
35°	1440	1378	1369
40°	1392	1329	1317
45°	1345	1279	1263
50°	1293	1228	1201
55°	1238	1168	1144
60°	1176	1097	1079
65°	1109	1024	1002
70°	1023	934	918
75°	904	826	841
80°	760	689	694
85°	537	456	452

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1422 cd/sqm

TEST NUMBER: P922089

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	130.6	1.3
10°-20°	367.5	3.8
20°-30°	540.1	5.6
30°-40°	627.3	6.5
40°-50°	626.6	6.5
50°-60°	546.3	5.6
60°-70°	403.9	4.2
70°-80°	228.5	2.4
80°-90°	64.0	0.7
90°-100°	69.5	0.7
100°-110°	259.0	2.7
110°-120°	686.8	7.1
120°-130°	1139.1	11.7
130°-140°	1209.9	12.5
140°-150°	1124.5	11.6
150°-160°	904.1	9.3
160°-170°	582.6	6.0
170°-180°	200.5	2.1
0°-30°	1038.3	10.7
0°-40°	1665.6	17.2
0°-60°	2838.5	29.2
0°-90°	3534.9	36.4
90°-120°	1015.2	10.5
90°-150°	4488.7	46.2
90°-180°	6176.0	63.6
0°-180°	9710.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1388	1388	1388	1388	1388	
5°	1388	1383	1368	1378	1376	132
15°	1321	1313	1296	1301	1295	372
25°	1196	1185	1162	1165	1162	550
35°	1032	1018	997	989	982	644
45°	840	830	810	796	790	648
55°	635	627	611	595	589	568
65°	428	420	407	395	388	424
75°	224	222	215	207	210	239
85°	55	53	52	48	47	61
90°	1	18	30	38	41	9
95°	99	49	59	67	66	117
105°	463	509	93	110	116	495
115°	876	902	940	235	125	863
125°	1239	1259	1288	1299	1303	1105
135°	1534	1558	1572	1587	1584	1185
145°	1779	1777	1803	1814	1806	1113
155°	1959	1945	1963	1972	1960	903
165°	2064	2055	2059	2070	2059	583
175°	2111	2100	2104	2114	2099	201
180°	2107	2107	2107	2107	2107	

TEST NUMBER: P922089

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1387.9	1387.9	1387.9	1387.9	1387.9
2.5°	1396.0	1389.3	1374.6	1387.9	1385.4
5°	1387.9	1382.6	1367.9	1378.5	1376.0
7.5°	1378.5	1370.6	1355.8	1366.6	1364.0
10°	1364.0	1354.6	1338.6	1349.2	1345.2
12.5°	1343.8	1335.9	1319.9	1326.6	1323.8
15°	1321.2	1313.2	1295.8	1301.2	1294.6
17.5°	1293.2	1285.2	1267.8	1274.4	1267.8
20°	1262.4	1254.5	1235.8	1239.7	1234.6
22.5°	1231.8	1219.8	1202.4	1202.4	1199.7
25°	1195.7	1185.1	1162.4	1165.0	1162.4
27.5°	1155.7	1146.3	1129.1	1125.1	1118.5
30°	1115.7	1105.0	1085.0	1081.0	1075.7
32.5°	1073.0	1065.1	1043.7	1035.6	1030.2
35°	1031.6	1018.3	996.9	988.9	982.2
37.5°	984.9	972.9	951.5	942.2	935.5
40°	936.9	926.1	904.7	892.9	887.5
42.5°	890.2	879.4	858.2	844.7	836.8
45°	839.5	830.2	810.0	795.5	790.1
47.5°	790.1	780.7	759.4	744.7	736.7
50°	738.0	731.3	712.7	693.9	687.2
52.5°	687.2	678.0	660.7	646.0	636.6
55°	635.3	627.2	611.3	595.2	588.6
57.5°	583.2	576.6	559.1	543.1	537.8
60°	531.1	525.8	507.2	492.5	488.5
62.5°	480.5	471.1	457.8	444.4	439.1
65°	428.5	420.4	407.1	395.0	388.4
67.5°	375.1	368.3	356.4	347.1	341.7
70°	325.7	320.3	308.3	298.9	293.6
72.5°	275.0	269.6	263.0	253.6	249.6
75°	224.2	221.6	214.8	206.9	209.6
77.5°	178.8	173.4	170.8	166.7	162.8
80°	133.5	132.1	129.4	125.5	122.8
82.5°	90.8	90.8	89.5	84.1	84.1
85°	54.7	53.4	52.1	48.0	46.7
87.5°	24.1	21.4	18.7	14.7	13.3
90°	1.4	18.3	30.4	38.2	41.1
92.5°	38.2	32.0	36.6	39.7	41.1
95°	99.0	48.7	59.4	67.1	65.5
97.5°	178.3	53.4	77.7	82.4	83.8
100°	269.9	61.0	86.9	99.0	102.1
102.5°	370.3	367.5	90.0	106.6	111.3
105°	463.4	509.2	93.0	109.7	115.8
107.5°	571.6	609.7	96.1	112.8	119.0
110°	675.4	707.2	266.8	114.4	120.4

TEST NUMBER: P922089

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	772.9	800.2	774.4	117.3	122.0
115°	876.5	902.3	940.5	234.8	125.1
117.5°	966.4	996.8	1022.9	804.8	405.5
120°	1067.0	1089.8	1117.4	1135.7	929.9
122.5°	1152.3	1176.7	1207.4	1216.4	1218.0
125°	1239.2	1259.1	1288.1	1298.8	1303.2
127.5°	1318.5	1339.8	1362.8	1378.0	1379.5
130°	1393.2	1417.6	1434.3	1451.2	1449.7
132.5°	1469.4	1489.3	1506.0	1519.7	1518.3
135°	1533.5	1557.9	1571.6	1586.9	1583.9
137.5°	1600.4	1618.8	1634.1	1649.4	1644.8
140°	1666.0	1678.3	1695.0	1708.7	1701.1
142.5°	1721.0	1731.7	1751.4	1763.5	1756.0
145°	1779.0	1777.4	1803.2	1813.9	1806.3
147.5°	1829.1	1824.6	1850.5	1858.1	1852.1
150°	1877.9	1867.3	1891.8	1900.8	1893.2
152.5°	1919.0	1906.9	1929.8	1938.9	1928.3
155°	1958.7	1945.1	1963.4	1972.5	1960.3
157.5°	1990.7	1978.6	1992.3	2003.0	1990.7
160°	2018.3	2009.0	2018.3	2027.3	2016.6
162.5°	2042.6	2033.5	2041.0	2051.7	2038.0
165°	2063.9	2054.9	2059.3	2070.0	2059.3
167.5°	2080.7	2071.4	2076.2	2086.9	2073.1
170°	2094.4	2085.3	2088.3	2099.0	2085.3
172.5°	2103.5	2094.4	2097.6	2108.2	2094.4
175°	2111.1	2100.4	2103.5	2114.2	2099.0
177.5°	2114.2	2103.5	2105.1	2115.9	2102.0
180°	2106.6	2106.6	2106.6	2106.6	2106.6

TEST NUMBER: P922089

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.51	8.26	8.57	9.33	10.78	7.07	7.82	8.13	8.89	10.34
	3H	9.15	9.83	10.23	10.90	12.37	8.67	9.34	9.75	10.42	11.89
	4H	9.73	10.37	10.82	11.45	12.93	9.25	9.89	10.33	10.96	12.44
	6H	10.12	10.71	11.22	11.79	13.28	9.63	10.22	10.73	11.30	12.79
	8H	10.22	10.78	11.32	11.88	13.36	9.73	10.29	10.83	11.39	12.87
	12H	10.26	10.79	11.37	11.89	13.39	9.77	10.30	10.87	11.39	12.90
4H	2H	7.95	8.59	9.05	9.67	11.15	7.60	8.24	8.69	9.32	10.80
	3H	9.80	10.33	10.90	11.44	12.93	9.40	9.93	10.50	11.04	12.53
	4H	10.51	10.99	11.61	12.09	13.60	10.09	10.58	11.19	11.67	13.18
	6H	11.01	11.43	12.12	12.55	14.05	10.59	11.01	11.70	12.12	13.63
	8H	11.15	11.54	12.27	12.66	14.18	10.73	11.12	11.84	12.23	13.75
	12H	11.22	11.57	12.35	12.70	14.22	10.78	11.13	11.91	12.26	13.78
8H	4H	10.69	11.08	11.80	12.19	13.71	10.32	10.71	11.43	11.82	13.34
	6H	11.31	11.63	12.44	12.78	14.30	10.93	11.26	12.07	12.41	13.93
	8H	11.52	11.81	12.66	12.94	14.48	11.14	11.42	12.28	12.56	14.09
	12H	11.65	11.90	12.79	13.02	14.60	11.25	11.50	12.39	12.62	14.20
12H	4H	10.67	11.02	11.80	12.15	13.67	10.31	10.66	11.44	11.78	13.31
	6H	11.34	11.62	12.48	12.75	14.29	10.97	11.25	12.11	12.39	13.92
	8H	11.57	11.82	12.71	12.95	14.52	11.20	11.45	12.34	12.57	14.15