

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922107

Luminaire Tested: DFN2DIP-PN3F0-050D040US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922107
REPORT IS A COMBINATION OF REPORTS P901050 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D040US940-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7321.0 lumens
Efficiency: N/A
Efficacy: 97.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 75
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922107

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US940-RLLONL

Luminous Intensity Polar Plot

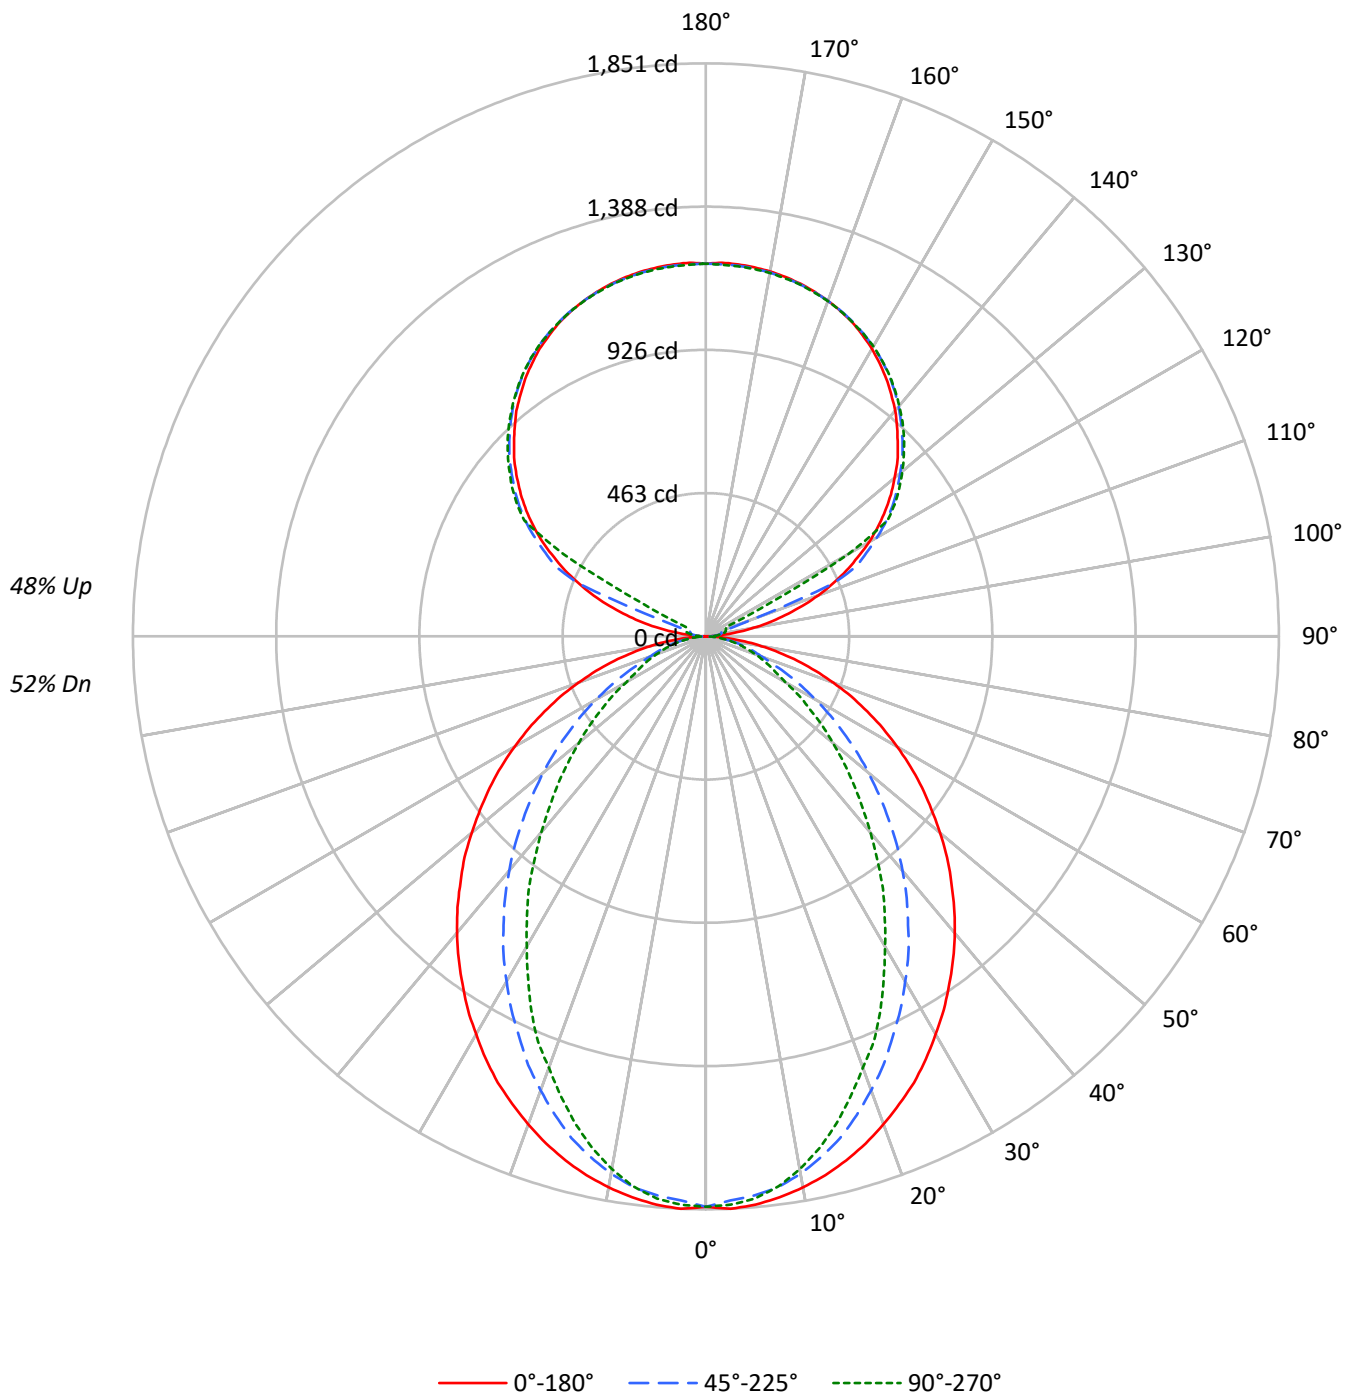

TEST NUMBER: P922107

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	108	108	108	108	99	99	99	99	84	84	84	70	70	70	58	58	58	58	58	58
1	99	95	91	87	91	88	84	82	75	72	70	63	61	60	52	51	50	50	50	45
2	90	83	77	72	83	77	72	68	66	62	59	56	53	51	46	44	43	43	43	38
3	83	74	66	61	76	68	62	57	59	54	50	50	46	43	41	39	37	37	37	33
4	76	65	58	52	70	61	54	49	52	47	43	45	41	38	37	35	32	32	32	29
5	70	59	51	45	64	55	48	42	47	42	38	40	36	33	34	31	28	28	28	25
6	65	53	45	39	60	49	42	37	43	37	33	37	32	29	31	28	25	25	25	22
7	60	48	40	35	55	45	38	33	39	33	29	33	29	26	28	25	23	23	23	20
8	56	44	36	31	51	41	34	29	36	30	26	31	26	23	26	23	20	20	20	18
9	52	40	32	28	48	37	31	26	33	27	24	28	24	21	24	21	19	19	19	16
10	48	37	30	25	45	34	28	24	30	25	21	26	22	19	23	19	17	17	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2154	2154	2154
5°	2156	2118	2133
10°	2134	2075	2062
15°	2103	2005	1954
20°	2063	1909	1822
25°	2022	1802	1694
30°	1967	1692	1532
35°	1913	1574	1390
40°	1858	1452	1227
45°	1795	1317	1080
50°	1729	1181	936
55°	1660	1035	798
60°	1581	884	656
65°	1489	730	589
70°	1377	586	532
75°	1237	513	482
80°	1035	426	415
85°	703	277	307

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1795 cd/sqm

TEST NUMBER: P922107

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.7	2.4
10°-20°	474.1	6.5
20°-30°	665.6	9.1
30°-40°	725.6	9.9
40°-50°	666.9	9.1
50°-60°	523.7	7.2
60°-70°	340.9	4.7
70°-80°	175.5	2.4
80°-90°	46.9	0.6
90°-100°	39.7	0.5
100°-110°	148.0	2.0
110°-120°	392.4	5.4
120°-130°	650.9	8.9
130°-140°	691.4	9.4
140°-150°	642.6	8.8
150°-160°	516.6	7.1
160°-170°	332.9	4.5
170°-180°	114.6	1.6
0°-30°	1312.4	17.9
0°-40°	2038.0	27.8
0°-60°	3228.6	44.1
0°-90°	3791.9	51.8
90°-120°	580.1	7.9
90°-150°	2565.0	35.0
90°-180°	3529.0	48.2
0°-180°	7321.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1843	1843	1843	1843	1843	
5°	1843	1834	1813	1828	1823	175
15°	1753	1734	1678	1646	1629	494
25°	1591	1538	1427	1359	1334	732
35°	1371	1286	1139	1034	997	858
45°	1121	1009	834	715	675	865
55°	852	722	542	442	410	761
65°	575	440	290	234	228	570
75°	307	190	133	122	120	324
85°	72	37	32	32	32	82
90°	1	10	17	22	24	7
95°	56	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	537	134	72	493
125°	708	720	736	742	745	632
135°	876	890	898	907	905	677
145°	1016	1016	1030	1036	1032	636
155°	1119	1112	1122	1127	1120	516
165°	1179	1174	1177	1183	1177	333
175°	1206	1200	1202	1208	1199	115
180°	1204	1204	1204	1204	1204	

TEST NUMBER: P922107

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1842.7	1842.7	1842.7	1842.7	1842.7
2.5°	1851.0	1842.7	1824.4	1841.1	1837.7
5°	1842.7	1834.4	1812.7	1827.6	1822.7
7.5°	1827.6	1817.8	1794.4	1801.0	1792.6
10°	1807.7	1796.0	1762.7	1757.7	1747.7
12.5°	1782.7	1767.7	1722.6	1712.7	1694.2
15°	1752.7	1734.3	1677.7	1646.0	1629.3
17.5°	1717.6	1691.0	1620.9	1584.2	1557.5
20°	1677.7	1644.2	1560.8	1519.3	1482.5
22.5°	1634.3	1595.9	1499.1	1442.5	1417.6
25°	1590.9	1537.5	1427.4	1359.1	1334.0
27.5°	1539.3	1482.5	1360.8	1282.4	1244.0
30°	1484.3	1420.8	1287.4	1202.4	1157.3
32.5°	1430.8	1354.1	1217.5	1117.3	1075.6
35°	1370.8	1285.8	1139.1	1033.9	997.2
37.5°	1312.4	1220.7	1065.7	950.5	908.9
40°	1250.7	1150.8	988.8	870.5	827.2
42.5°	1187.4	1080.7	912.2	788.7	747.2
45°	1120.7	1008.9	833.8	715.3	675.3
47.5°	1057.3	939.0	758.8	640.3	603.7
50°	987.3	868.9	685.5	570.2	535.4
52.5°	918.8	793.7	615.4	505.3	473.7
55°	852.1	722.0	541.9	441.9	410.3
57.5°	783.8	650.4	477.0	383.6	356.9
60°	713.7	580.3	408.5	323.6	296.9
62.5°	645.4	512.0	350.2	270.2	256.9
65°	575.3	440.2	290.2	233.5	228.5
67.5°	508.6	373.5	233.5	205.1	200.1
70°	438.6	308.5	193.4	176.7	170.0
72.5°	371.9	248.4	161.8	148.5	145.1
75°	306.8	190.0	133.4	121.7	120.1
77.5°	241.8	135.0	105.1	98.4	95.0
80°	181.7	96.8	80.0	73.4	73.4
82.5°	126.7	65.1	55.0	51.6	51.6
85°	71.7	36.6	31.7	31.7	31.7
87.5°	26.8	13.3	13.3	11.7	11.7
90°	0.8	10.4	17.4	21.8	23.5
92.5°	21.8	18.3	20.9	22.6	23.5
95°	56.5	27.8	33.9	38.3	37.5
97.5°	101.9	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.5	58.3
102.5°	211.6	210.0	51.4	60.9	63.6
105°	264.7	291.0	53.1	62.7	66.2
107.5°	326.6	348.4	54.9	64.5	67.9
110°	385.9	404.1	152.5	65.4	68.8

TEST NUMBER: P922107

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.7	457.3	442.5	67.1	69.7
115°	500.8	515.6	537.4	134.1	71.5
117.5°	552.2	569.6	584.5	459.9	231.7
120°	609.8	622.8	638.5	649.0	531.4
122.5°	658.4	672.4	689.9	695.1	696.0
125°	708.1	719.5	736.0	742.2	744.8
127.5°	753.4	765.6	778.7	787.5	788.3
130°	796.1	810.1	819.6	829.2	828.4
132.5°	839.6	851.0	860.6	868.4	867.6
135°	876.3	890.3	898.0	906.8	905.1
137.5°	914.5	925.0	933.8	942.4	939.9
140°	952.0	959.0	968.6	976.4	972.1
142.5°	983.5	989.5	1000.9	1007.7	1003.4
145°	1016.5	1015.7	1030.4	1036.5	1032.2
147.5°	1045.2	1042.6	1057.4	1061.8	1058.4
150°	1073.1	1067.0	1081.0	1086.2	1081.8
152.5°	1096.6	1089.7	1102.7	1108.0	1101.9
155°	1119.3	1111.5	1121.9	1127.1	1120.2
157.5°	1137.6	1130.6	1138.5	1144.6	1137.6
160°	1153.2	1148.0	1153.2	1158.4	1152.4
162.5°	1167.2	1162.0	1166.4	1172.4	1164.6
165°	1179.4	1174.2	1176.8	1182.9	1176.8
167.5°	1189.0	1183.7	1186.4	1192.5	1184.6
170°	1196.9	1191.6	1193.3	1199.4	1191.6
172.5°	1202.0	1196.9	1198.6	1204.7	1196.9
175°	1206.3	1200.2	1202.0	1208.1	1199.4
177.5°	1208.1	1202.0	1202.9	1209.1	1201.2
180°	1203.8	1203.8	1203.8	1203.8	1203.8

TEST NUMBER: P922107

CATALOG NUMBER: DFN2DIP-PN3F0-050D040US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.94	10.79	10.89	11.75	12.99	5.91	6.75	6.86	7.71	8.96
	3H	11.61	12.37	12.57	13.34	14.61	7.09	7.85	8.05	8.82	10.09
	4H	12.22	12.93	13.19	13.91	15.19	7.54	8.25	8.51	9.22	10.50
	6H	12.64	13.29	13.62	14.27	15.56	7.85	8.51	8.84	9.49	10.78
	8H	12.76	13.39	13.75	14.38	15.67	7.94	8.57	8.93	9.56	10.85
	12H	12.82	13.41	13.82	14.40	15.72	7.98	8.58	8.98	9.57	10.88
4H	2H	9.96	10.67	10.94	11.65	12.93	6.50	7.22	7.48	8.19	9.47
	3H	11.78	12.38	12.77	13.38	14.67	7.85	8.44	8.83	9.44	10.74
	4H	12.47	13.01	13.47	14.01	15.33	8.39	8.93	9.39	9.93	11.24
	6H	12.98	13.45	13.99	14.47	15.78	8.80	9.27	9.81	10.29	11.60
	8H	13.15	13.59	14.16	14.60	15.93	8.93	9.36	9.94	10.38	11.70
	12H	13.25	13.64	14.27	14.67	16.00	8.99	9.38	10.02	10.41	11.74
8H	4H	12.44	12.87	13.45	13.89	15.21	8.67	9.10	9.68	10.11	11.44
	6H	13.00	13.36	14.03	14.41	15.74	9.18	9.54	10.21	10.59	11.92
	8H	13.21	13.53	14.25	14.57	15.91	9.36	9.68	10.41	10.72	12.07
	12H	13.35	13.62	14.39	14.66	16.05	9.48	9.76	10.52	10.79	12.18
12H	4H	12.39	12.78	13.42	13.81	15.15	8.67	9.06	9.70	10.09	11.43
	6H	12.97	13.29	14.02	14.33	15.68	9.23	9.54	10.27	10.58	11.93
	8H	13.19	13.47	14.23	14.50	15.89	9.43	9.71	10.48	10.74	12.13

END OF REPORT