

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903216

Luminaire Tested: DFN2DIP-PN4F0-060D040US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903216
REPORT IS A COMBINATION OF REPORTS P899613 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D040US830-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8935.3 lumens
Efficiency: N/A
Efficacy: 105.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 84.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903216

CATALOG NUMBER: DFN2DIP-PN4F0-060D040US830-FLLFLL

Luminous Intensity Polar Plot

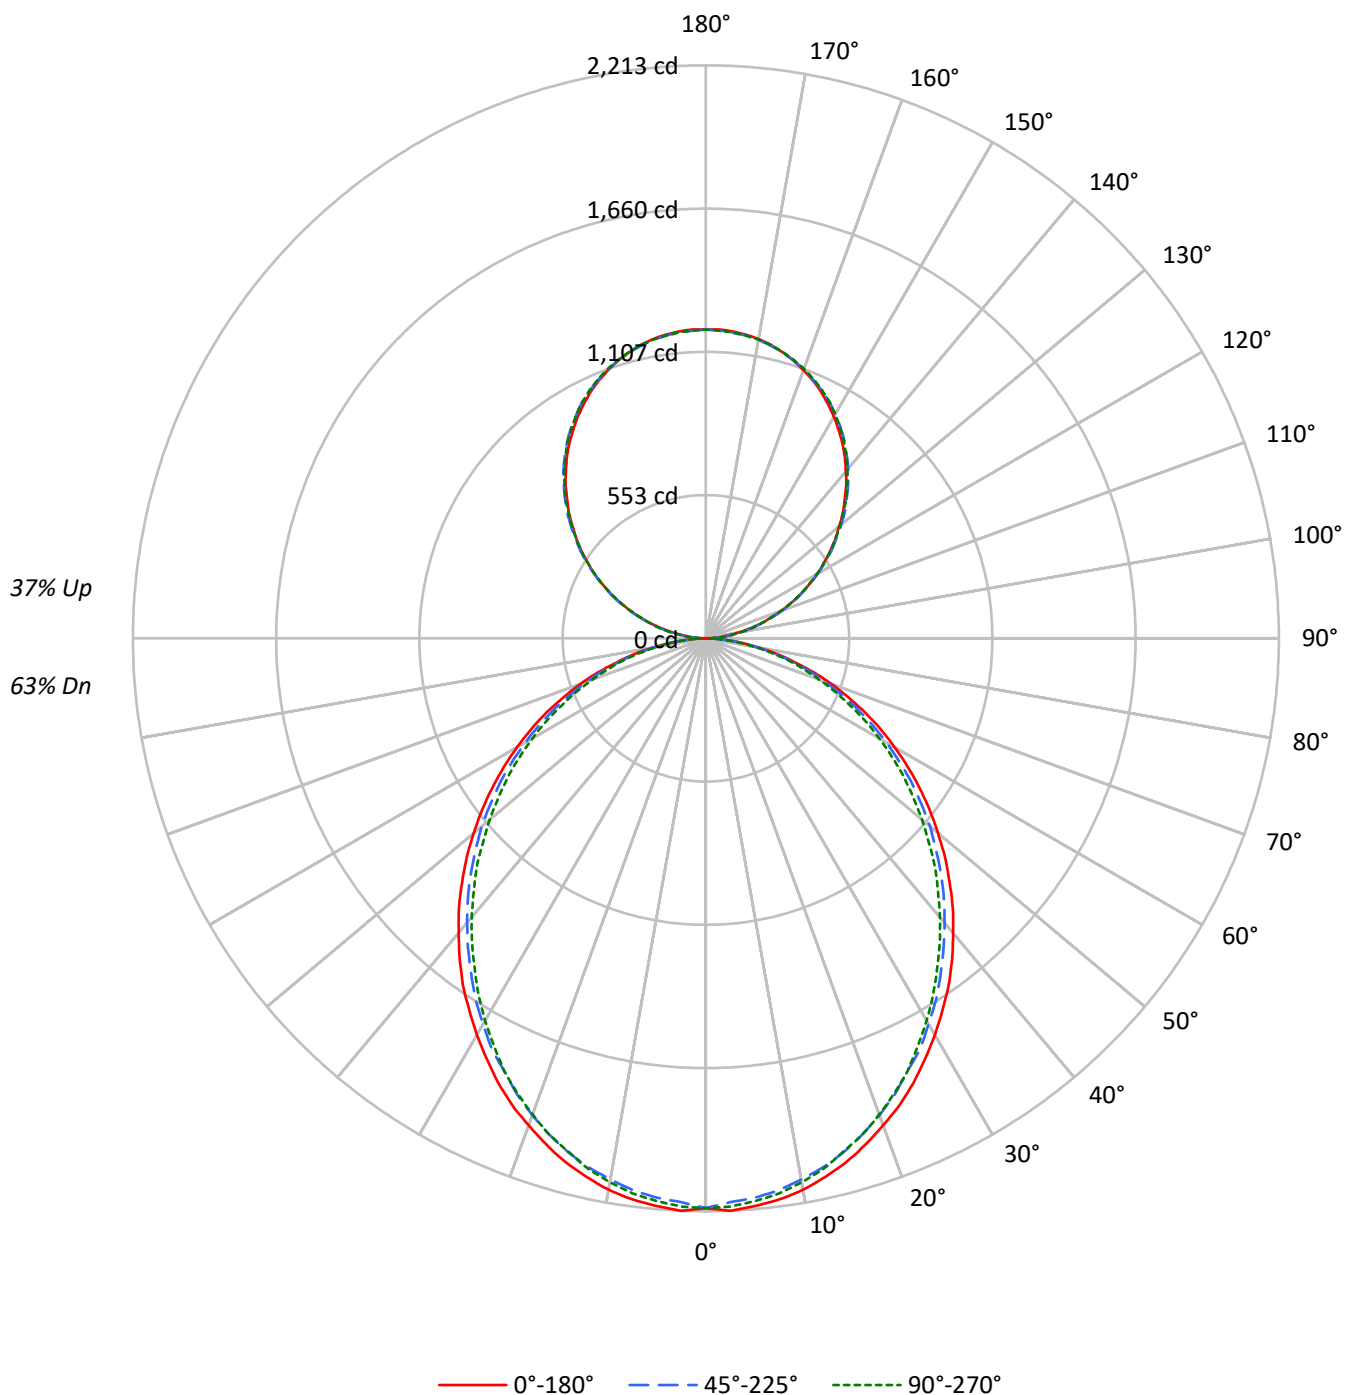

TEST NUMBER: P903216

CATALOG NUMBER: DFN2DIP-PN4F0-060D040US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1606	1606	1606
5°	1609	1584	1595
10°	1596	1563	1574
15°	1572	1538	1540
20°	1541	1502	1506
25°	1509	1459	1466
30°	1470	1420	1416
35°	1432	1373	1362
40°	1386	1326	1311
45°	1340	1279	1259
50°	1290	1229	1199
55°	1237	1172	1144
60°	1178	1104	1081
65°	1113	1033	1006
70°	1030	947	926
75°	915	844	852
80°	778	714	710
85°	562	487	475

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1340 cd/sqm

TEST NUMBER: P903216

CATALOG NUMBER: DFN2DIP-PN4F0-060D040US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	2.3
10°-20°	582.7	6.5
20°-30°	856.4	9.6
30°-40°	994.6	11.1
40°-50°	993.4	11.1
50°-60°	866.2	9.7
60°-70°	640.3	7.2
70°-80°	362.3	4.1
80°-90°	99.0	1.1
90°-100°	73.8	0.8
100°-110°	234.4	2.6
110°-120°	401.2	4.5
120°-130°	527.6	5.9
130°-140°	592.2	6.6
140°-150°	580.8	6.5
150°-160°	487.2	5.5
160°-170°	323.1	3.6
170°-180°	112.9	1.3
0°-30°	1646.2	18.4
0°-40°	2640.9	29.6
0°-60°	4500.5	50.4
0°-90°	5602.1	62.7
90°-120°	709.4	7.9
90°-150°	2410.0	27.0
90°-180°	3333.0	37.3
0°-180°	8935.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	1	13	35	33	34	9
95°	52	63	64	64	63	58
105°	216	219	221	223	223	228
115°	403	408	406	406	403	398
125°	586	595	592	588	587	523
135°	757	768	771	770	767	585
145°	920	927	932	934	930	575
155°	1051	1054	1058	1063	1059	484
165°	1144	1143	1143	1150	1145	323
175°	1190	1187	1185	1192	1186	113
180°	1192	1192	1192	1192	1192	

TEST NUMBER: P903216

CATALOG NUMBER: DFN2DIP-PN4F0-060D040US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	1.0	12.9	35.3	33.1	34.1
92.5°	22.2	30.2	31.3	32.3	32.3
95°	52.5	62.6	64.4	64.4	62.6
97.5°	87.4	96.7	100.7	100.7	100.7
100°	127.6	135.9	138.7	138.7	137.7
102.5°	170.0	176.2	180.1	181.2	180.1
105°	216.4	219.2	221.4	223.2	223.2
107.5°	262.4	266.7	266.7	267.4	262.4
110°	307.0	312.7	312.7	312.7	309.9



TEST NUMBER: P903216

CATALOG NUMBER: DFN2DIP-PN4F0-060D040US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	355.1	361.3	360.1	357.3	355.1
115°	402.6	408.4	406.5	405.5	402.6
117.5°	449.7	457.6	452.6	449.7	446.9
120°	497.2	505.0	497.2	497.2	493.9
122.5°	540.3	550.4	545.4	542.4	540.3
125°	585.6	594.6	591.7	588.4	587.4
127.5°	629.8	640.9	637.0	632.6	629.8
130°	671.1	684.1	682.3	680.1	676.2
132.5°	717.5	727.5	728.3	723.2	720.4
135°	757.4	768.5	770.7	769.6	766.8
137.5°	802.0	811.0	812.8	812.0	807.8
140°	841.1	850.2	855.2	855.2	851.2
142.5°	881.5	890.4	893.2	894.4	890.4
145°	919.5	926.7	932.5	933.6	929.6
147.5°	953.7	962.6	967.0	968.7	964.8
150°	988.9	995.0	999.0	1002.2	999.0
152.5°	1020.2	1026.2	1031.3	1035.3	1031.3
155°	1051.4	1054.3	1057.5	1062.6	1059.3
157.5°	1078.5	1080.5	1082.3	1089.6	1084.5
160°	1102.5	1104.7	1105.7	1111.8	1107.5
162.5°	1124.7	1124.7	1125.9	1132.7	1127.7
165°	1143.9	1142.7	1142.7	1149.9	1144.9
167.5°	1161.1	1157.8	1157.8	1165.1	1160.0
170°	1174.0	1171.1	1170.1	1177.2	1171.1
172.5°	1183.0	1180.2	1179.0	1186.3	1180.2
175°	1190.2	1187.3	1185.2	1192.3	1186.3
177.5°	1194.2	1191.3	1189.1	1195.2	1189.1
180°	1192.3	1192.3	1192.3	1192.3	1192.3

TEST NUMBER: P903216

CATALOG NUMBER: DFN2DIP-PN4F0-060D040US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.02	11.01	10.86	11.87	12.95	9.58	10.57	10.42	11.43	12.51
	3H	11.69	12.58	12.55	13.45	14.56	11.21	12.10	12.06	12.97	14.07
	4H	12.29	13.13	13.16	14.00	15.12	11.80	12.64	12.67	13.52	14.63
	6H	12.70	13.47	13.58	14.36	15.48	12.20	12.98	13.09	13.86	14.99
	8H	12.81	13.54	13.70	14.45	15.57	12.31	13.05	13.20	13.95	15.08
	12H	12.86	13.56	13.75	14.46	15.61	12.36	13.06	13.26	13.96	15.11
4H	2H	10.50	11.34	11.37	12.21	13.33	10.15	10.98	11.02	11.86	12.98
	3H	12.38	13.08	13.26	13.99	15.12	11.97	12.68	12.86	13.59	14.72
	4H	13.10	13.74	14.00	14.64	15.80	12.68	13.32	13.58	14.23	15.38
	6H	13.62	14.18	14.54	15.11	16.26	13.20	13.75	14.11	14.68	15.84
	8H	13.78	14.29	14.69	15.22	16.39	13.35	13.87	14.26	14.79	15.96
	12H	13.86	14.32	14.79	15.27	16.44	13.42	13.88	14.35	14.83	16.00
8H	4H	13.31	13.82	14.22	14.75	15.92	12.94	13.45	13.85	14.38	15.55
	6H	13.95	14.37	14.89	15.34	16.51	13.57	14.00	14.51	14.96	16.13
	8H	14.17	14.55	15.12	15.51	16.69	13.79	14.16	14.74	15.12	16.31
	12H	14.31	14.64	15.26	15.59	16.83	13.91	14.24	14.86	15.19	16.43
12H	4H	13.30	13.76	14.23	14.71	15.88	12.94	13.40	13.87	14.34	15.52
	6H	13.98	14.36	14.93	15.31	16.50	13.61	13.99	14.56	14.95	16.14
	8H	14.23	14.56	15.18	15.51	16.75	13.86	14.19	14.81	15.14	16.38

END OF REPORT