

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906111

Luminaire Tested: DFN2DIP-PN4F0-100D090US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906111
REPORT IS A COMBINATION OF REPORTS P901232 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-100D090US835-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17410.0 lumens
Efficiency: N/A
Efficacy: 103.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 167.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906111

CATALOG NUMBER: DFN2DIP-PN4F0-100D090US835-RLLONL

Luminous Intensity Polar Plot

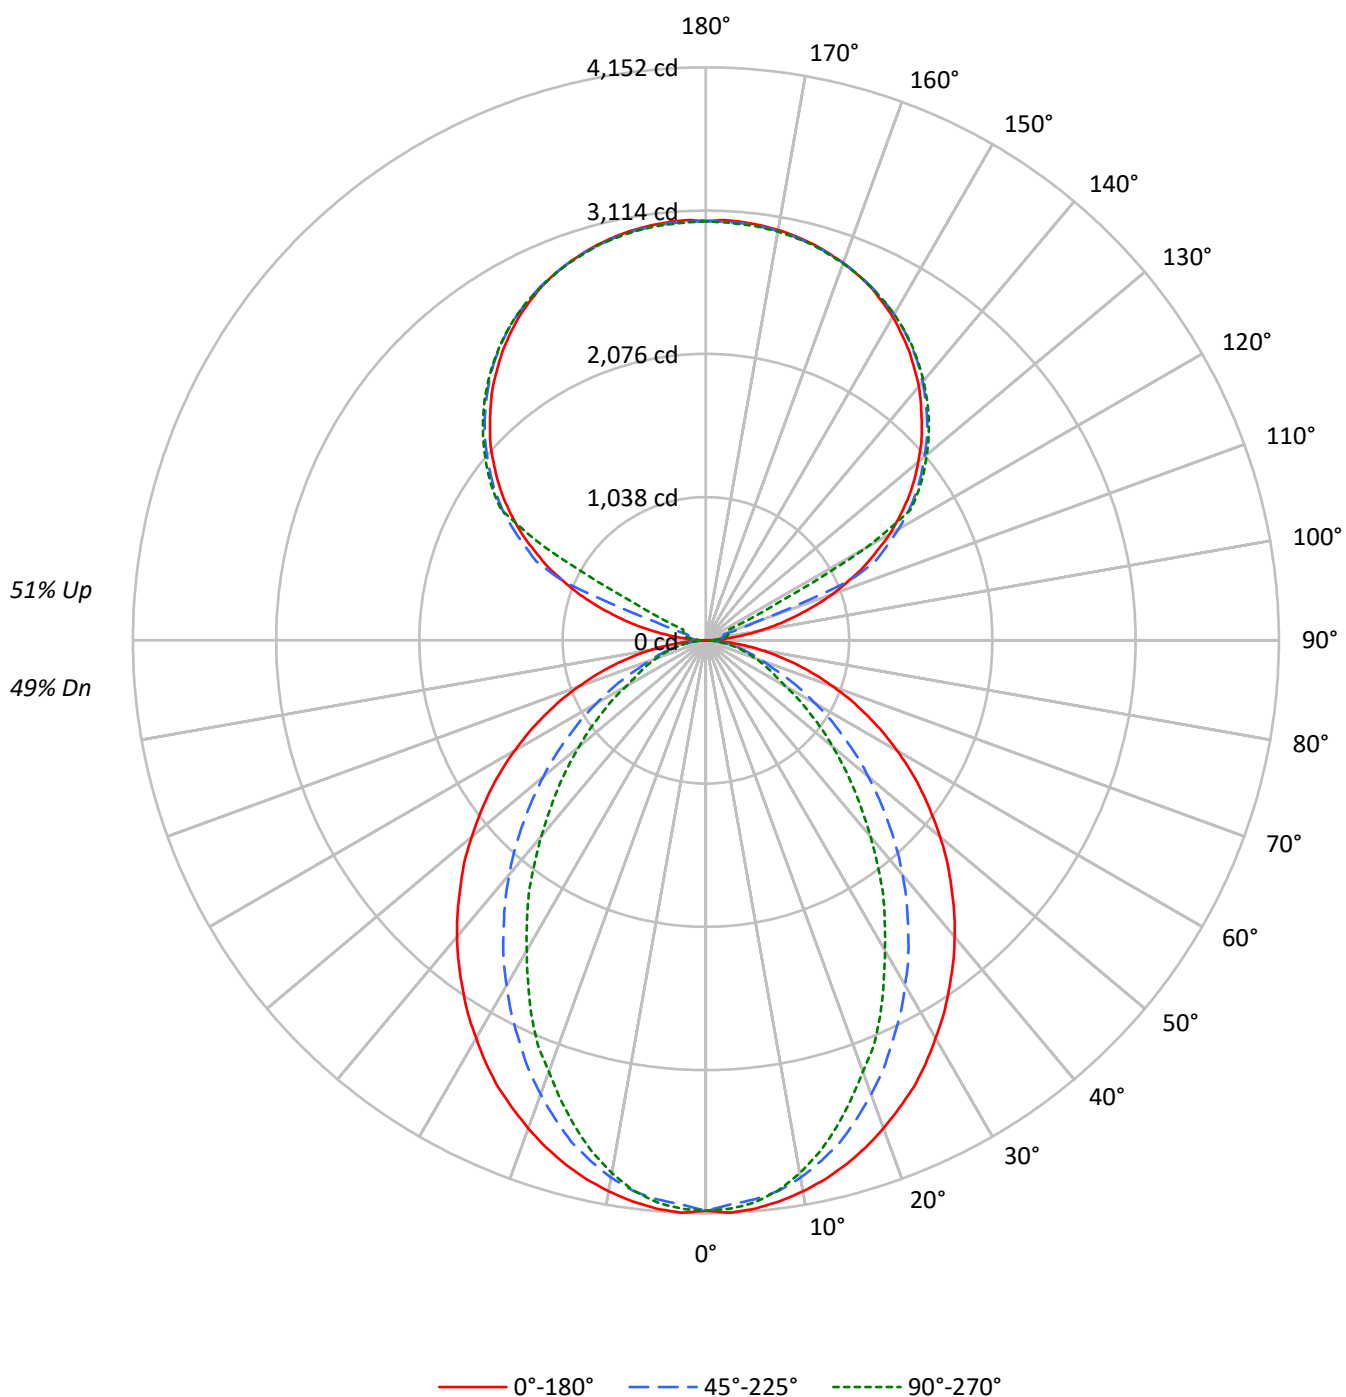

TEST NUMBER: P906111

CATALOG NUMBER: DFN2DIP-PN4F0-100D090US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	83	81	73	71	69	61	59	58	49	48	47
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	56	57	53	49	48	45	42	39	37	35
4	75	65	57	51	69	60	53	48	51	46	42	43	39	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	29	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	35	30	51	40	33	29	35	29	26	30	26	22	25	22	19
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3017	3017	3017
5°	3022	2969	2989
10°	2992	2912	2892
15°	2951	2816	2742
20°	2896	2683	2558
25°	2840	2535	2380
30°	2765	2383	2155
35°	2692	2219	1956
40°	2617	2050	1729
45°	2530	1862	1523
50°	2441	1672	1322
55°	2347	1470	1128
60°	2239	1257	929
65°	2114	1042	837
70°	1963	841	758
75°	1773	742	691
80°	1497	624	601
85°	1043	418	456

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2530 cd/sqm

TEST NUMBER: P906111

CATALOG NUMBER: DFN2DIP-PN4F0-100D090US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	387.3	2.2
10°-20°	1063.3	6.1
20°-30°	1492.9	8.6
30°-40°	1627.4	9.3
40°-50°	1495.7	8.6
50°-60°	1174.7	6.7
60°-70°	764.6	4.4
70°-80°	393.6	2.3
80°-90°	105.8	0.6
90°-100°	100.2	0.6
100°-110°	373.4	2.1
110°-120°	990.2	5.7
120°-130°	1642.4	9.4
130°-140°	1744.6	10.0
140°-150°	1621.4	9.3
150°-160°	1303.5	7.5
160°-170°	840.0	4.8
170°-180°	289.1	1.7
0°-30°	2943.6	16.9
0°-40°	4571.0	26.3
0°-60°	7241.3	41.6
0°-90°	8505.3	48.9
90°-120°	1463.7	8.4
90°-150°	6472.0	37.2
90°-180°	8905.0	51.1
0°-180°	17410.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4133	4133	4133	4133	4133	
5°	4133	4114	4066	4099	4088	392
15°	3931	3890	3763	3692	3654	1108
25°	3568	3448	3202	3048	2992	1641
35°	3075	2884	2555	2319	2236	1924
45°	2514	2263	1870	1604	1515	1941
55°	1911	1620	1216	991	920	1708
65°	1290	987	651	524	512	1279
75°	688	426	299	273	269	728
85°	161	82	71	71	71	184
90°	2	26	44	55	59	16
95°	143	70	86	97	94	169
105°	668	734	134	158	167	714
115°	1264	1301	1356	338	180	1244
125°	1787	1815	1857	1873	1879	1594
135°	2211	2246	2266	2288	2284	1708
145°	2565	2563	2600	2615	2604	1604
155°	2824	2805	2831	2844	2826	1301
165°	2976	2963	2969	2985	2969	841
175°	3044	3028	3033	3048	3026	290
180°	3037	3037	3037	3037	3037	

TEST NUMBER: P906111

CATALOG NUMBER: DFN2DIP-PN4F0-100D090US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4133.0	4133.0	4133.0	4133.0	4133.0
2.5°	4151.6	4133.0	4091.7	4129.4	4121.9
5°	4133.0	4114.3	4065.5	4099.3	4088.1
7.5°	4099.3	4077.0	4024.6	4039.3	4020.7
10°	4054.4	4028.2	3953.6	3942.1	3919.9
12.5°	3998.5	3964.7	3863.5	3841.3	3800.0
15°	3931.0	3889.7	3762.7	3691.7	3654.4
17.5°	3852.4	3792.5	3635.4	3553.2	3493.3
20°	3762.7	3687.7	3500.8	3407.6	3325.0
22.5°	3665.5	3579.4	3362.3	3235.4	3179.4
25°	3568.3	3448.5	3201.6	3048.4	2992.1
27.5°	3452.4	3325.0	3052.0	2876.2	2790.1
30°	3329.0	3186.5	2887.3	2696.9	2595.7
32.5°	3209.2	3036.9	2730.6	2506.0	2412.3
35°	3074.6	2883.8	2554.8	2319.1	2236.5
37.5°	2943.7	2737.7	2390.1	2131.8	2038.5
40°	2805.2	2581.0	2217.9	1952.4	1855.2
42.5°	2663.1	2423.8	2046.1	1769.1	1675.8
45°	2513.5	2262.7	1870.3	1604.4	1514.7
47.5°	2371.5	2106.0	1702.0	1436.1	1354.0
50°	2214.3	1948.8	1537.3	1279.0	1200.8
52.5°	2060.7	1780.2	1380.2	1133.3	1062.3
55°	1911.1	1619.5	1215.5	991.3	920.2
57.5°	1758.0	1458.7	1069.9	860.3	800.4
60°	1600.8	1301.6	916.3	725.8	665.9
62.5°	1447.6	1148.4	785.3	606.0	576.2
65°	1290.5	987.3	650.8	523.8	512.3
67.5°	1140.9	837.7	523.8	459.9	448.8
70°	983.7	692.1	433.7	396.4	381.4
72.5°	834.1	557.1	362.7	332.9	325.4
75°	688.1	426.2	299.2	273.0	269.4
77.5°	542.5	302.8	235.7	220.6	213.1
80°	407.5	217.1	179.4	164.7	164.7
82.5°	284.1	146.0	123.4	115.9	115.9
85°	160.7	82.1	71.0	71.0	71.0
87.5°	59.9	29.8	29.8	26.2	26.2
90°	2.1	26.4	43.8	55.1	59.2
92.5°	55.1	46.2	52.7	57.2	59.2
95°	142.8	70.2	85.6	96.8	94.5
97.5°	257.1	77.0	112.0	118.7	120.8
100°	389.1	88.0	125.3	142.8	147.2
102.5°	534.0	529.8	129.7	153.7	160.5
105°	668.1	734.2	134.1	158.2	167.0
107.5°	824.2	879.0	138.6	162.6	171.5
110°	973.7	1019.7	384.7	164.9	173.6

TEST NUMBER: P906111

CATALOG NUMBER: DFN2DIP-PN4F0-100D090US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1114.4	1153.8	1116.5	169.1	175.9
115°	1263.7	1301.0	1356.1	338.5	180.3
117.5°	1393.4	1437.3	1474.8	1160.4	584.6
120°	1538.5	1571.4	1611.1	1637.4	1340.7
122.5°	1661.5	1696.7	1740.8	1753.8	1756.2
125°	1786.7	1815.4	1857.2	1872.6	1879.1
127.5°	1901.0	1931.8	1965.0	1986.9	1989.0
130°	2008.8	2044.1	2068.1	2092.3	2090.3
132.5°	2118.7	2147.4	2171.4	2191.3	2189.2
135°	2211.1	2246.3	2265.9	2288.1	2283.7
137.5°	2307.7	2334.0	2356.2	2378.1	2371.6
140°	2402.1	2419.9	2443.9	2463.7	2452.8
142.5°	2481.5	2496.9	2525.3	2542.8	2531.9
145°	2565.0	2562.6	2600.0	2615.4	2604.4
147.5°	2637.3	2630.8	2668.1	2679.1	2670.4
150°	2707.8	2692.4	2727.6	2740.6	2729.7
152.5°	2767.0	2749.5	2782.4	2795.7	2780.3
155°	2824.2	2804.6	2830.9	2844.0	2826.5
157.5°	2870.4	2852.9	2872.7	2888.1	2870.4
160°	2910.0	2896.7	2910.0	2923.1	2907.7
162.5°	2945.0	2931.9	2942.9	2958.3	2938.5
165°	2975.8	2962.7	2969.3	2984.7	2969.3
167.5°	3000.1	2986.8	2993.5	3008.9	2989.1
170°	3019.9	3006.6	3011.0	3026.4	3006.6
172.5°	3033.0	3019.9	3024.3	3039.7	3019.9
175°	3043.9	3028.5	3033.0	3048.3	3026.4
177.5°	3048.3	3033.0	3035.3	3050.7	3030.9
180°	3037.4	3037.4	3037.4	3037.4	3037.4

TEST NUMBER: P906111

CATALOG NUMBER: DFN2DIP-PN4F0-100D090US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.88	11.70	11.86	12.69	13.98	6.85	7.67	7.82	8.65	9.94
	3H	12.56	13.30	13.55	14.29	15.60	8.04	8.77	9.02	9.76	11.07
	4H	13.17	13.87	14.17	14.86	16.18	8.49	9.18	9.48	10.18	11.50
	6H	13.60	14.23	14.60	15.23	16.57	8.81	9.45	9.82	10.45	11.78
	8H	13.72	14.33	14.74	15.35	16.68	8.90	9.51	9.91	10.52	11.85
	12H	13.79	14.36	14.80	15.37	16.73	8.94	9.52	9.96	10.53	11.88
4H	2H	10.90	11.59	11.90	12.59	13.91	7.44	8.14	8.45	9.13	10.45
	3H	12.73	13.31	13.74	14.33	15.67	8.79	9.37	9.81	10.39	11.73
	4H	13.42	13.95	14.45	14.97	16.33	9.34	9.87	10.36	10.89	12.24
	6H	13.94	14.40	14.97	15.44	16.79	9.76	10.21	10.79	11.25	12.61
	8H	14.12	14.54	15.15	15.57	16.94	9.89	10.31	10.92	11.35	12.71
	12H	14.22	14.60	15.27	15.64	17.02	9.96	10.34	11.01	11.39	12.76
8H	4H	13.39	13.81	14.42	14.85	16.22	9.62	10.05	10.65	11.08	12.45
	6H	13.96	14.31	15.02	15.39	16.75	10.14	10.49	11.20	11.57	12.93
	8H	14.18	14.49	15.24	15.55	16.93	10.33	10.64	11.40	11.70	13.09
	12H	14.32	14.59	15.39	15.64	17.07	10.45	10.72	11.52	11.78	13.21
12H	4H	13.34	13.73	14.39	14.77	16.15	9.63	10.01	10.68	11.06	12.43
	6H	13.94	14.24	15.00	15.30	16.69	10.19	10.50	11.26	11.56	12.94
	8H	14.16	14.43	15.23	15.48	16.91	10.40	10.67	11.47	11.73	13.16

END OF REPORT