

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908982

Luminaire Tested: DFN2DIP-SQ2F0-050D050US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908982
REPORT IS A COMBINATION OF REPORTS P899800 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D050US840-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8760.6 lumens
Efficiency: N/A
Efficacy: 107.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 81.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908982

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US840-RLLFLL

Luminous Intensity Polar Plot

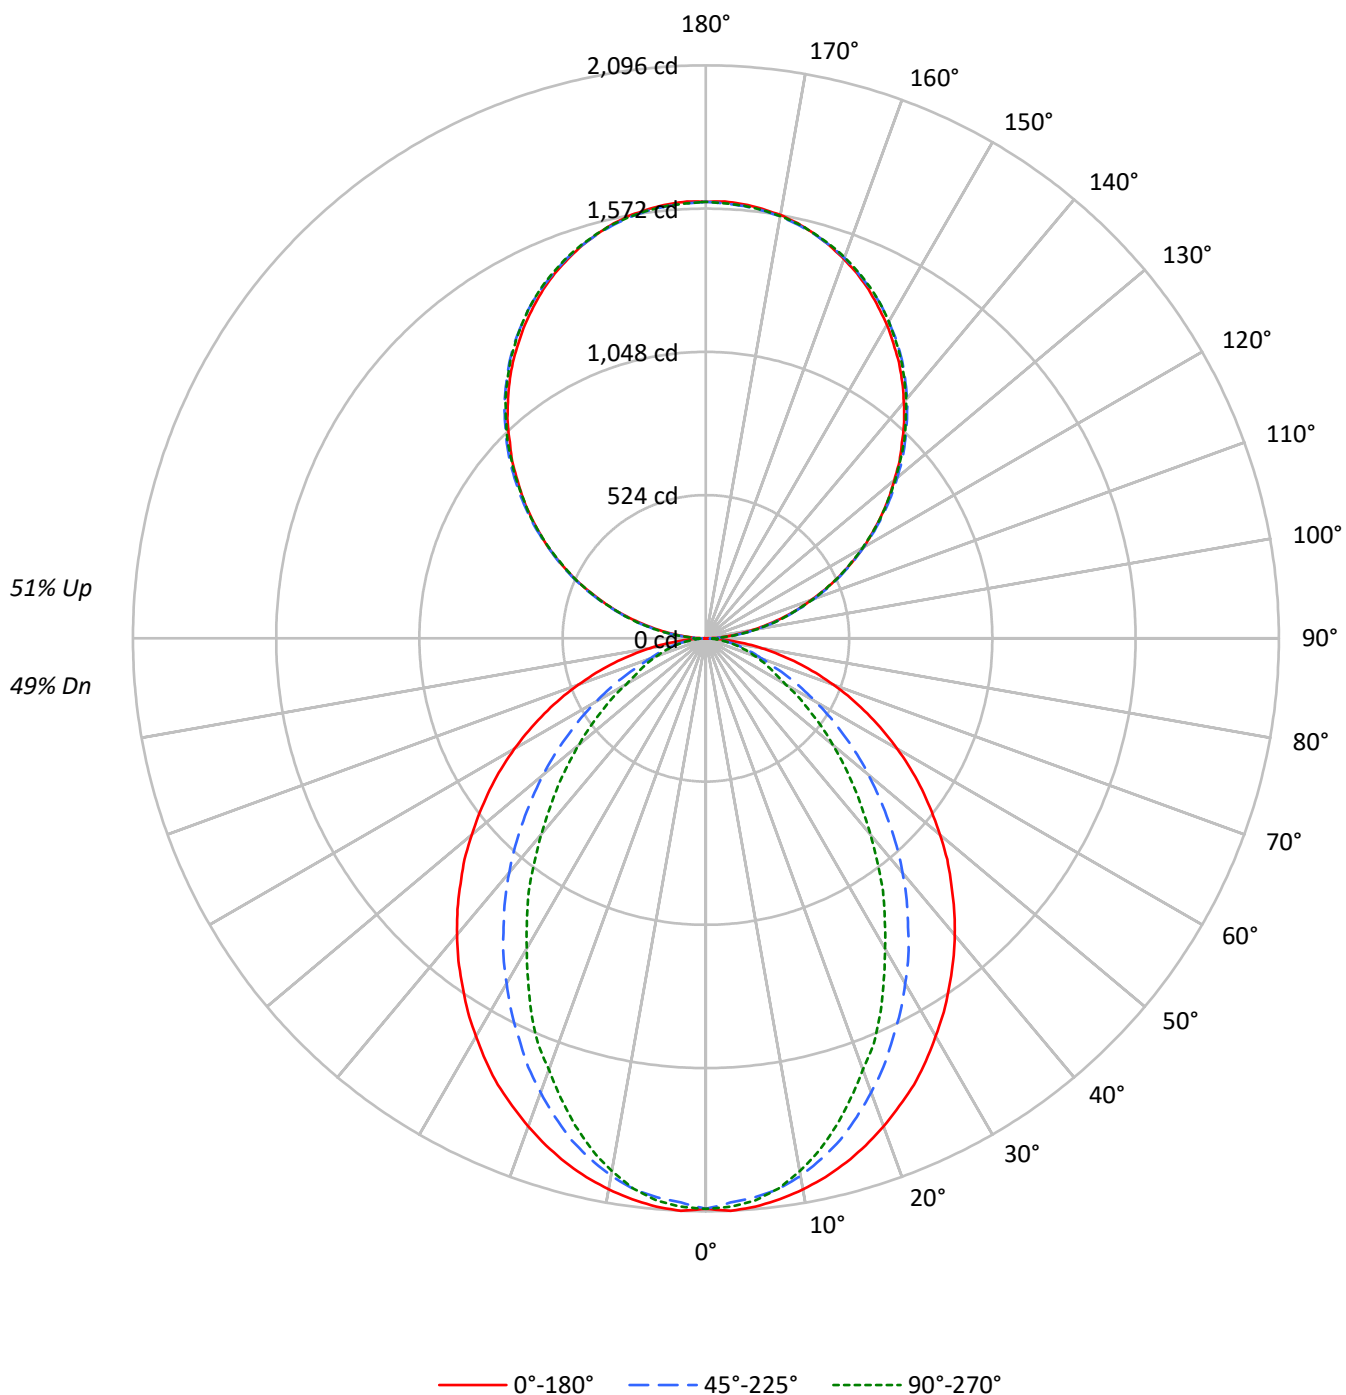

TEST NUMBER: P908982

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4589	4589	4589
5°	4588	4506	4539
10°	4535	4408	4384
15°	4464	4252	4150
20°	4374	4042	3865
25°	4281	3809	3590
30°	4159	3570	3243
35°	4040	3314	2938
40°	3917	3051	2591
45°	3776	2760	2275
50°	3629	2468	1968
55°	3475	2156	1673
60°	3297	1832	1371
65°	3091	1504	1227
70°	2841	1198	1101
75°	2526	1036	989
80°	2074	842	838
85°	1351	523	597

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3776 cd/sqm

TEST NUMBER: P908982

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.6	2.2
10°-20°	536.9	6.1
20°-30°	753.8	8.6
30°-40°	821.7	9.4
40°-50°	755.2	8.6
50°-60°	593.1	6.8
60°-70°	386.1	4.4
70°-80°	198.7	2.3
80°-90°	55.3	0.6
90°-100°	98.8	1.1
100°-110°	314.0	3.6
110°-120°	537.3	6.1
120°-130°	706.6	8.1
130°-140°	793.2	9.1
140°-150°	777.8	8.9
150°-160°	652.5	7.4
160°-170°	432.7	4.9
170°-180°	151.2	1.7
0°-30°	1486.3	17.0
0°-40°	2308.0	26.3
0°-60°	3656.4	41.7
0°-90°	4296.5	49.0
90°-120°	950.1	10.8
90°-150°	3227.7	36.8
90°-180°	4464.0	51.0
0°-180°	8760.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2087	2087	2087	2087	2087	
5°	2087	2078	2053	2070	2064	198
15°	1985	1964	1900	1864	1845	559
25°	1802	1741	1617	1539	1511	829
35°	1552	1456	1290	1171	1129	972
45°	1269	1143	944	810	765	980
55°	965	818	614	500	465	862
65°	652	499	329	264	259	646
75°	348	215	151	138	136	368
85°	81	42	36	36	36	93
90°	1	17	47	44	46	9
95°	70	84	86	86	84	78
105°	290	294	297	299	299	306
115°	539	547	544	543	539	533
125°	784	796	792	788	787	701
135°	1014	1029	1032	1031	1027	784
145°	1232	1241	1249	1250	1245	769
155°	1408	1412	1416	1423	1419	648
165°	1532	1530	1530	1540	1533	432
175°	1594	1590	1587	1597	1589	151
180°	1597	1597	1597	1597	1597	

TEST NUMBER: P908982

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2086.9	2086.9	2086.9	2086.9	2086.9
2.5°	2096.3	2086.9	2066.1	2085.1	2081.2
5°	2086.9	2077.5	2052.9	2069.8	2064.3
7.5°	2069.8	2058.6	2032.2	2039.6	2030.1
10°	2047.2	2034.0	1996.3	1990.5	1979.2
12.5°	2018.9	2002.0	1950.9	1939.6	1918.7
15°	1984.9	1964.1	1900.0	1864.1	1845.2
17.5°	1945.2	1915.0	1835.6	1794.1	1763.8
20°	1900.0	1862.1	1767.7	1720.6	1678.9
22.5°	1850.9	1807.4	1697.8	1633.7	1605.4
25°	1801.7	1741.2	1616.6	1539.2	1510.8
27.5°	1743.2	1678.9	1541.1	1452.3	1408.9
30°	1680.9	1609.0	1457.9	1361.7	1310.6
32.5°	1620.4	1533.5	1378.8	1265.4	1218.1
35°	1552.5	1456.1	1290.0	1170.9	1129.3
37.5°	1486.3	1382.4	1206.9	1076.4	1029.4
40°	1416.4	1303.2	1119.8	985.8	936.8
42.5°	1344.7	1223.9	1033.1	893.2	846.2
45°	1269.2	1142.6	944.3	810.1	764.8
47.5°	1197.4	1063.4	859.4	725.2	683.7
50°	1118.1	984.0	776.3	645.8	606.3
52.5°	1040.6	898.9	696.9	572.3	536.4
55°	965.0	817.7	613.7	500.5	464.6
57.5°	887.7	736.6	540.2	434.4	404.1
60°	808.3	657.2	462.6	366.5	336.2
62.5°	730.9	579.9	396.6	306.0	290.9
65°	651.6	498.6	328.6	264.5	258.7
67.5°	576.0	423.0	264.5	232.3	226.6
70°	496.8	349.4	219.0	200.2	192.6
72.5°	421.2	281.3	183.2	168.1	164.3
75°	347.5	215.2	151.1	137.8	136.0
77.5°	273.9	152.9	119.1	111.4	107.6
80°	205.8	109.6	90.6	83.1	83.1
82.5°	143.5	73.7	62.3	58.5	58.5
85°	81.2	41.5	35.9	35.9	35.9
87.5°	30.3	15.0	15.0	13.2	13.2
90°	1.4	17.4	47.2	44.3	45.7
92.5°	29.9	40.4	41.9	43.3	43.3
95°	70.3	83.8	86.1	86.1	83.8
97.5°	116.9	129.5	134.8	134.8	134.8
100°	170.9	182.0	185.8	185.8	184.4
102.5°	227.7	235.9	241.2	242.7	241.2
105°	289.8	293.7	296.6	298.9	298.9
107.5°	351.4	357.2	357.2	358.2	351.4
110°	411.1	418.9	418.9	418.9	415.0



TEST NUMBER: P908982

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US840-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	475.6	483.8	482.4	478.6	475.6
115°	539.2	546.9	544.5	543.1	539.2
117.5°	602.3	612.9	606.1	602.3	598.4
120°	665.8	676.4	665.8	665.8	661.5
122.5°	723.6	737.1	730.3	726.5	723.6
125°	784.3	796.3	792.4	788.1	786.7
127.5°	843.4	858.4	853.1	847.3	843.4
130°	898.9	916.2	913.7	910.9	905.5
132.5°	961.0	974.4	975.4	968.7	964.8
135°	1014.4	1029.3	1032.2	1030.8	1026.9
137.5°	1074.1	1086.1	1088.5	1087.5	1081.8
140°	1126.5	1138.6	1145.3	1145.3	1140.0
142.5°	1180.4	1192.6	1196.4	1197.8	1192.6
145°	1231.5	1241.1	1248.8	1250.3	1245.0
147.5°	1277.3	1289.3	1295.1	1297.5	1292.1
150°	1324.4	1332.6	1337.9	1342.2	1337.9
152.5°	1366.3	1374.5	1381.2	1386.5	1381.2
155°	1408.2	1412.0	1416.3	1423.1	1418.8
157.5°	1444.3	1447.1	1449.6	1459.3	1452.5
160°	1476.5	1479.5	1480.9	1489.0	1483.3
162.5°	1506.4	1506.4	1507.8	1517.0	1510.3
165°	1532.0	1530.5	1530.5	1540.1	1533.4
167.5°	1555.0	1550.6	1550.6	1560.3	1553.6
170°	1572.4	1568.5	1567.1	1576.7	1568.5
172.5°	1584.4	1580.5	1579.1	1588.7	1580.5
175°	1594.1	1590.1	1587.3	1596.9	1588.7
177.5°	1599.3	1595.5	1592.6	1600.7	1592.6
180°	1596.9	1596.9	1596.9	1596.9	1596.9

TEST NUMBER: P908982

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.23	13.06	13.21	14.04	15.33	8.19	9.02	9.17	10.00	11.29
	3H	13.89	14.63	14.87	15.62	16.93	9.36	10.10	10.35	11.09	12.40
	4H	14.49	15.18	15.48	16.18	17.49	9.80	10.50	10.80	11.49	12.81
	6H	14.89	15.53	15.90	16.53	17.86	10.11	10.75	11.11	11.74	13.07
	8H	15.01	15.62	16.02	16.63	17.96	10.19	10.80	11.20	11.81	13.14
	12H	15.06	15.64	16.08	16.65	18.00	10.22	10.80	11.24	11.81	13.16
4H	2H	12.25	12.94	13.25	13.94	15.25	8.78	9.47	9.78	10.47	11.79
	3H	14.05	14.63	15.06	15.65	16.98	10.11	10.68	11.12	11.71	13.04
	4H	14.73	15.26	15.75	16.27	17.63	10.64	11.17	11.66	12.18	13.54
	6H	15.22	15.68	16.25	16.72	18.07	11.04	11.49	12.07	12.53	13.88
	8H	15.39	15.81	16.42	16.84	18.21	11.16	11.58	12.19	12.61	13.98
	12H	15.47	15.86	16.52	16.90	18.27	11.21	11.59	12.26	12.64	14.01
8H	4H	14.69	15.12	15.72	16.15	17.51	10.91	11.33	11.94	12.36	13.73
	6H	15.24	15.59	16.29	16.66	18.02	11.40	11.75	12.45	12.82	14.19
	8H	15.44	15.75	16.50	16.81	18.19	11.58	11.88	12.64	12.94	14.33
	12H	15.56	15.83	16.63	16.89	18.31	11.68	11.95	12.75	13.00	14.43
12H	4H	14.64	15.02	15.69	16.07	17.44	10.91	11.29	11.96	12.34	13.71
	6H	15.21	15.52	16.27	16.58	17.96	11.44	11.75	12.51	12.81	14.19
	8H	15.42	15.69	16.48	16.74	18.16	11.64	11.91	12.70	12.96	14.39