

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908996

Luminaire Tested: DFN2DIP-SQ2F0-060D030US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908996
REPORT IS A COMBINATION OF REPORTS P899777 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D030US840-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8679.8 lumens
Efficiency: N/A
Efficacy: 111.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 77.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908996

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US840-FLLFLL

Luminous Intensity Polar Plot

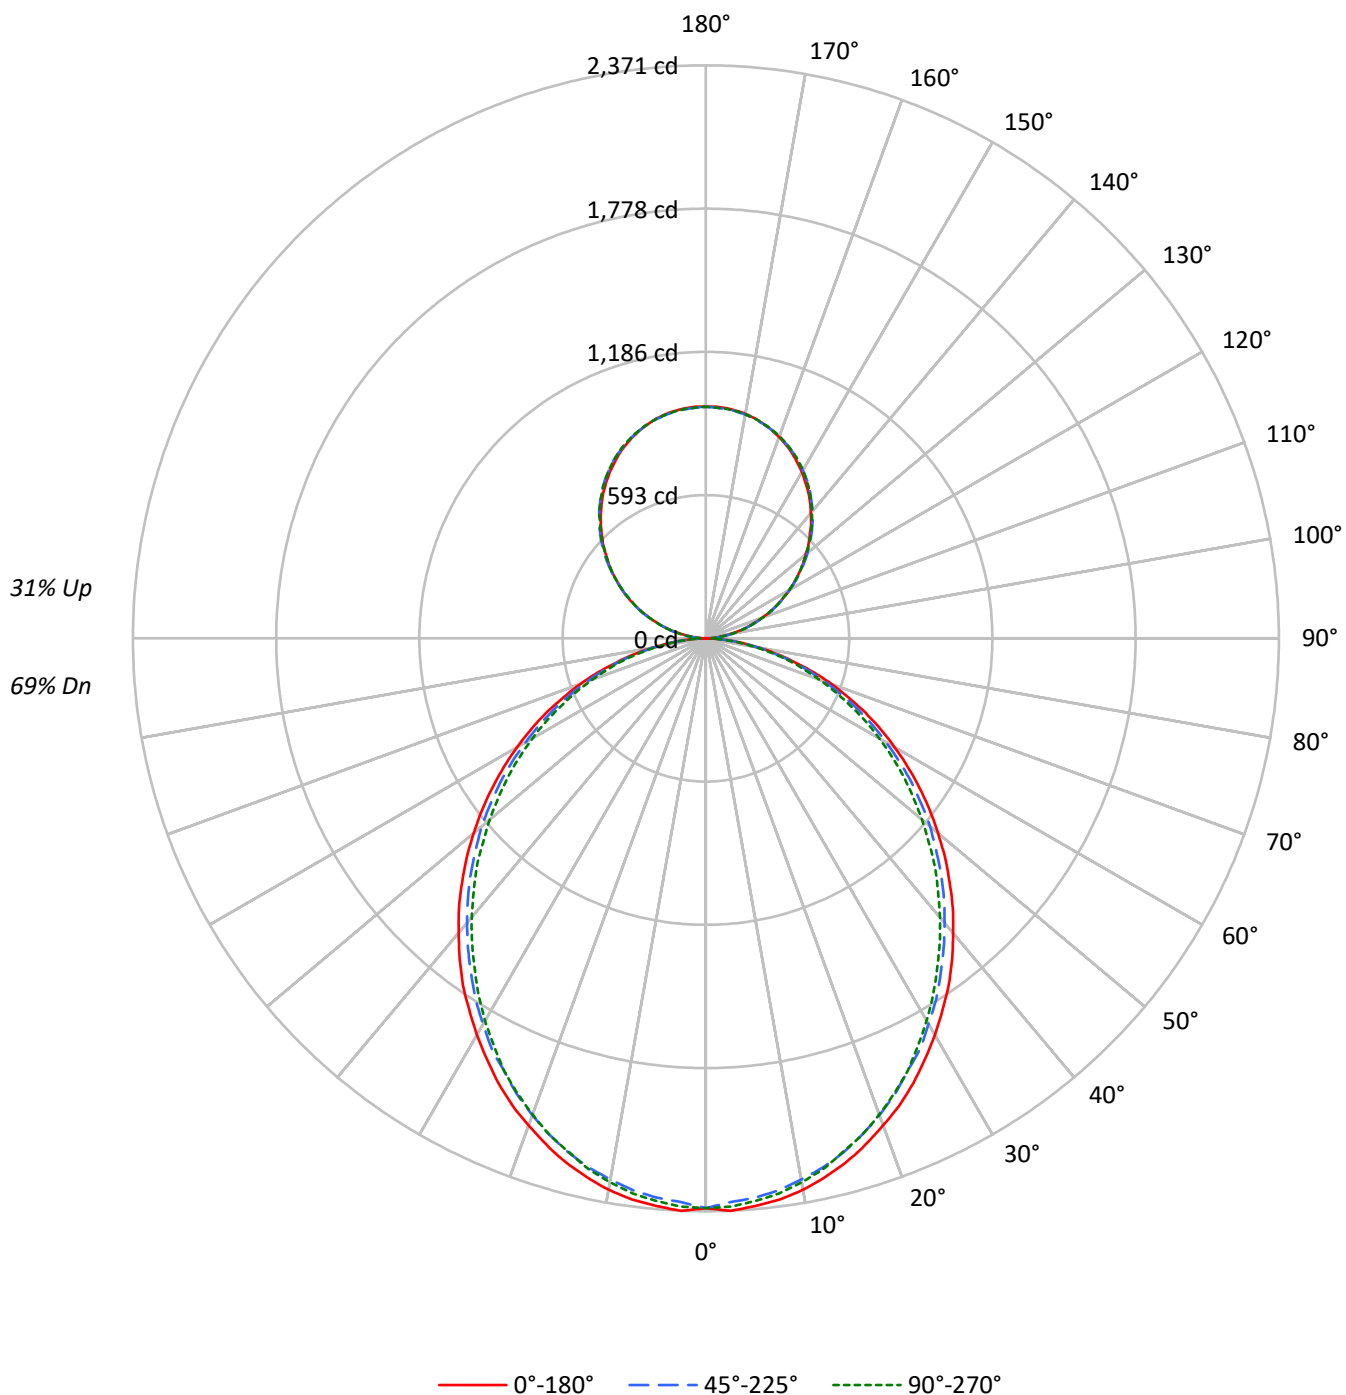

TEST NUMBER: P908996

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	35	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5184	5184	5184
5°	5183	5101	5139
10°	5133	5021	5062
15°	5048	4927	4946
20°	4937	4801	4828
25°	4826	4652	4692
30°	4690	4513	4522
35°	4560	4351	4341
40°	4401	4187	4169
45°	4243	4022	3993
50°	4069	3848	3790
55°	3886	3648	3601
60°	3680	3411	3384
65°	3452	3165	3129
70°	3164	2863	2853
75°	2768	2503	2588
80°	2286	2043	2102
85°	1544	1290	1321

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4243 cd/sqm

TEST NUMBER: P908996

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	2.6
10°-20°	624.4	7.2
20°-30°	917.5	10.6
30°-40°	1065.7	12.3
40°-50°	1064.4	12.3
50°-60°	928.1	10.7
60°-70°	686.1	7.9
70°-80°	388.2	4.5
80°-90°	105.2	1.2
90°-100°	59.3	0.7
100°-110°	188.4	2.2
110°-120°	322.4	3.7
120°-130°	424.0	4.9
130°-140°	475.9	5.5
140°-150°	466.7	5.4
150°-160°	391.5	4.5
160°-170°	259.6	3.0
170°-180°	90.7	1.0
0°-30°	1763.8	20.3
0°-40°	2829.5	32.6
0°-60°	4821.9	55.6
0°-90°	6001.3	69.1
90°-120°	570.1	6.6
90°-150°	1936.6	22.3
90°-180°	2678.0	30.9
0°-180°	8679.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	1	10	28	27	28	8
95°	42	50	52	52	50	47
105°	174	176	178	179	179	184
115°	324	328	327	326	324	320
125°	471	478	475	473	472	420
135°	609	618	619	618	616	470
145°	739	745	749	750	747	462
155°	845	847	850	854	851	389
165°	919	918	918	924	920	259
175°	956	954	952	958	953	91
180°	958	958	958	958	958	

TEST NUMBER: P908996

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	0.9	10.4	28.3	26.6	27.5
92.5°	17.9	24.2	25.1	26.0	26.0
95°	42.2	50.3	51.7	51.7	50.3
97.5°	70.2	77.7	80.9	80.9	80.9
100°	102.5	109.2	111.5	111.5	110.7
102.5°	136.6	141.6	144.7	145.6	144.7
105°	173.9	176.2	177.9	179.4	179.4
107.5°	210.9	214.3	214.3	214.9	210.9
110°	246.7	251.4	251.4	251.4	249.0

TEST NUMBER: P908996

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	285.4	290.3	289.4	287.1	285.4
115°	323.6	328.1	326.7	325.9	323.6
117.5°	361.3	367.7	363.7	361.3	359.0
120°	399.5	405.9	399.5	399.5	396.9
122.5°	434.1	442.2	438.2	435.9	434.1
125°	470.6	477.8	475.4	472.8	472.0
127.5°	506.0	515.0	511.9	508.4	506.0
130°	539.3	549.7	548.3	546.5	543.3
132.5°	576.5	584.6	585.2	581.2	578.9
135°	608.6	617.5	619.4	618.4	616.1
137.5°	644.4	651.7	653.1	652.6	649.0
140°	675.9	683.2	687.2	687.2	684.0
142.5°	708.3	715.5	717.8	718.7	715.5
145°	738.9	744.7	749.3	750.1	747.0
147.5°	766.4	773.6	777.0	778.5	775.3
150°	794.7	799.6	802.7	805.4	802.7
152.5°	819.8	824.7	828.7	831.9	828.7
155°	845.0	847.2	849.8	853.8	851.3
157.5°	866.6	868.3	869.8	875.6	871.5
160°	886.0	887.7	888.6	893.4	890.0
162.5°	903.8	903.8	904.7	910.2	906.2
165°	919.2	918.3	918.3	924.0	920.0
167.5°	933.0	930.4	930.4	936.1	932.1
170°	943.4	941.1	940.3	946.0	941.1
172.5°	950.6	948.4	947.5	953.2	948.4
175°	956.4	954.1	952.4	958.2	953.2
177.5°	959.6	957.3	955.5	960.5	955.5
180°	958.2	958.2	958.2	958.2	958.2

TEST NUMBER: P908996

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.48	15.54	15.25	16.34	17.31	14.03	15.10	14.81	15.89	16.86
	3H	16.13	17.09	16.92	17.89	18.89	15.64	16.60	16.43	17.41	18.40
	4H	16.72	17.62	17.52	18.43	19.44	16.22	17.13	17.03	17.94	18.95
	6H	17.11	17.95	17.93	18.77	19.79	16.61	17.45	17.43	18.27	19.29
	8H	17.22	18.01	18.04	18.85	19.87	16.71	17.51	17.54	18.35	19.37
	12H	17.26	18.02	18.10	18.85	19.91	16.75	17.51	17.59	18.35	19.40
4H	2H	14.95	15.85	15.76	16.67	17.68	14.60	15.50	15.40	16.31	17.32
	3H	16.81	17.57	17.63	18.41	19.44	16.40	17.16	17.22	18.01	19.03
	4H	17.52	18.21	18.35	19.05	20.11	17.10	17.78	17.93	18.63	19.68
	6H	18.03	18.62	18.88	19.49	20.55	17.60	18.19	18.45	19.06	20.12
	8H	18.17	18.73	19.03	19.59	20.66	17.74	18.29	18.59	19.16	20.23
	12H	18.25	18.75	19.12	19.63	20.71	17.80	18.30	18.67	19.18	20.26
8H	4H	17.72	18.28	18.57	19.14	20.21	17.34	17.90	18.20	18.76	19.83
	6H	18.34	18.80	19.22	19.70	20.78	17.95	18.41	18.83	19.32	20.39
	8H	18.55	18.95	19.44	19.86	20.94	18.15	18.56	19.05	19.46	20.55
	12H	18.67	19.03	19.57	19.93	21.07	18.26	18.62	19.16	19.52	20.66
12H	4H	17.71	18.21	18.59	19.10	20.18	17.34	17.84	18.22	18.73	19.81
	6H	18.36	18.77	19.26	19.67	20.76	17.99	18.40	18.88	19.30	20.39
	8H	18.60	18.96	19.49	19.85	20.99	18.22	18.58	19.11	19.47	20.61