

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911740

Luminaire Tested: DFN2DIP-SQ2F0-060D070US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911740
REPORT IS A COMBINATION OF REPORTS P899825 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D070US850-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13457.7 lumens
Efficiency: N/A
Efficacy: 122.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 109.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911740

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US850-FLLFLL

Luminous Intensity Polar Plot

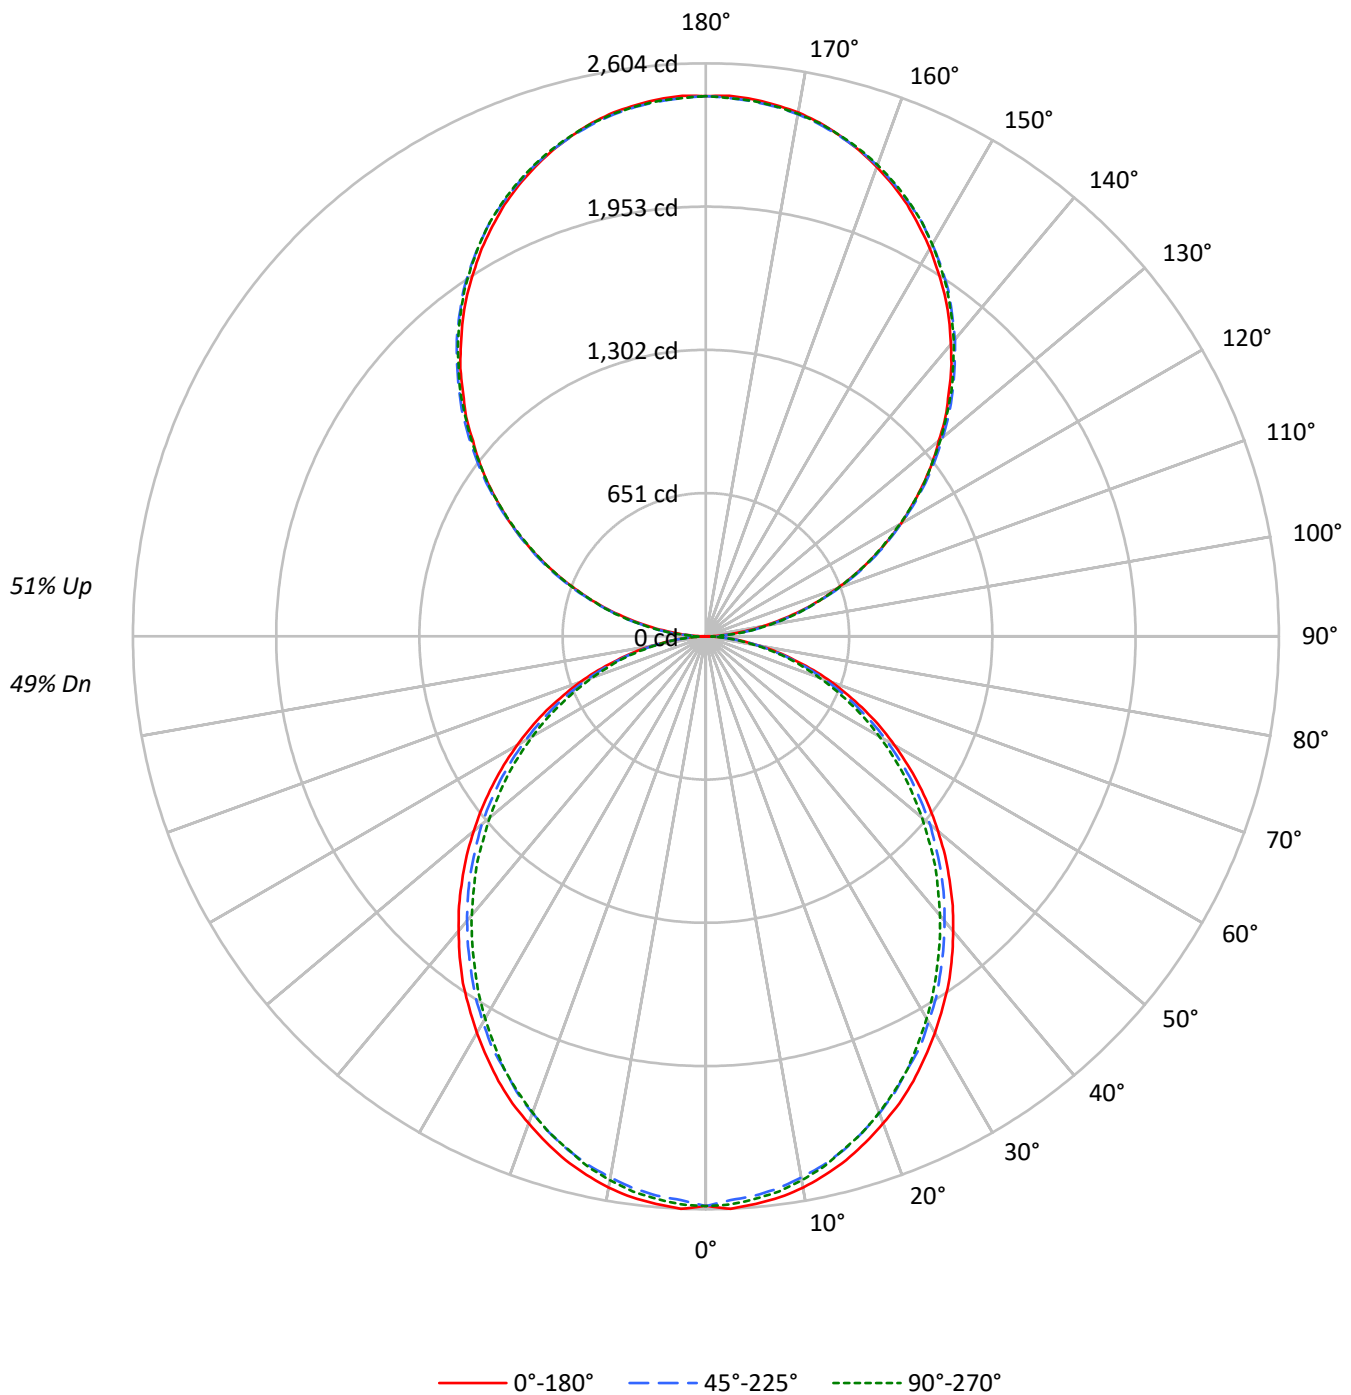

TEST NUMBER: P911740

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	93	89	86	90	86	83	80	73	70	68	60	59	57	49	48	47
2	89	81	75	70	82	75	70	65	64	60	56	53	50	48	43	41	39
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	33
4	74	63	55	49	68	59	52	46	50	45	40	42	38	34	34	31	29
5	68	56	48	42	62	52	45	40	45	39	35	37	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	29	26	28	25	22
7	58	46	38	32	53	42	35	30	36	31	27	31	26	23	25	22	20
8	54	41	34	28	49	39	32	27	33	28	24	28	24	21	23	20	18
9	50	38	30	25	46	35	29	24	30	25	21	26	22	19	22	18	16
10	47	35	28	23	43	32	26	22	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5693	5693	5693
5°	5692	5601	5644
10°	5636	5513	5559
15°	5543	5410	5432
20°	5422	5272	5302
25°	5300	5109	5153
30°	5151	4956	4965
35°	5008	4778	4768
40°	4834	4598	4579
45°	4660	4417	4385
50°	4469	4226	4162
55°	4268	4006	3954
60°	4041	3746	3717
65°	3791	3475	3436
70°	3474	3145	3133
75°	3039	2749	2842
80°	2511	2244	2308
85°	1695	1416	1451

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4660 cd/sqm

TEST NUMBER: P911740

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.7	1.8
10°-20°	685.6	5.1
20°-30°	1007.6	7.5
30°-40°	1170.3	8.7
40°-50°	1168.8	8.7
50°-60°	1019.2	7.6
60°-70°	753.4	5.6
70°-80°	426.3	3.2
80°-90°	119.5	0.9
90°-100°	151.9	1.1
100°-110°	482.7	3.6
110°-120°	826.1	6.1
120°-130°	1086.4	8.1
130°-140°	1219.5	9.1
140°-150°	1195.8	8.9
150°-160°	1003.1	7.5
160°-170°	665.3	4.9
170°-180°	232.5	1.7
0°-30°	1937.0	14.4
0°-40°	3107.2	23.1
0°-60°	5295.3	39.3
0°-90°	6594.4	49.0
90°-120°	1460.7	10.9
90°-150°	4962.4	36.9
90°-180°	6863.0	51.0
0°-180°	13457.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2589	2589	2589	2589	2589	
5°	2589	2579	2552	2572	2567	246
15°	2465	2450	2417	2428	2415	694
25°	2231	2211	2168	2173	2168	1026
35°	1925	1900	1860	1845	1832	1202
45°	1566	1549	1511	1484	1474	1209
55°	1185	1170	1140	1110	1098	1060
65°	799	784	759	737	724	790
75°	418	413	401	386	391	446
85°	102	100	97	90	87	114
90°	2	27	72	68	70	13
95°	108	129	132	132	129	120
105°	446	452	456	460	460	470
115°	829	841	837	835	829	820
125°	1206	1224	1218	1212	1210	1077
135°	1560	1582	1587	1585	1579	1205
145°	1893	1908	1920	1922	1914	1183
155°	2165	2171	2178	2188	2181	997
165°	2355	2353	2353	2368	2357	664
175°	2451	2445	2440	2455	2443	233
180°	2455	2455	2455	2455	2455	

TEST NUMBER: P911740

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2589.1	2589.1	2589.1	2589.1	2589.1
2.5°	2604.2	2591.7	2564.2	2589.1	2584.3
5°	2589.1	2579.3	2551.8	2571.7	2566.9
7.5°	2571.7	2556.9	2529.4	2549.5	2544.5
10°	2544.5	2527.1	2497.1	2517.0	2509.6
12.5°	2507.0	2492.1	2462.3	2474.7	2469.7
15°	2464.6	2449.9	2417.4	2427.5	2415.1
17.5°	2412.4	2397.7	2365.2	2377.5	2365.2
20°	2355.1	2340.3	2305.4	2312.8	2303.1
22.5°	2298.1	2275.6	2243.1	2243.1	2238.1
25°	2230.6	2210.9	2168.5	2173.3	2168.5
27.5°	2155.9	2138.5	2106.2	2098.9	2086.5
30°	2081.5	2061.3	2024.1	2016.7	2006.6
32.5°	2001.6	1986.9	1947.0	1931.9	1921.9
35°	1924.6	1899.7	1859.8	1844.7	1832.3
37.5°	1837.4	1814.9	1775.1	1757.5	1745.1
40°	1747.8	1727.7	1687.9	1665.7	1655.6
42.5°	1660.6	1640.5	1601.0	1575.9	1561.0
45°	1566.1	1548.6	1511.1	1484.0	1473.9
47.5°	1473.9	1456.4	1416.6	1389.1	1374.3
50°	1376.7	1364.3	1329.5	1294.5	1282.1
52.5°	1282.1	1264.7	1232.4	1205.0	1187.6
55°	1185.2	1170.1	1140.3	1110.4	1098.0
57.5°	1088.0	1075.6	1043.1	1013.3	1003.2
60°	990.8	981.0	946.2	918.7	911.3
62.5°	896.2	878.8	853.9	829.1	819.1
65°	799.3	784.3	759.4	736.9	724.5
67.5°	699.7	687.0	664.8	647.4	637.3
70°	607.5	597.5	575.0	557.6	547.8
72.5°	512.9	502.9	490.5	473.1	465.7
75°	418.1	413.4	400.7	385.9	390.9
77.5°	333.6	323.6	318.5	311.2	303.8
80°	249.1	246.4	241.4	234.0	229.0
82.5°	169.3	169.3	166.9	156.9	156.9
85°	101.9	99.6	97.1	89.5	87.2
87.5°	44.9	39.9	34.8	27.5	24.8
90°	2.2	26.6	72.5	68.1	70.3
92.5°	45.9	62.2	64.4	66.7	66.7
95°	108.0	128.8	132.5	132.5	128.8
97.5°	179.9	199.1	207.3	207.3	207.3
100°	262.7	279.8	285.7	285.7	283.5
102.5°	350.1	362.6	370.8	373.1	370.8
105°	445.6	451.5	455.9	459.7	459.7
107.5°	540.3	549.2	549.2	550.7	540.3
110°	632.1	644.0	644.0	644.0	638.0

TEST NUMBER: P911740

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	731.3	743.9	741.7	735.7	731.3
115°	829.0	840.8	837.2	835.0	829.0
117.5°	925.9	942.2	931.9	925.9	920.0
120°	1023.6	1039.9	1023.6	1023.6	1017.0
122.5°	1112.4	1133.2	1122.9	1116.9	1112.4
125°	1205.7	1224.2	1218.3	1211.7	1209.5
127.5°	1296.8	1319.7	1311.6	1302.7	1296.8
130°	1381.9	1408.5	1404.9	1400.4	1392.2
132.5°	1477.4	1498.1	1499.6	1489.3	1483.3
135°	1559.6	1582.4	1587.0	1584.7	1578.8
137.5°	1651.3	1669.8	1673.5	1672.0	1663.2
140°	1732.0	1750.6	1760.9	1760.9	1752.8
142.5°	1814.9	1833.4	1839.3	1841.5	1833.4
145°	1893.4	1908.1	1920.0	1922.2	1914.1
147.5°	1963.7	1982.2	1991.1	1994.8	1986.7
150°	2036.2	2048.8	2057.0	2063.6	2057.0
152.5°	2100.6	2113.2	2123.5	2131.7	2123.5
155°	2165.0	2170.9	2177.6	2187.9	2181.3
157.5°	2220.6	2225.0	2228.6	2243.5	2233.1
160°	2270.1	2274.6	2276.8	2289.3	2280.4
162.5°	2316.0	2316.0	2318.3	2332.2	2321.9
165°	2355.2	2353.0	2353.0	2367.8	2357.4
167.5°	2390.8	2384.1	2384.1	2398.9	2388.6
170°	2417.4	2411.5	2409.3	2424.1	2411.5
172.5°	2435.9	2429.9	2427.7	2442.6	2429.9
175°	2450.7	2444.8	2440.4	2455.1	2442.6
177.5°	2458.9	2452.9	2448.5	2461.1	2448.5
180°	2455.1	2455.1	2455.1	2455.1	2455.1

TEST NUMBER: P911740

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.10	13.96	14.07	14.94	16.22	12.66	13.51	13.63	14.49	15.78
	3H	14.75	15.51	15.72	16.50	17.81	14.26	15.02	15.23	16.01	17.32
	4H	15.32	16.04	16.31	17.04	18.35	14.83	15.55	15.82	16.54	17.86
	6H	15.70	16.37	16.70	17.37	18.70	15.20	15.87	16.21	16.87	18.20
	8H	15.80	16.44	16.81	17.45	18.78	15.30	15.93	16.31	16.95	18.27
	12H	15.84	16.45	16.85	17.45	18.80	15.33	15.94	16.35	16.95	18.30
4H	2H	13.55	14.28	14.55	15.27	16.59	13.20	13.92	14.19	14.92	16.23
	3H	15.40	16.00	16.40	17.02	18.35	14.99	15.59	15.99	16.61	17.94
	4H	16.09	16.65	17.11	17.66	19.01	15.67	16.22	16.68	17.24	18.59
	6H	16.59	17.07	17.61	18.10	19.45	16.16	16.63	17.18	17.67	19.02
	8H	16.73	17.18	17.76	18.21	19.57	16.29	16.74	17.32	17.77	19.13
	12H	16.79	17.20	17.84	18.24	19.61	16.35	16.75	17.39	17.79	19.16
8H	4H	16.28	16.72	17.30	17.75	19.12	15.90	16.35	16.93	17.38	18.74
	6H	16.89	17.25	17.94	18.33	19.69	16.50	16.87	17.55	17.94	19.30
	8H	17.09	17.42	18.15	18.47	19.86	16.70	17.02	17.76	18.08	19.46
	12H	17.21	17.50	18.27	18.55	19.97	16.80	17.09	17.86	18.14	19.56
12H	4H	16.26	16.66	17.31	17.71	19.08	15.89	16.29	16.94	17.34	18.71
	6H	16.91	17.23	17.97	18.29	19.67	16.54	16.86	17.59	17.92	19.30
	8H	17.14	17.42	18.20	18.47	19.90	16.76	17.04	17.82	18.09	19.52