

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917172

Luminaire Tested: DFN2DIP-SQ2F0-050D070US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917172
REPORT IS A COMBINATION OF REPORTS P899823 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D070US930-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9086.5 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 98.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917172

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US930-FLLFLL

Luminous Intensity Polar Plot

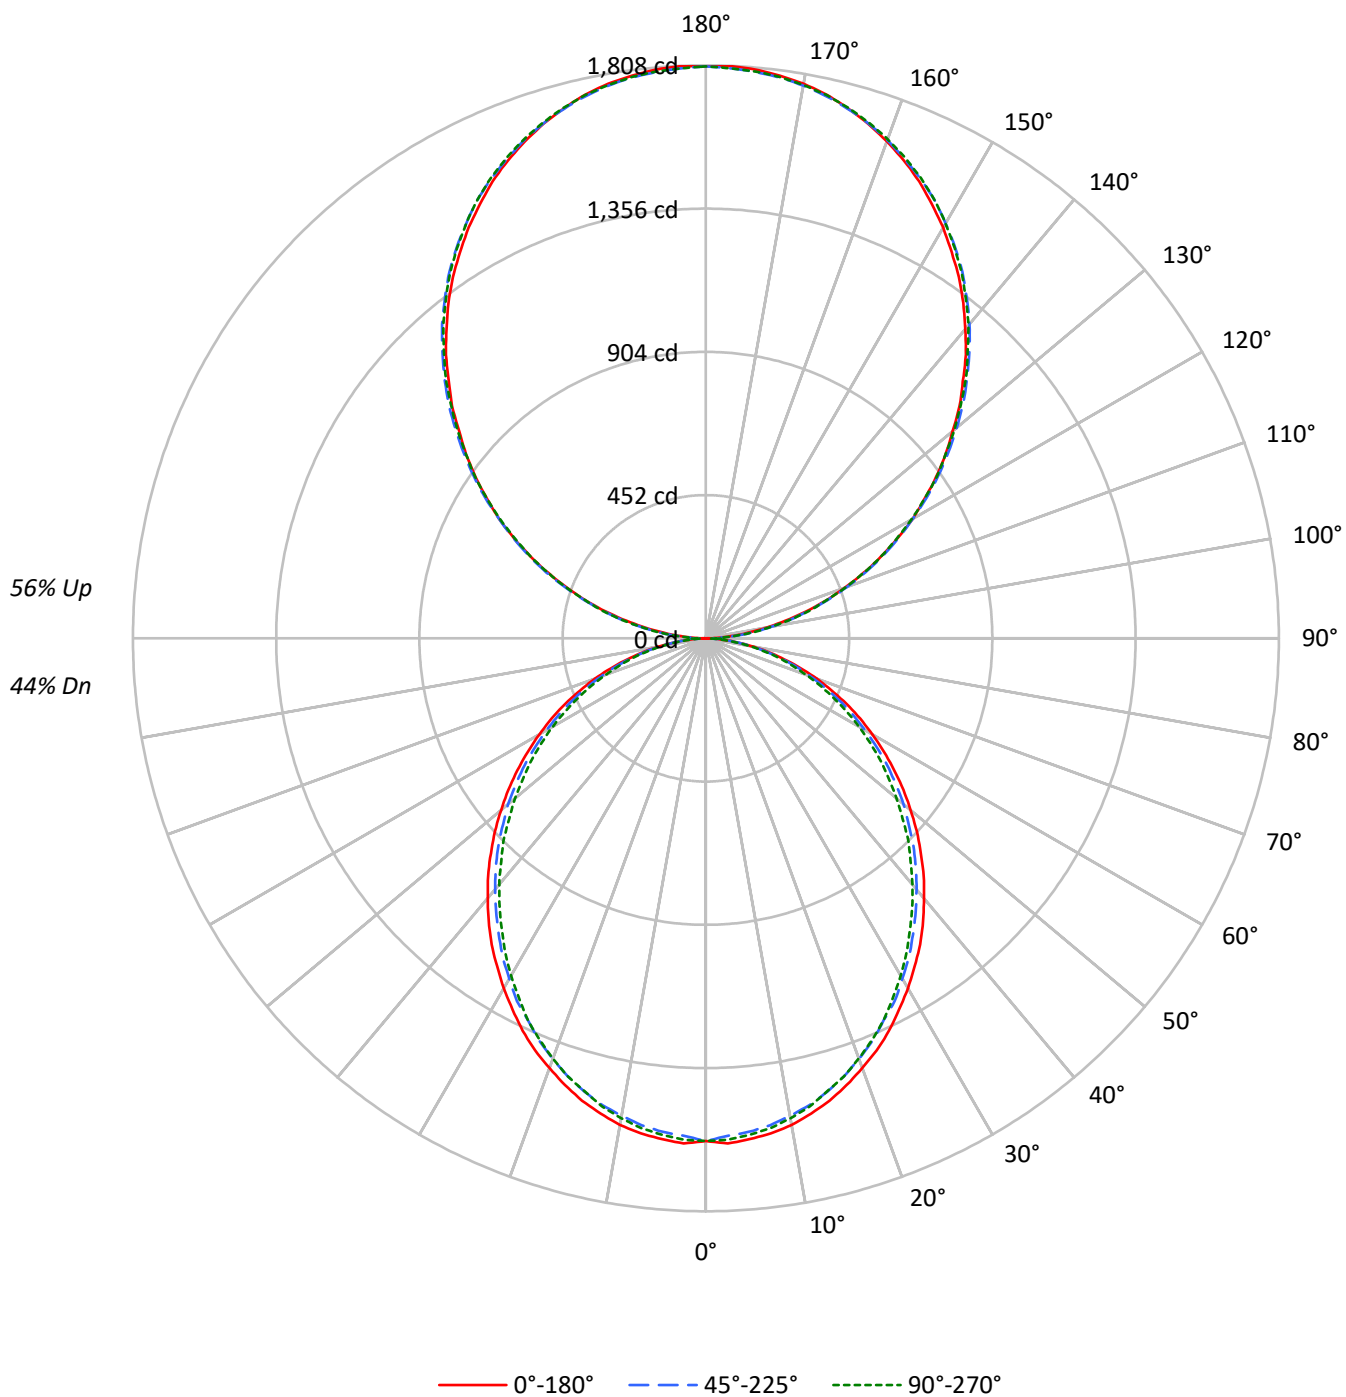

TEST NUMBER: P917172

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	45	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	24	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3488	3488	3488
5°	3487	3431	3458
10°	3453	3378	3406
15°	3396	3315	3328
20°	3322	3230	3248
25°	3247	3130	3157
30°	3155	3037	3042
35°	3068	2928	2921
40°	2961	2817	2805
45°	2854	2706	2686
50°	2738	2589	2550
55°	2615	2454	2423
60°	2476	2295	2277
65°	2323	2129	2105
70°	2129	1927	1920
75°	1862	1684	1741
80°	1538	1375	1414
85°	1040	867	888

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2854 cd/sqm

TEST NUMBER: P917172

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	149.3	1.6
10°-20°	420.0	4.6
20°-30°	617.3	6.8
30°-40°	717.0	7.9
40°-50°	716.1	7.9
50°-60°	624.4	6.9
60°-70°	461.6	5.1
70°-80°	261.1	2.9
80°-90°	74.0	0.8
90°-100°	111.7	1.2
100°-110°	354.9	3.9
110°-120°	607.3	6.7
120°-130°	798.7	8.8
130°-140°	896.5	9.9
140°-150°	879.1	9.7
150°-160°	737.5	8.1
160°-170°	489.1	5.4
170°-180°	170.9	1.9
0°-30°	1186.6	13.1
0°-40°	1903.6	20.9
0°-60°	3244.1	35.7
0°-90°	4040.8	44.5
90°-120°	1073.9	11.8
90°-150°	3648.2	40.1
90°-180°	5046.0	55.5
0°-180°	9086.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1586	1586	1586	1586	1586	
5°	1586	1580	1563	1576	1573	151
15°	1510	1501	1481	1487	1480	425
25°	1367	1354	1328	1332	1328	629
35°	1179	1164	1139	1130	1123	736
45°	959	949	926	909	903	740
55°	726	717	698	680	673	649
65°	490	480	465	452	444	484
75°	256	253	246	236	240	273
85°	62	61	60	55	53	70
90°	2	20	53	50	52	9
95°	79	95	97	97	95	88
105°	328	332	335	338	338	346
115°	609	618	616	614	609	603
125°	886	900	896	891	889	792
135°	1147	1163	1167	1165	1161	886
145°	1392	1403	1412	1413	1407	870
155°	1592	1596	1601	1608	1604	733
165°	1731	1730	1730	1741	1733	488
175°	1802	1797	1794	1805	1796	171
180°	1805	1805	1805	1805	1805	

TEST NUMBER: P917172

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1586.2	1586.2	1586.2	1586.2	1586.2
2.5°	1595.4	1587.8	1571.0	1586.2	1583.3
5°	1586.2	1580.2	1563.3	1575.5	1572.6
7.5°	1575.5	1566.4	1549.6	1561.9	1558.9
10°	1558.9	1548.2	1529.9	1542.0	1537.5
12.5°	1535.9	1526.8	1508.5	1516.1	1513.0
15°	1509.9	1500.9	1481.0	1487.2	1479.5
17.5°	1477.9	1468.8	1448.9	1456.5	1448.9
20°	1442.8	1433.8	1412.4	1416.9	1411.0
22.5°	1407.9	1394.1	1374.2	1374.2	1371.1
25°	1366.6	1354.5	1328.5	1331.5	1328.5
27.5°	1320.8	1310.1	1290.4	1285.8	1278.2
30°	1275.1	1262.9	1240.1	1235.5	1229.4
32.5°	1226.3	1217.2	1192.8	1183.6	1177.5
35°	1179.0	1163.8	1139.4	1130.2	1122.6
37.5°	1125.6	1111.9	1087.4	1076.8	1069.2
40°	1070.8	1058.5	1034.0	1020.4	1014.3
42.5°	1017.4	1005.1	980.8	965.4	956.3
45°	959.4	948.8	925.8	909.1	902.9
47.5°	902.9	892.3	867.9	851.0	842.0
50°	843.4	835.8	814.5	793.1	785.5
52.5°	785.5	774.8	755.0	738.3	727.6
55°	726.1	716.9	698.5	680.3	672.7
57.5°	666.5	658.9	639.0	620.8	614.6
60°	607.0	601.0	579.7	562.8	558.3
62.5°	549.1	538.4	523.2	507.9	501.8
65°	489.7	480.5	465.2	451.5	443.8
67.5°	428.7	420.9	407.3	396.6	390.4
70°	372.2	366.1	352.3	341.6	335.7
72.5°	314.3	308.1	300.5	289.8	285.3
75°	256.2	253.2	245.5	236.4	239.5
77.5°	204.4	198.2	195.2	190.6	186.1
80°	152.6	151.0	147.9	143.4	140.3
82.5°	103.7	103.7	102.2	96.1	96.1
85°	62.5	61.0	59.5	54.9	53.4
87.5°	27.5	24.5	21.4	16.8	15.2
90°	1.6	19.6	53.3	50.1	51.7
92.5°	33.8	45.7	47.4	49.0	49.0
95°	79.4	94.7	97.4	97.4	94.7
97.5°	132.2	146.3	152.4	152.4	152.4
100°	193.1	205.7	210.0	210.0	208.4
102.5°	257.4	266.6	272.6	274.3	272.6
105°	327.6	331.9	335.2	337.9	337.9
107.5°	397.2	403.7	403.7	404.9	397.2
110°	464.7	473.4	473.4	473.4	469.0

TEST NUMBER: P917172

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	537.6	546.9	545.3	540.9	537.6
115°	609.4	618.2	615.5	613.8	609.4
117.5°	680.7	692.7	685.1	680.7	676.4
120°	752.5	764.5	752.5	752.5	747.6
122.5°	817.8	833.1	825.5	821.1	817.8
125°	886.4	900.0	895.7	890.8	889.2
127.5°	953.3	970.2	964.3	957.7	953.3
130°	1015.9	1035.5	1032.8	1029.6	1023.5
132.5°	1086.1	1101.4	1102.4	1094.9	1090.5
135°	1146.6	1163.3	1166.7	1165.0	1160.7
137.5°	1214.0	1227.6	1230.3	1229.2	1222.7
140°	1273.3	1286.9	1294.5	1294.5	1288.6
142.5°	1334.2	1347.9	1352.2	1353.8	1347.9
145°	1392.0	1402.8	1411.5	1413.2	1407.2
147.5°	1443.6	1457.3	1463.8	1466.5	1460.5
150°	1497.0	1506.2	1512.2	1517.1	1512.2
152.5°	1544.3	1553.6	1561.1	1567.2	1561.1
155°	1591.6	1595.9	1600.9	1608.5	1603.6
157.5°	1632.5	1635.7	1638.4	1649.3	1641.7
160°	1668.9	1672.2	1673.8	1683.0	1676.5
162.5°	1702.7	1702.7	1704.3	1714.6	1707.0
165°	1731.4	1729.8	1729.8	1740.7	1733.1
167.5°	1757.6	1752.7	1752.7	1763.6	1756.0
170°	1777.2	1772.9	1771.2	1782.1	1772.9
172.5°	1790.8	1786.4	1784.8	1795.7	1786.4
175°	1801.6	1797.3	1794.1	1804.9	1795.7
177.5°	1807.7	1803.3	1800.0	1809.3	1800.0
180°	1804.9	1804.9	1804.9	1804.9	1804.9

TEST NUMBER: P917172

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.96	11.78	11.96	12.79	14.14	10.52	11.33	11.52	12.35	13.69
	3H	12.60	13.33	13.61	14.35	15.72	12.11	12.84	13.12	13.86	15.23
	4H	13.17	13.86	14.20	14.89	16.26	12.68	13.37	13.70	14.39	15.77
	6H	13.55	14.19	14.59	15.22	16.61	13.05	13.69	14.09	14.72	16.11
	8H	13.65	14.26	14.69	15.30	16.69	13.15	13.75	14.19	14.80	16.19
	12H	13.69	14.27	14.74	15.31	16.71	13.18	13.76	14.23	14.80	16.21
4H	2H	11.41	12.10	12.44	13.12	14.50	11.05	11.74	12.08	12.77	14.14
	3H	13.24	13.82	14.29	14.88	16.26	12.84	13.41	13.88	14.47	15.86
	4H	13.94	14.47	14.99	15.52	16.93	13.52	14.05	14.57	15.09	16.50
	6H	14.44	14.89	15.49	15.96	17.37	14.00	14.46	15.06	15.53	16.93
	8H	14.57	15.00	15.63	16.06	17.48	14.14	14.56	15.20	15.62	17.05
	12H	14.64	15.02	15.71	16.10	17.52	14.19	14.57	15.26	15.65	17.07
8H	4H	14.12	14.55	15.18	15.61	17.03	13.74	14.17	14.80	15.23	16.65
	6H	14.73	15.08	15.81	16.18	17.60	14.34	14.69	15.42	15.80	17.22
	8H	14.93	15.24	16.02	16.33	17.77	14.54	14.85	15.63	15.94	17.38
	12H	15.05	15.32	16.14	16.40	17.88	14.64	14.91	15.73	15.99	17.47
12H	4H	14.10	14.49	15.18	15.56	16.99	13.73	14.12	14.81	15.19	16.62
	6H	14.75	15.06	15.84	16.15	17.59	14.38	14.69	15.47	15.77	17.21
	8H	14.98	15.25	16.07	16.33	17.81	14.60	14.87	15.69	15.95	17.43

END OF REPORT