

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919862

Luminaire Tested: DFN2DIP-SQ2F0-040D030US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919862
REPORT IS A COMBINATION OF REPORTS P899774 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D030US935-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5213.3 lumens
Efficiency: N/A
Efficacy: 92.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 56.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919862

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US935-RLLFLL

Luminous Intensity Polar Plot

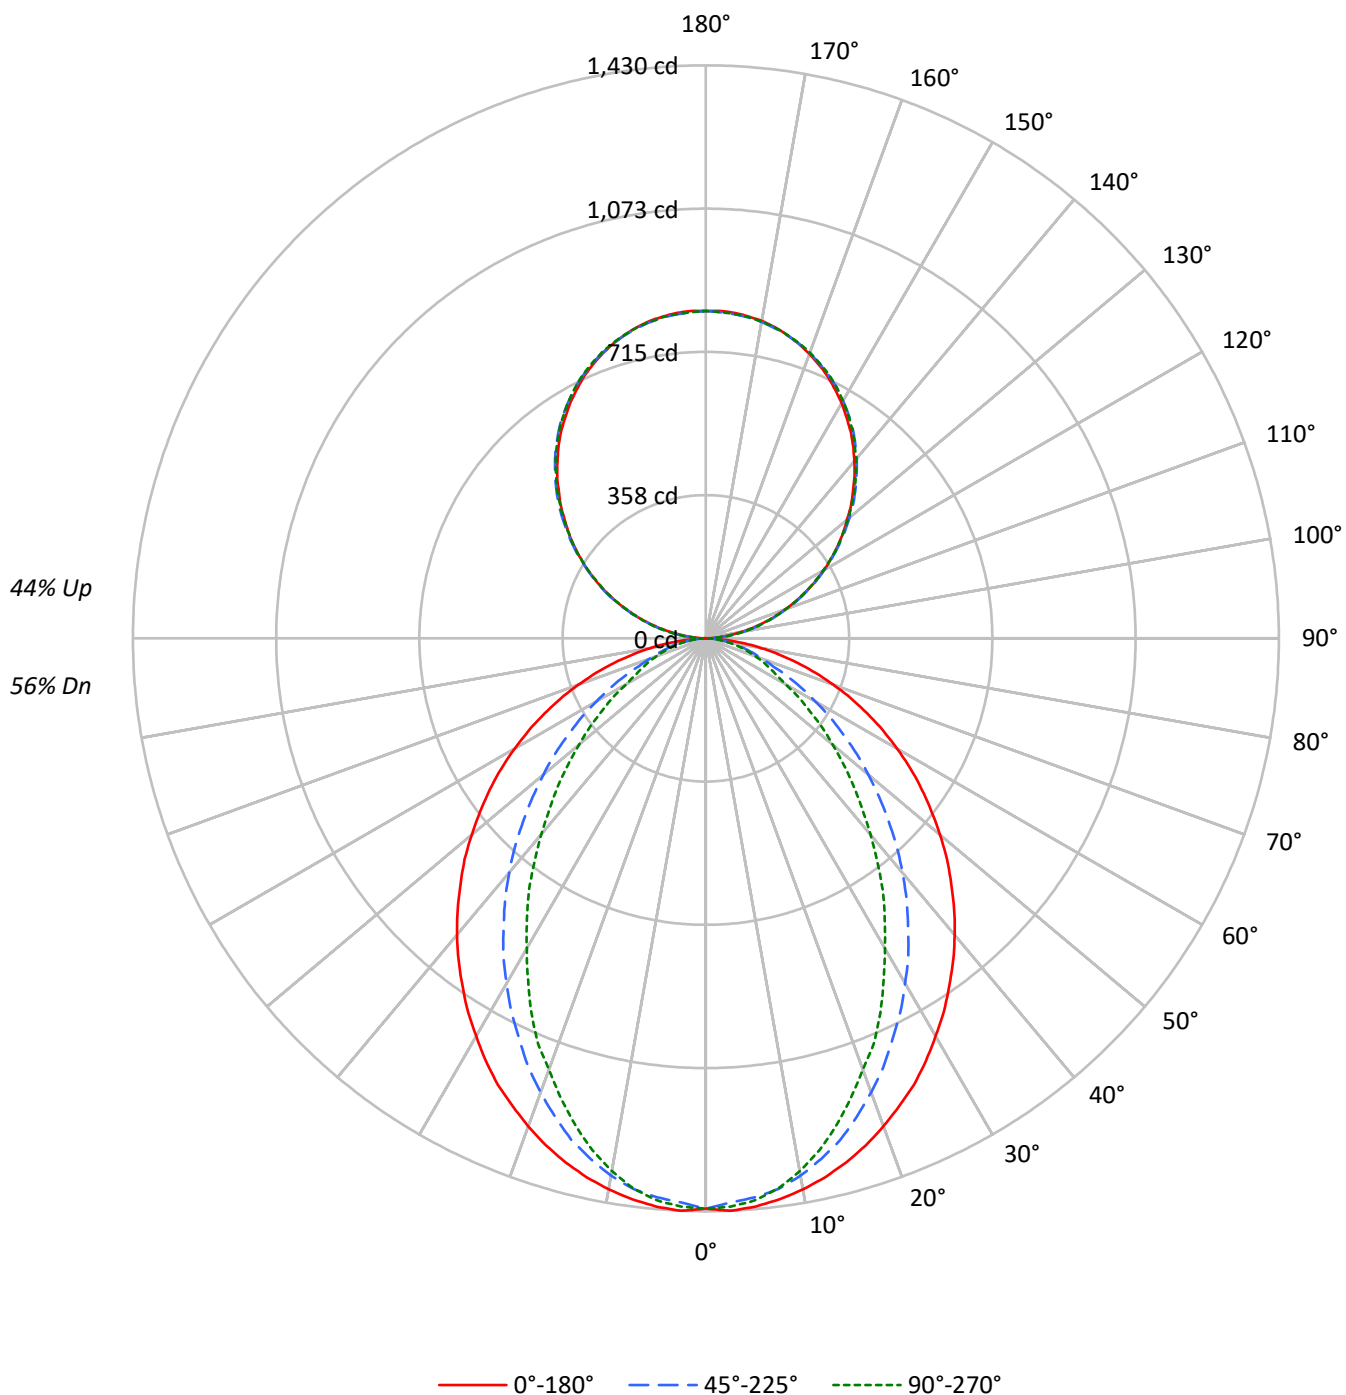

TEST NUMBER: P919862

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	55	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	49	47	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	30
6	65	53	46	40	61	50	43	38	44	38	34	38	34	31	33	30	27
7	61	48	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3130	3130	3130
5°	3129	3073	3096
10°	3093	3006	2990
15°	3045	2900	2831
20°	2983	2757	2636
25°	2920	2598	2448
30°	2837	2435	2212
35°	2755	2261	2004
40°	2672	2081	1767
45°	2575	1883	1552
50°	2475	1683	1342
55°	2370	1471	1141
60°	2248	1250	936
65°	2108	1025	837
70°	1938	817	751
75°	1722	707	675
80°	1414	573	571
85°	922	357	408

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2575 cd/sqm

TEST NUMBER: P919862

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	133.4	2.6
10°-20°	366.2	7.0
20°-30°	514.2	9.9
30°-40°	560.5	10.8
40°-50°	515.1	9.9
50°-60°	404.5	7.8
60°-70°	263.3	5.1
70°-80°	135.6	2.6
80°-90°	36.9	0.7
90°-100°	50.6	1.0
100°-110°	160.6	3.1
110°-120°	274.9	5.3
120°-130°	361.5	6.9
130°-140°	405.7	7.8
140°-150°	397.9	7.6
150°-160°	333.8	6.4
160°-170°	221.3	4.2
170°-180°	77.4	1.5
0°-30°	1013.8	19.4
0°-40°	1574.2	30.2
0°-60°	2493.9	47.8
0°-90°	2929.7	56.2
90°-120°	486.0	9.3
90°-150°	1651.1	31.7
90°-180°	2284.0	43.8
0°-180°	5213.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1423	1423	1423	1423	1423	
5°	1423	1417	1400	1412	1408	135
15°	1354	1340	1296	1271	1259	382
25°	1229	1188	1103	1050	1030	565
35°	1059	993	880	799	770	663
45°	866	779	644	553	522	668
55°	658	558	419	341	317	588
65°	444	340	224	180	176	441
75°	237	147	103	94	93	251
85°	55	28	24	24	24	64
90°	1	9	24	23	23	5
95°	36	43	44	44	43	40
105°	148	150	152	153	153	156
115°	276	280	278	278	276	273
125°	401	407	405	403	402	358
135°	519	526	528	527	525	401
145°	630	635	639	640	637	394
155°	720	722	724	728	726	332
165°	784	783	783	788	784	221
175°	816	814	812	817	813	77
180°	817	817	817	817	817	

TEST NUMBER: P919862

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1423.4	1423.4	1423.4	1423.4	1423.4
2.5°	1429.9	1423.4	1409.2	1422.2	1419.5
5°	1423.4	1416.9	1400.2	1411.8	1408.0
7.5°	1411.8	1404.1	1386.1	1391.1	1384.7
10°	1396.4	1387.3	1361.6	1357.6	1350.0
12.5°	1377.1	1365.5	1330.6	1322.9	1308.7
15°	1353.8	1339.6	1295.9	1271.4	1258.6
17.5°	1326.8	1306.1	1252.0	1223.7	1203.1
20°	1295.9	1270.1	1205.7	1173.5	1145.1
22.5°	1262.4	1232.8	1158.0	1114.2	1095.0
25°	1228.9	1187.7	1102.6	1049.9	1030.4
27.5°	1189.0	1145.1	1051.1	990.6	960.9
30°	1146.5	1097.4	994.4	928.8	894.0
32.5°	1105.3	1045.9	940.4	863.1	830.8
35°	1058.9	993.2	879.9	798.7	770.2
37.5°	1013.8	942.9	823.1	734.2	702.1
40°	966.1	888.9	763.9	672.4	638.9
42.5°	917.1	834.7	704.6	609.2	577.1
45°	865.6	779.3	644.1	552.6	521.7
47.5°	816.7	725.3	586.2	494.6	466.3
50°	762.6	671.1	529.4	440.5	413.5
52.5°	709.7	613.1	475.4	390.3	365.8
55°	658.2	557.8	418.6	341.4	316.9
57.5°	605.5	502.4	368.4	296.3	275.7
60°	551.3	448.2	315.6	249.9	229.4
62.5°	498.6	395.5	270.4	208.7	198.5
65°	444.4	340.0	224.1	180.4	176.4
67.5°	393.0	288.5	180.4	158.4	154.5
70°	338.8	238.3	149.4	136.6	131.3
72.5°	287.3	191.9	124.9	114.7	112.1
75°	236.9	146.8	103.1	94.0	92.8
77.5°	186.8	104.3	81.2	76.0	73.4
80°	140.3	74.7	61.7	56.7	56.7
82.5°	97.9	50.3	42.5	39.9	39.9
85°	55.4	28.3	24.5	24.5	24.5
87.5°	20.7	10.2	10.2	9.0	9.0
90°	0.8	8.9	24.1	22.6	23.4
92.5°	15.2	20.7	21.4	22.1	22.1
95°	36.0	42.9	44.1	44.1	42.9
97.5°	59.8	66.2	69.0	69.0	69.0
100°	87.4	93.1	95.1	95.1	94.4
102.5°	116.5	120.7	123.4	124.2	123.4
105°	148.3	150.2	151.7	152.9	152.9
107.5°	179.8	182.7	182.7	183.2	179.8
110°	210.3	214.3	214.3	214.3	212.3

TEST NUMBER: P919862

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	243.3	247.5	246.8	244.8	243.3
115°	275.9	279.7	278.5	277.8	275.9
117.5°	308.1	313.5	310.0	308.1	306.1
120°	340.6	346.0	340.6	340.6	338.4
122.5°	370.1	377.0	373.6	371.6	370.1
125°	401.2	407.3	405.4	403.1	402.4
127.5°	431.4	439.1	436.4	433.4	431.4
130°	459.8	468.6	467.4	466.0	463.2
132.5°	491.5	498.4	498.9	495.5	493.5
135°	518.9	526.5	528.0	527.3	525.3
137.5°	549.4	555.6	556.8	556.4	553.4
140°	576.3	582.5	585.9	585.9	583.2
142.5°	603.9	610.0	612.0	612.8	610.0
145°	630.0	634.9	638.9	639.5	636.9
147.5°	653.4	659.5	662.5	663.7	661.0
150°	677.5	681.7	684.4	686.6	684.4
152.5°	699.0	703.1	706.5	709.3	706.5
155°	720.4	722.3	724.5	728.0	725.8
157.5°	738.8	740.3	741.6	746.5	743.0
160°	755.4	756.8	757.6	761.7	758.8
162.5°	770.6	770.6	771.4	776.0	772.6
165°	783.7	782.9	782.9	787.8	784.4
167.5°	795.5	793.2	793.2	798.1	794.7
170°	804.3	802.4	801.7	806.6	802.4
172.5°	810.5	808.6	807.8	812.7	808.6
175°	815.5	813.5	812.0	816.9	812.7
177.5°	818.1	816.1	814.7	818.9	814.7
180°	816.9	816.9	816.9	816.9	816.9

TEST NUMBER: P919862

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.56	12.44	12.46	13.36	14.54	7.52	8.40	8.43	9.32	10.51
	3H	13.22	14.01	14.14	14.94	16.15	8.69	9.48	9.61	10.41	11.62
	4H	13.82	14.56	14.75	15.50	16.72	9.13	9.88	10.07	10.81	12.03
	6H	14.22	14.91	15.17	15.85	17.08	9.44	10.12	10.39	11.07	12.30
	8H	14.34	15.00	15.30	15.96	17.18	9.52	10.17	10.48	11.14	12.36
	12H	14.40	15.02	15.36	15.97	17.23	9.56	10.18	10.52	11.13	12.39
4H	2H	11.58	12.32	12.52	13.26	14.48	8.11	8.85	9.05	9.79	11.01
	3H	13.39	14.01	14.34	14.98	16.21	9.44	10.06	10.39	11.03	12.26
	4H	14.07	14.63	15.03	15.59	16.85	9.98	10.54	10.94	11.50	12.76
	6H	14.56	15.05	15.54	16.04	17.29	10.38	10.86	11.35	11.85	13.11
	8H	14.73	15.18	15.71	16.16	17.43	10.50	10.95	11.47	11.93	13.20
	12H	14.82	15.23	15.81	16.22	17.50	10.55	10.96	11.55	11.96	13.23
8H	4H	14.03	14.49	15.01	15.47	16.74	10.25	10.70	11.22	11.68	12.95
	6H	14.58	14.95	15.58	15.98	17.24	10.74	11.12	11.74	12.14	13.41
	8H	14.78	15.11	15.79	16.12	17.41	10.92	11.25	11.93	12.26	13.55
	12H	14.91	15.20	15.92	16.20	17.54	11.03	11.32	12.04	12.32	13.65
12H	4H	13.99	14.40	14.98	15.39	16.67	10.25	10.66	11.25	11.66	12.93
	6H	14.55	14.88	15.56	15.89	17.18	10.79	11.12	11.80	12.13	13.41
	8H	14.76	15.05	15.77	16.06	17.39	10.98	11.28	12.00	12.28	13.61

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

8 of 8