

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919897

Luminaire Tested: DFN2DIP-SQ2F0-050D060US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919897
REPORT IS A COMBINATION OF REPORTS P901331 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D060US935-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9376.3 lumens
Efficiency: N/A
Efficacy: 104.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919897

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US935-FLLONL

Luminous Intensity Polar Plot

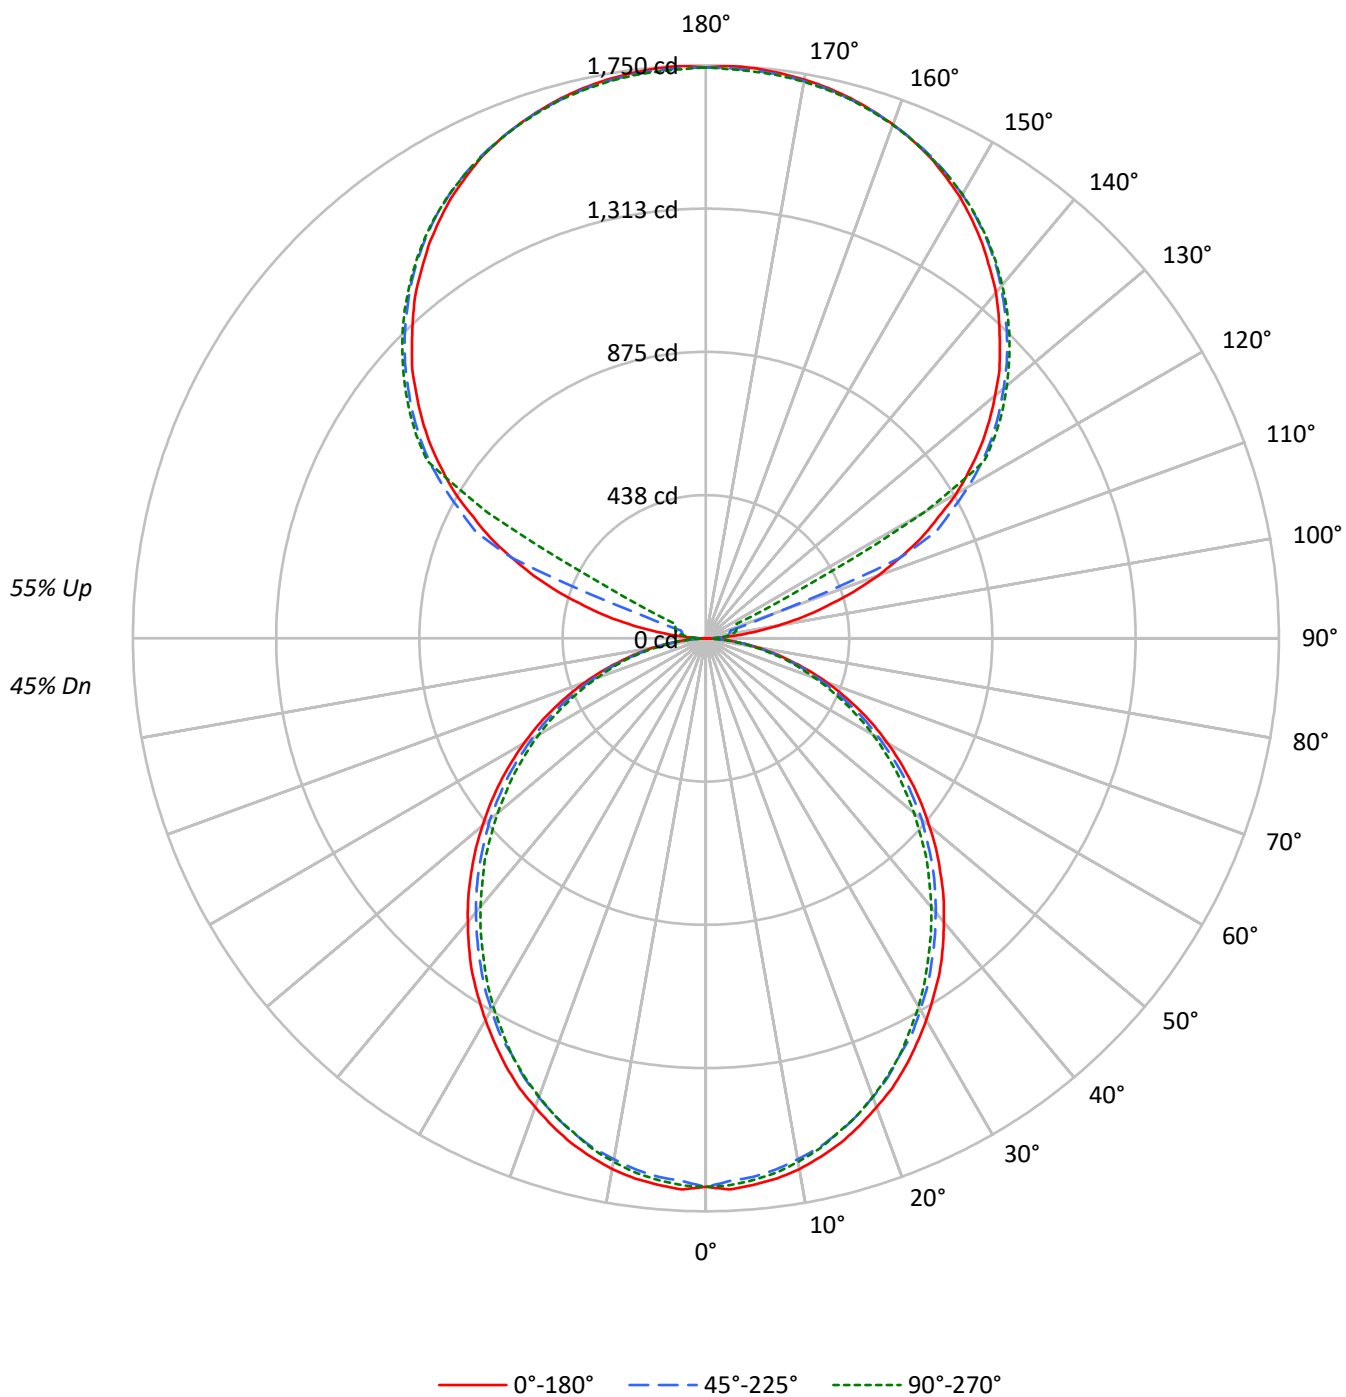

TEST NUMBER: P919897

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	92	89	85	89	85	82	79	71	68	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	33	31
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	43	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	32	28	25	26	23	21
7	57	45	37	32	53	42	35	30	35	30	26	30	25	22	24	21	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3683	3683	3683
5°	3683	3624	3651
10°	3647	3567	3597
15°	3587	3500	3514
20°	3508	3411	3430
25°	3429	3305	3334
30°	3332	3207	3213
35°	3240	3091	3085
40°	3127	2975	2962
45°	3015	2858	2837
50°	2891	2734	2693
55°	2761	2592	2558
60°	2614	2424	2405
65°	2453	2248	2223
70°	2248	2034	2027
75°	1966	1778	1839
80°	1625	1452	1494
85°	1098	917	938

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3015 cd/sqm

TEST NUMBER: P919897

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.7	1.7
10°-20°	443.6	4.7
20°-30°	651.9	7.0
30°-40°	757.2	8.1
40°-50°	756.2	8.1
50°-60°	659.4	7.0
60°-70°	487.4	5.2
70°-80°	275.8	2.9
80°-90°	75.8	0.8
90°-100°	57.5	0.6
100°-110°	214.3	2.3
110°-120°	568.4	6.1
120°-130°	942.7	10.1
130°-140°	1001.4	10.7
140°-150°	930.7	9.9
150°-160°	748.2	8.0
160°-170°	482.1	5.1
170°-180°	165.9	1.8
0°-30°	1253.2	13.4
0°-40°	2010.3	21.4
0°-60°	3425.9	36.5
0°-90°	4265.0	45.5
90°-120°	840.2	9.0
90°-150°	3714.9	39.6
90°-180°	5111.0	54.5
0°-180°	9376.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1675	1675	1675	1675	1675	
5°	1675	1669	1651	1664	1661	159
15°	1595	1585	1564	1570	1562	449
25°	1443	1430	1403	1406	1403	664
35°	1245	1229	1203	1194	1186	778
45°	1013	1002	978	960	954	782
55°	767	757	738	718	710	686
65°	517	507	491	477	469	511
75°	270	267	259	250	253	289
85°	66	64	63	58	56	74
90°	1	15	25	32	34	9
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P919897

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1675.1	1675.1	1675.1	1675.1	1675.1
2.5°	1684.8	1676.8	1659.1	1675.1	1672.1
5°	1675.1	1668.8	1651.0	1663.8	1660.8
7.5°	1663.8	1654.2	1636.5	1649.5	1646.2
10°	1646.2	1634.9	1615.7	1628.4	1623.7
12.5°	1621.9	1612.4	1593.1	1601.1	1597.8
15°	1594.6	1585.0	1564.0	1570.5	1562.5
17.5°	1560.7	1551.2	1530.2	1538.2	1530.2
20°	1523.7	1514.2	1491.6	1496.3	1490.0
22.5°	1486.8	1472.2	1451.2	1451.2	1447.9
25°	1443.2	1430.4	1403.0	1406.1	1403.0
27.5°	1394.8	1383.5	1362.7	1357.9	1349.9
30°	1346.6	1333.7	1309.6	1304.8	1298.3
32.5°	1295.0	1285.5	1259.6	1249.9	1243.5
35°	1245.1	1229.1	1203.2	1193.5	1185.5
37.5°	1188.7	1174.2	1148.4	1137.1	1129.1
40°	1130.8	1117.8	1092.0	1077.6	1071.2
42.5°	1074.4	1061.4	1035.8	1019.5	1010.0
45°	1013.2	1001.9	977.7	960.1	953.6
47.5°	953.6	942.3	916.5	898.7	889.2
50°	890.7	882.7	860.1	837.6	829.5
52.5°	829.5	818.2	797.4	779.6	768.4
55°	766.8	757.1	737.7	718.4	710.4
57.5°	703.9	695.9	674.9	655.6	649.0
60°	641.0	634.7	612.2	594.3	589.6
62.5°	579.9	568.6	552.5	536.4	529.9
65°	517.1	507.4	491.3	476.8	468.7
67.5°	452.7	444.5	430.2	418.9	412.3
70°	393.0	386.6	372.0	360.8	354.5
72.5°	331.9	325.4	317.4	306.1	301.3
75°	270.5	267.4	259.2	249.7	253.0
77.5°	215.9	209.3	206.1	201.3	196.6
80°	161.2	159.5	156.2	151.4	148.2
82.5°	109.5	109.5	108.0	101.5	101.5
85°	66.0	64.4	62.9	57.9	56.4
87.5°	29.0	25.8	22.6	17.7	16.1
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6

TEST NUMBER: P919897

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P919897

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.25	12.08	12.25	13.08	14.42	10.81	11.63	11.81	12.64	13.97
	3H	12.89	13.63	13.90	14.65	16.00	12.40	13.14	13.41	14.16	15.51
	4H	13.47	14.16	14.48	15.18	16.55	12.97	13.67	13.99	14.69	16.05
	6H	13.85	14.49	14.88	15.51	16.89	13.35	13.99	14.38	15.02	16.39
	8H	13.94	14.56	14.98	15.60	16.97	13.44	14.06	14.48	15.10	16.47
	12H	13.98	14.57	15.02	15.60	17.00	13.48	14.06	14.52	15.09	16.49
4H	2H	11.70	12.40	12.73	13.42	14.78	11.34	12.04	12.37	13.06	14.42
	3H	13.54	14.12	14.57	15.17	16.55	13.13	13.71	14.16	14.76	16.14
	4H	14.24	14.77	15.28	15.81	17.21	13.81	14.35	14.85	15.39	16.78
	6H	14.73	15.19	15.78	16.25	17.65	14.30	14.76	15.35	15.82	17.21
	8H	14.87	15.30	15.92	16.35	17.76	14.43	14.86	15.48	15.92	17.33
	12H	14.93	15.32	16.00	16.39	17.80	14.48	14.87	15.55	15.94	17.36
8H	4H	14.42	14.85	15.47	15.90	17.31	14.04	14.47	15.09	15.52	16.93
	6H	15.02	15.38	16.10	16.48	17.88	14.64	14.99	15.71	16.09	17.50
	8H	15.23	15.54	16.31	16.62	18.05	14.84	15.15	15.92	16.23	17.66
	12H	15.35	15.62	16.43	16.70	18.16	14.94	15.21	16.02	16.29	17.75
12H	4H	14.40	14.79	15.47	15.86	17.27	14.03	14.42	15.10	15.49	16.90
	6H	15.05	15.36	16.13	16.44	17.87	14.68	14.99	15.76	16.07	17.49
	8H	15.27	15.55	16.36	16.62	18.09	14.89	15.17	15.98	16.24	17.71

END OF REPORT