

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903775

Luminaire Tested: DFN2DIP-SQ3F0-080D080US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903775
REPORT IS A COMBINATION OF REPORTS P901462 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D080US830-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13874.3 lumens
Efficiency: N/A
Efficacy: 101.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 136.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903775

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-RLLONL

Luminous Intensity Polar Plot

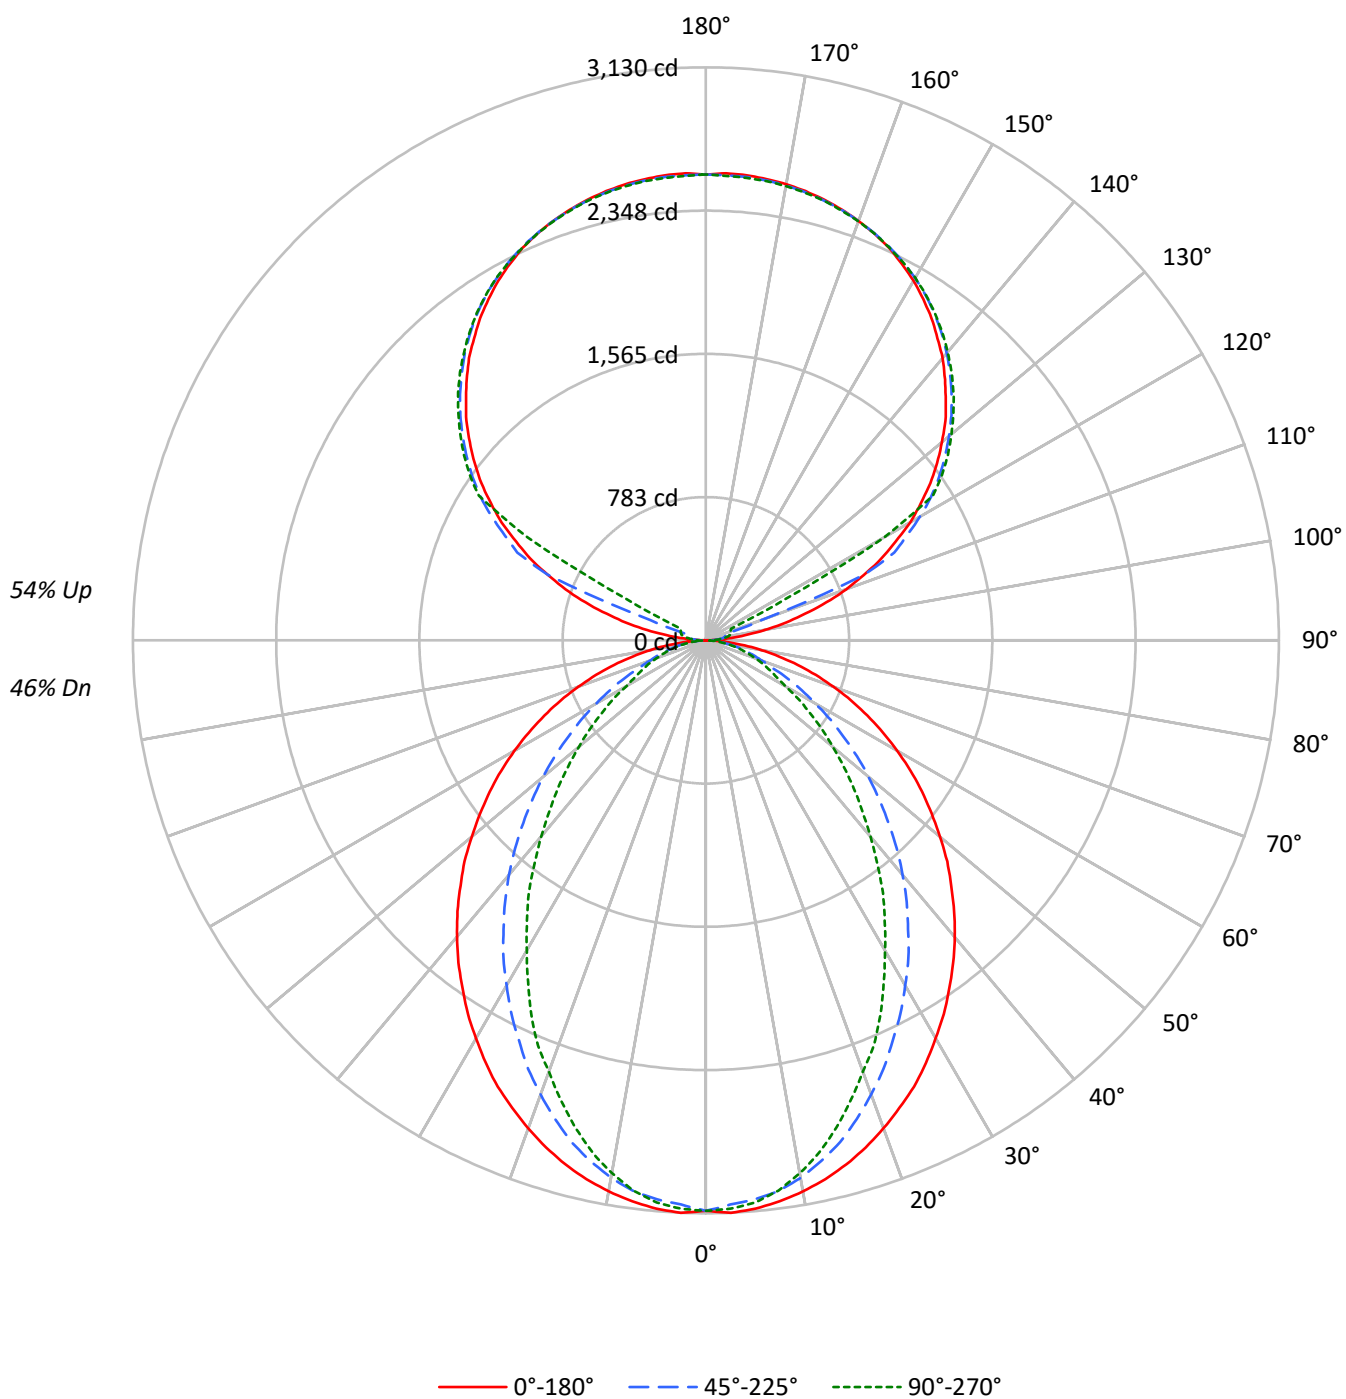

TEST NUMBER: P903775

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53	46		
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45	40		
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39	34		
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34	29		
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29	26		
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26	23		
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23	20		
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21	18		
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19	16		
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17	15		
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15	13		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3571	3571	3571
5°	3574	3512	3535
10°	3537	3441	3419
15°	3486	3324	3240
20°	3419	3166	3021
25°	3351	2988	2810
30°	3260	2806	2542
35°	3170	2610	2306
40°	3080	2408	2036
45°	2974	2184	1792
50°	2865	1959	1554
55°	2751	1718	1324
60°	2618	1466	1089
65°	2466	1211	979
70°	2281	973	884
75°	2048	852	802
80°	1711	708	691
85°	1161	460	512

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2974 cd/sqm

TEST NUMBER: P903775

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	292.1	2.1
10°-20°	801.8	5.8
20°-30°	1125.7	8.1
30°-40°	1227.1	8.8
40°-50°	1127.8	8.1
50°-60°	885.7	6.4
60°-70°	576.5	4.2
70°-80°	296.8	2.1
80°-90°	80.2	0.6
90°-100°	83.9	0.6
100°-110°	312.8	2.3
110°-120°	829.6	6.0
120°-130°	1376.0	9.9
130°-140°	1461.6	10.5
140°-150°	1358.4	9.8
150°-160°	1092.1	7.9
160°-170°	703.7	5.1
170°-180°	242.2	1.7
0°-30°	2219.6	16.0
0°-40°	3446.7	24.8
0°-60°	5460.2	39.4
0°-90°	6413.8	46.2
90°-120°	1226.4	8.8
90°-150°	5422.4	39.1
90°-180°	7460.0	53.8
0°-180°	13874.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3116	3116	3116	3116	3116	
5°	3116	3102	3066	3091	3083	296
15°	2964	2933	2837	2784	2756	835
25°	2691	2600	2414	2299	2256	1237
35°	2318	2174	1926	1749	1686	1451
45°	1895	1706	1410	1210	1142	1464
55°	1441	1221	916	747	694	1288
65°	973	744	491	395	386	965
75°	519	321	226	206	203	549
85°	121	62	54	54	54	139
90°	2	22	37	46	50	13
95°	120	59	72	81	79	142
105°	560	615	112	132	140	598
115°	1059	1090	1136	284	151	1042
125°	1497	1521	1556	1569	1574	1335
135°	1852	1882	1898	1917	1913	1431
145°	2149	2147	2178	2191	2182	1344
155°	2366	2350	2372	2383	2368	1090
165°	2493	2482	2488	2501	2488	704
175°	2550	2537	2541	2554	2536	243
180°	2545	2545	2545	2545	2545	

TEST NUMBER: P903775

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3116.4	3116.4	3116.4	3116.4	3116.4
2.5°	3130.5	3116.4	3085.3	3113.7	3108.0
5°	3116.4	3102.4	3065.5	3091.0	3082.6
7.5°	3091.0	3074.2	3034.7	3045.8	3031.7
10°	3057.1	3037.4	2981.2	2972.5	2955.7
12.5°	3015.0	2989.6	2913.2	2896.4	2865.3
15°	2964.1	2933.0	2837.2	2783.7	2755.5
17.5°	2904.8	2859.7	2741.2	2679.3	2634.0
20°	2837.2	2780.7	2639.8	2569.5	2507.2
22.5°	2763.9	2699.0	2535.3	2439.6	2397.4
25°	2690.6	2600.3	2414.1	2298.7	2256.2
27.5°	2603.2	2507.2	2301.3	2168.8	2103.8
30°	2510.2	2402.7	2177.2	2033.5	1957.2
32.5°	2419.8	2290.0	2059.0	1889.6	1819.0
35°	2318.4	2174.4	1926.4	1748.7	1686.4
37.5°	2219.6	2064.4	1802.2	1607.4	1537.1
40°	2115.3	1946.2	1672.4	1472.2	1398.8
42.5°	2008.1	1827.7	1542.8	1334.0	1263.6
45°	1895.3	1706.2	1410.2	1209.8	1142.2
47.5°	1788.2	1588.0	1283.4	1082.9	1021.0
50°	1669.6	1469.5	1159.2	964.4	905.4
52.5°	1553.9	1342.3	1040.7	854.6	801.1
55°	1441.1	1221.2	916.5	747.4	693.9
57.5°	1325.6	1099.9	806.7	648.8	603.5
60°	1207.0	981.5	690.9	547.2	502.1
62.5°	1091.6	865.9	592.2	456.9	434.5
65°	973.1	744.4	490.7	395.0	386.3
67.5°	860.3	631.7	395.0	346.8	338.5
70°	741.8	521.9	327.1	298.9	287.6
72.5°	629.0	420.1	273.5	251.1	245.3
75°	518.9	321.4	225.6	205.9	203.2
77.5°	409.1	228.3	177.8	166.4	160.7
80°	307.3	163.7	135.3	124.1	124.1
82.5°	214.2	110.1	93.0	87.4	87.4
85°	121.2	61.9	53.5	53.5	53.5
87.5°	45.1	22.4	22.4	19.8	19.8
90°	1.8	22.1	36.8	46.1	49.7
92.5°	46.1	38.7	44.2	47.9	49.7
95°	119.6	58.8	71.7	81.2	79.2
97.5°	215.4	64.5	93.8	99.5	101.2
100°	326.0	73.7	105.0	119.6	123.3
102.5°	447.4	443.8	108.7	128.8	134.5
105°	559.8	615.1	112.4	132.5	140.0
107.5°	690.5	736.4	116.1	136.2	143.6
110°	815.9	854.3	322.3	138.2	145.4

TEST NUMBER: P903775

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	933.7	966.7	935.5	141.7	147.4
115°	1058.8	1090.1	1136.1	283.6	151.1
117.5°	1167.4	1204.2	1235.7	972.1	489.8
120°	1289.0	1316.5	1349.8	1371.9	1123.2
122.5°	1391.9	1421.5	1458.5	1469.4	1471.4
125°	1496.9	1521.0	1555.9	1568.9	1574.3
127.5°	1592.7	1618.5	1646.3	1664.6	1666.4
130°	1683.0	1712.5	1732.7	1753.0	1751.2
132.5°	1775.1	1799.1	1819.3	1835.9	1834.1
135°	1852.5	1882.0	1898.4	1917.0	1913.3
137.5°	1933.4	1955.5	1974.1	1992.4	1987.0
140°	2012.5	2027.4	2047.6	2064.2	2054.9
142.5°	2079.1	2091.9	2115.7	2130.4	2121.2
145°	2149.0	2147.0	2178.3	2191.2	2182.0
147.5°	2209.6	2204.1	2235.3	2244.6	2237.3
150°	2268.6	2255.7	2285.2	2296.1	2287.0
152.5°	2318.3	2303.6	2331.1	2342.3	2329.4
155°	2366.2	2349.8	2371.8	2382.7	2368.1
157.5°	2404.8	2390.2	2406.8	2419.7	2404.8
160°	2438.1	2427.0	2438.1	2449.0	2436.1
162.5°	2467.4	2456.5	2465.6	2478.5	2461.9
165°	2493.2	2482.3	2487.7	2500.6	2487.7
167.5°	2513.5	2502.4	2508.0	2520.9	2504.3
170°	2530.2	2518.9	2522.7	2535.6	2518.9
172.5°	2541.1	2530.2	2533.8	2546.7	2530.2
175°	2550.2	2537.3	2541.1	2553.9	2535.6
177.5°	2553.9	2541.1	2543.0	2555.9	2539.3
180°	2544.8	2544.8	2544.8	2544.8	2544.8

TEST NUMBER: P903775

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.17	11.97	12.17	12.97	14.30	7.13	7.93	8.13	8.94	10.26
	3H	12.84	13.56	13.85	14.57	15.92	8.31	9.03	9.32	10.04	11.39
	4H	13.45	14.12	14.47	15.14	16.49	8.76	9.43	9.78	10.45	11.80
	6H	13.86	14.49	14.89	15.51	16.87	9.07	9.69	10.10	10.71	12.08
	8H	13.99	14.58	15.02	15.61	16.98	9.16	9.75	10.19	10.79	12.15
	12H	14.05	14.61	15.08	15.64	17.03	9.20	9.76	10.24	10.79	12.18
4H	2H	11.18	11.86	12.21	12.88	14.23	7.72	8.40	8.75	9.41	10.77
	3H	13.01	13.57	14.04	14.61	15.98	9.06	9.63	10.10	10.67	12.04
	4H	13.69	14.21	14.73	15.24	16.63	9.60	10.12	10.64	11.15	12.55
	6H	14.20	14.64	15.25	15.70	17.09	10.01	10.46	11.06	11.51	12.90
	8H	14.37	14.79	15.43	15.84	17.24	10.14	10.55	11.19	11.60	13.00
	12H	14.47	14.84	15.53	15.90	17.31	10.20	10.57	11.27	11.64	13.04
8H	4H	13.66	14.07	14.71	15.12	16.52	9.88	10.29	10.93	11.34	12.74
	6H	14.22	14.56	15.29	15.65	17.05	10.39	10.73	11.46	11.82	13.22
	8H	14.43	14.73	15.51	15.81	17.23	10.57	10.87	11.66	11.95	13.37
	12H	14.56	14.83	15.65	15.90	17.36	10.69	10.95	11.77	12.02	13.48
12H	4H	13.61	13.98	14.68	15.05	16.45	9.88	10.25	10.95	11.32	12.73
	6H	14.19	14.49	15.27	15.57	16.99	10.44	10.73	11.52	11.81	13.23
	8H	14.41	14.67	15.49	15.74	17.20	10.64	10.90	11.72	11.97	13.43

END OF REPORT