

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911915

Luminaire Tested: DFN2DIP-SQ3F0-070D060US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911915
REPORT IS A COMBINATION OF REPORTS P901424 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D060US850-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13186.0 lumens
Efficiency: N/A
Efficacy: 119.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911915

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US850-RLLONL

Luminous Intensity Polar Plot

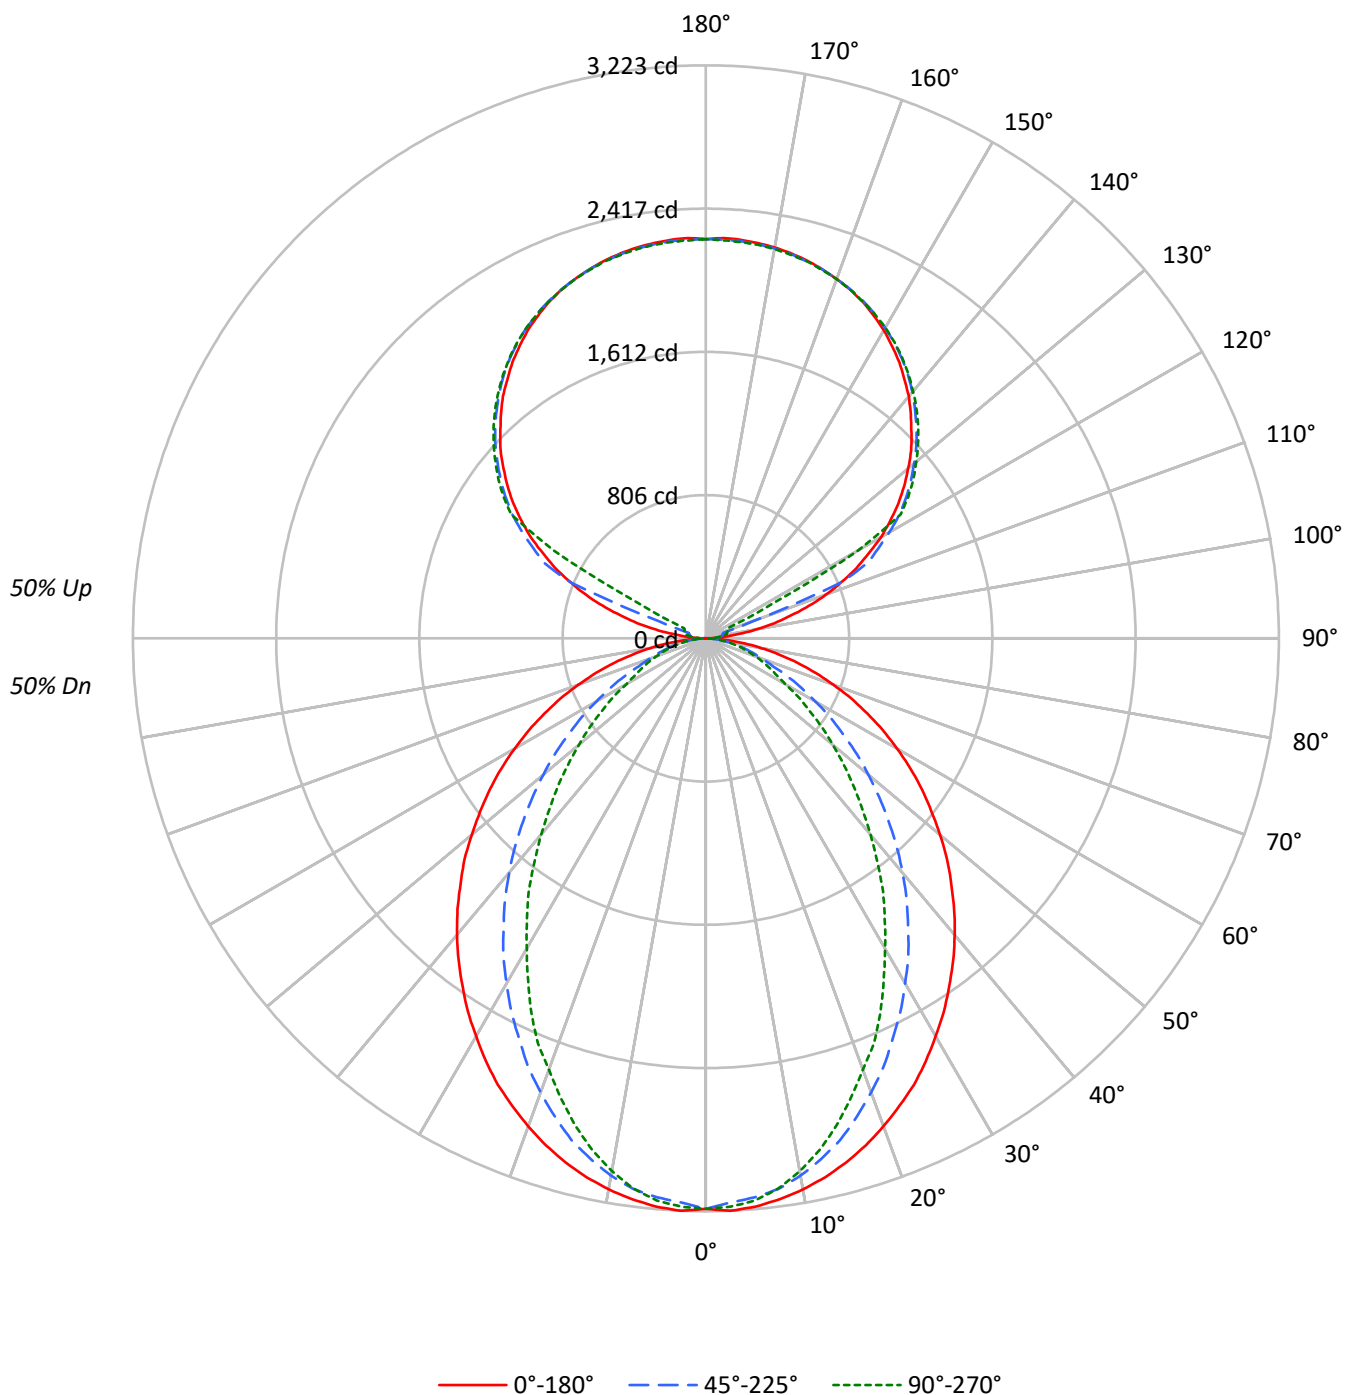

TEST NUMBER: P911915

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	91	87	84	81	74	72	69	62	60	59	50	49	48
2	90	83	77	72	83	77	72	67	65	62	58	55	52	50	45	43	41
3	82	73	66	60	76	68	62	57	58	53	50	49	45	43	40	38	36
4	76	65	57	52	70	60	54	49	52	47	43	44	40	37	36	34	31
5	70	58	50	45	64	54	47	42	47	41	37	40	35	32	33	30	28
6	64	52	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	59	47	40	34	55	44	37	32	38	33	29	33	29	25	28	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	52	40	32	27	48	37	30	26	32	27	23	28	24	21	24	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3676	3676	3676
5°	3680	3615	3640
10°	3641	3542	3520
15°	3588	3423	3336
20°	3520	3259	3110
25°	3450	3076	2893
30°	3356	2889	2617
35°	3264	2687	2374
40°	3170	2479	2097
45°	3062	2249	1845
50°	2950	2016	1600
55°	2832	1768	1364
60°	2695	1509	1121
65°	2538	1247	1008
70°	2348	1001	910
75°	2108	877	826
80°	1762	729	712
85°	1195	474	528

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3062 cd/sqm

TEST NUMBER: P911915

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	300.7	2.3
10°-20°	825.5	6.3
20°-30°	1158.9	8.8
30°-40°	1263.3	9.6
40°-50°	1161.1	8.8
50°-60°	911.9	6.9
60°-70°	593.5	4.5
70°-80°	305.5	2.3
80°-90°	81.9	0.6
90°-100°	74.1	0.6
100°-110°	276.0	2.1
110°-120°	732.1	5.6
120°-130°	1214.2	9.2
130°-140°	1289.8	9.8
140°-150°	1198.7	9.1
150°-160°	963.8	7.3
160°-170°	621.0	4.7
170°-180°	213.7	1.6
0°-30°	2285.1	17.3
0°-40°	3548.4	26.9
0°-60°	5621.4	42.6
0°-90°	6602.5	50.1
90°-120°	1082.2	8.2
90°-150°	4785.0	36.3
90°-180°	6583.0	49.9
0°-180°	13186.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3208	3208	3208	3208	3208	
5°	3208	3194	3156	3182	3174	304
15°	3052	3020	2921	2866	2837	860
25°	2770	2677	2485	2366	2323	1274
35°	2387	2239	1983	1800	1736	1494
45°	1951	1756	1452	1246	1176	1507
55°	1484	1257	944	770	714	1326
65°	1002	766	505	407	398	993
75°	534	331	232	212	209	565
85°	125	64	55	55	55	143
90°	2	20	32	41	44	12
95°	106	52	63	72	70	125
105°	494	543	99	117	124	528
115°	934	962	1003	250	133	920
125°	1321	1342	1373	1384	1389	1178
135°	1635	1661	1675	1692	1688	1263
145°	1896	1895	1922	1934	1926	1186
155°	2088	2074	2093	2103	2090	962
165°	2200	2190	2195	2207	2195	622
175°	2250	2239	2242	2254	2238	214
180°	2246	2246	2246	2246	2246	

TEST NUMBER: P911915

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3208.4	3208.4	3208.4	3208.4	3208.4
2.5°	3222.9	3208.4	3176.4	3205.7	3199.8
5°	3208.4	3193.9	3156.1	3182.3	3173.6
7.5°	3182.3	3165.0	3124.4	3135.7	3121.3
10°	3147.5	3127.2	3069.2	3060.3	3043.0
12.5°	3104.0	3077.8	2999.3	2982.0	2949.9
15°	3051.6	3019.6	2921.0	2865.9	2836.9
17.5°	2990.6	2944.2	2822.2	2758.3	2711.8
20°	2921.0	2862.8	2717.7	2645.3	2581.2
22.5°	2845.6	2778.7	2610.1	2511.6	2468.2
25°	2770.1	2677.0	2485.4	2366.5	2322.8
27.5°	2680.1	2581.2	2369.3	2232.9	2166.0
30°	2584.3	2473.7	2241.4	2093.6	2015.1
32.5°	2491.3	2357.6	2119.7	1945.4	1872.7
35°	2386.8	2238.6	1983.3	1800.4	1736.3
37.5°	2285.2	2125.3	1855.5	1654.8	1582.5
40°	2177.6	2003.6	1721.7	1515.7	1440.1
42.5°	2067.4	1881.6	1588.3	1373.3	1301.0
45°	1951.3	1756.5	1451.9	1245.5	1175.9
47.5°	1840.9	1634.9	1321.3	1114.9	1051.1
50°	1719.0	1512.9	1193.4	992.9	932.2
52.5°	1599.7	1381.9	1071.4	879.8	824.7
55°	1483.6	1257.2	943.5	769.5	714.4
57.5°	1364.7	1132.4	830.5	667.8	621.4
60°	1242.7	1010.4	711.3	563.5	516.9
62.5°	1123.7	891.5	609.6	470.4	447.3
65°	1001.8	766.4	505.3	406.7	397.7
67.5°	885.6	650.3	406.7	357.0	348.4
70°	763.7	537.2	336.7	307.7	296.0
72.5°	647.5	432.5	281.6	258.5	252.6
75°	534.2	330.8	232.2	211.9	209.2
77.5°	421.1	235.0	183.0	171.2	165.5
80°	316.4	168.5	139.3	127.9	127.9
82.5°	220.6	113.3	95.8	89.9	89.9
85°	124.8	63.8	55.1	55.1	55.1
87.5°	46.5	23.1	23.1	20.3	20.3
90°	1.6	19.5	32.4	40.7	43.8
92.5°	40.7	34.2	38.9	42.3	43.8
95°	105.6	51.9	63.3	71.6	69.9
97.5°	190.1	56.9	82.7	87.8	89.4
100°	287.7	65.0	92.6	105.6	108.8
102.5°	394.8	391.7	95.9	113.7	118.7
105°	493.9	542.7	99.1	116.9	123.5
107.5°	609.4	649.9	102.5	120.2	126.8
110°	720.0	753.9	284.5	122.0	128.3

TEST NUMBER: P911915

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	823.9	853.0	825.4	125.0	130.1
115°	934.3	961.9	1002.6	250.3	133.3
117.5°	1030.2	1062.6	1090.4	857.9	432.2
120°	1137.5	1161.8	1191.2	1210.6	991.2
122.5°	1228.3	1254.4	1287.0	1296.6	1298.4
125°	1321.0	1342.2	1373.1	1384.5	1389.2
127.5°	1405.5	1428.3	1452.8	1469.0	1470.5
130°	1485.2	1511.2	1529.0	1546.9	1545.4
132.5°	1566.5	1587.6	1605.4	1620.0	1618.5
135°	1634.8	1660.8	1675.3	1691.7	1688.3
137.5°	1706.1	1725.6	1742.0	1758.2	1753.4
140°	1776.0	1789.1	1806.9	1821.5	1813.4
142.5°	1834.6	1846.0	1867.1	1880.0	1871.9
145°	1896.4	1894.6	1922.2	1933.7	1925.6
147.5°	1949.8	1945.0	1972.6	1980.7	1974.4
150°	2002.0	1990.5	2016.6	2026.3	2018.2
152.5°	2045.8	2032.8	2057.1	2067.0	2055.5
155°	2088.0	2073.5	2093.0	2102.7	2089.7
157.5°	2122.2	2109.2	2123.8	2135.3	2122.2
160°	2151.5	2141.6	2151.5	2161.1	2149.8
162.5°	2177.3	2167.7	2175.7	2187.2	2172.5
165°	2200.1	2190.5	2195.3	2206.7	2195.3
167.5°	2218.0	2208.2	2213.2	2224.7	2209.9
170°	2232.7	2222.9	2226.2	2237.5	2222.9
172.5°	2242.4	2232.7	2236.0	2247.4	2232.7
175°	2250.5	2239.1	2242.4	2253.7	2237.5
177.5°	2253.7	2242.4	2244.1	2255.5	2240.8
180°	2245.6	2245.6	2245.6	2245.6	2245.6

TEST NUMBER: P911915

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.64	12.47	12.61	13.45	14.72	7.60	8.43	8.57	9.41	10.68
	3H	13.32	14.06	14.29	15.04	16.34	8.79	9.53	9.76	10.51	11.81
	4H	13.92	14.62	14.91	15.61	16.91	9.23	9.93	10.22	10.92	12.22
	6H	14.34	14.99	15.34	15.98	17.29	9.55	10.19	10.55	11.18	12.50
	8H	14.46	15.08	15.47	16.09	17.40	9.63	10.25	10.64	11.26	12.57
	12H	14.52	15.11	15.53	16.11	17.45	9.67	10.26	10.68	11.26	12.60
4H	2H	11.66	12.36	12.65	13.35	14.65	8.20	8.90	9.19	9.89	11.19
	3H	13.48	14.07	14.49	15.08	16.40	9.54	10.12	10.54	11.14	12.46
	4H	14.17	14.70	15.18	15.71	17.05	10.08	10.62	11.09	11.62	12.96
	6H	14.68	15.14	15.70	16.17	17.51	10.49	10.95	11.52	11.98	13.32
	8H	14.86	15.28	15.88	16.31	17.66	10.62	11.05	11.64	12.07	13.42
	12H	14.95	15.33	15.99	16.37	17.73	10.68	11.07	11.72	12.11	13.46
8H	4H	14.14	14.57	15.16	15.59	16.94	10.36	10.79	11.38	11.81	13.16
	6H	14.70	15.05	15.75	16.12	17.47	10.87	11.22	11.92	12.29	13.64
	8H	14.91	15.22	15.97	16.27	17.64	11.06	11.37	12.11	12.42	13.79
	12H	15.05	15.32	16.10	16.37	17.78	11.17	11.44	12.23	12.49	13.90
12H	4H	14.09	14.48	15.13	15.52	16.87	10.36	10.75	11.40	11.79	13.15
	6H	14.67	14.98	15.73	16.04	17.41	10.92	11.23	11.97	12.28	13.65
	8H	14.89	15.16	15.95	16.21	17.62	11.12	11.40	12.18	12.44	13.85

END OF REPORT