

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911985

Luminaire Tested: DFN2DIP-SQ3F0-090D060US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911985
REPORT IS A COMBINATION OF REPORTS P901427 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D060US850-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16468.6 lumens
Efficiency: N/A
Efficacy: 123.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 132.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911985

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US850-FLLONL

Luminous Intensity Polar Plot

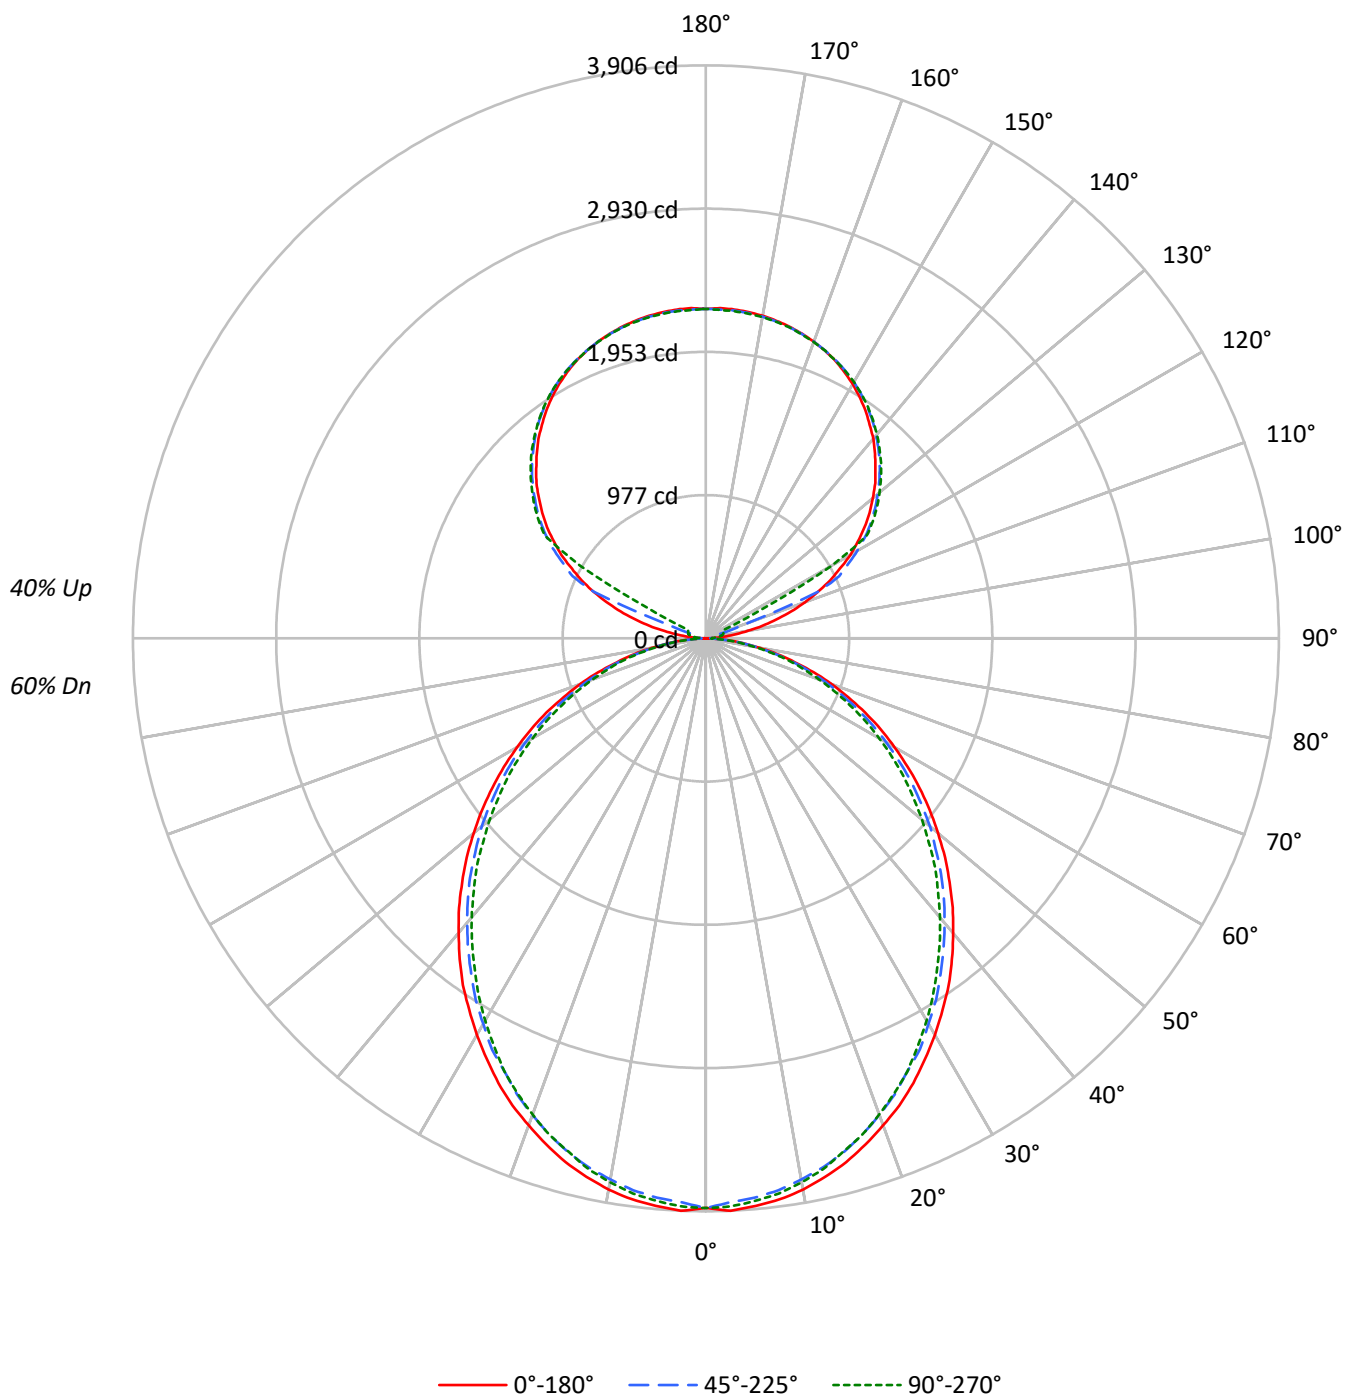

TEST NUMBER: P911985

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	90	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	49	47
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	44	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	30	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4450	4450	4450
5°	4454	4385	4416
10°	4415	4323	4355
15°	4348	4249	4260
20°	4257	4147	4163
25°	4167	4026	4051
30°	4054	3913	3909
35°	3948	3780	3759
40°	3817	3646	3616
45°	3686	3511	3469
50°	3543	3369	3300
55°	3393	3206	3144
60°	3224	3012	2965
65°	3038	2810	2754
70°	2802	2565	2527
75°	2476	2270	2314
80°	2080	1894	1913
85°	1464	1255	1252

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3686 cd/sqm

TEST NUMBER: P911985

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.5	2.2
10°-20°	1028.5	6.2
20°-30°	1511.4	9.2
30°-40°	1755.4	10.7
40°-50°	1753.3	10.6
50°-60°	1528.8	9.3
60°-70°	1130.1	6.9
70°-80°	639.4	3.9
80°-90°	172.7	1.0
90°-100°	74.1	0.4
100°-110°	276.0	1.7
110°-120°	732.1	4.4
120°-130°	1214.2	7.4
130°-140°	1289.8	7.8
140°-150°	1198.7	7.3
150°-160°	963.8	5.9
160°-170°	621.0	3.8
170°-180°	213.7	1.3
0°-30°	2905.4	17.6
0°-40°	4660.9	28.3
0°-60°	7942.9	48.2
0°-90°	9885.2	60.0
90°-120°	1082.2	6.6
90°-150°	4785.0	29.1
90°-180°	6583.0	40.0
0°-180°	16468.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3884	3884	3884	3884	3884	
5°	3884	3869	3828	3858	3850	369
15°	3697	3675	3626	3641	3622	1041
25°	3346	3316	3253	3260	3253	1540
35°	2887	2850	2790	2767	2748	1803
45°	2349	2323	2267	2226	2211	1813
55°	1778	1755	1710	1666	1647	1589
65°	1199	1176	1139	1106	1087	1185
75°	627	620	601	579	586	670
85°	153	149	146	134	131	171
90°	2	20	32	41	44	15
95°	106	52	63	72	70	125
105°	494	543	99	117	124	528
115°	934	962	1003	250	133	920
125°	1321	1342	1373	1384	1389	1178
135°	1635	1661	1675	1692	1688	1263
145°	1896	1895	1922	1934	1926	1186
155°	2088	2074	2093	2103	2090	962
165°	2200	2190	2195	2207	2195	622
175°	2250	2239	2242	2254	2238	214
180°	2246	2246	2246	2246	2246	

TEST NUMBER: P911985

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3883.6	3883.6	3883.6	3883.6	3883.6
2.5°	3906.2	3887.6	3846.5	3883.6	3876.5
5°	3883.6	3869.0	3827.8	3857.5	3850.3
7.5°	3857.5	3835.4	3794.1	3824.3	3816.7
10°	3816.7	3790.6	3745.8	3775.5	3764.4
12.5°	3760.4	3738.2	3693.5	3712.0	3704.6
15°	3697.1	3674.9	3626.1	3641.2	3622.5
17.5°	3618.6	3596.4	3547.7	3566.3	3547.7
20°	3532.6	3510.4	3458.1	3469.2	3454.5
22.5°	3447.0	3413.4	3364.6	3364.6	3357.1
25°	3346.0	3316.2	3252.9	3260.0	3252.9
27.5°	3233.8	3207.7	3159.4	3148.3	3129.7
30°	3122.2	3092.0	3036.1	3025.0	3010.0
32.5°	3002.5	2980.3	2920.4	2897.9	2882.8
35°	2886.8	2849.6	2789.7	2767.2	2748.5
37.5°	2756.1	2722.4	2662.5	2636.4	2617.8
40°	2621.7	2591.6	2531.7	2498.5	2483.5
42.5°	2490.9	2460.9	2401.4	2363.8	2341.7
45°	2349.1	2323.0	2266.7	2225.9	2210.9
47.5°	2210.9	2184.7	2124.8	2083.7	2061.5
50°	2065.1	2046.4	1994.1	1941.9	1923.2
52.5°	1923.2	1897.1	1848.7	1807.6	1781.4
55°	1777.8	1755.2	1710.4	1665.7	1647.1
57.5°	1632.0	1613.4	1564.7	1519.9	1504.8
60°	1486.2	1471.5	1419.2	1378.0	1367.0
62.5°	1344.3	1318.2	1280.9	1243.7	1228.7
65°	1198.9	1176.3	1139.1	1105.5	1086.8
67.5°	1049.6	1030.6	997.2	971.2	956.1
70°	911.3	896.2	862.6	836.4	821.8
72.5°	769.4	754.3	735.7	709.6	698.6
75°	627.3	620.0	601.1	578.9	586.4
77.5°	500.4	485.4	477.9	466.8	455.7
80°	373.6	369.6	362.1	351.0	343.6
82.5°	254.0	254.0	250.4	235.3	235.3
85°	152.9	149.4	145.8	134.3	130.8
87.5°	67.3	59.8	52.3	41.3	37.3
90°	1.6	19.5	32.4	40.7	43.8
92.5°	40.7	34.2	38.9	42.3	43.8
95°	105.6	51.9	63.3	71.6	69.9
97.5°	190.1	56.9	82.7	87.8	89.4
100°	287.7	65.0	92.6	105.6	108.8
102.5°	394.8	391.7	95.9	113.7	118.7
105°	493.9	542.7	99.1	116.9	123.5
107.5°	609.4	649.9	102.5	120.2	126.8
110°	720.0	753.9	284.5	122.0	128.3

TEST NUMBER: P911985

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	823.9	853.0	825.4	125.0	130.1
115°	934.3	961.9	1002.6	250.3	133.3
117.5°	1030.2	1062.6	1090.4	857.9	432.2
120°	1137.5	1161.8	1191.2	1210.6	991.2
122.5°	1228.3	1254.4	1287.0	1296.6	1298.4
125°	1321.0	1342.2	1373.1	1384.5	1389.2
127.5°	1405.5	1428.3	1452.8	1469.0	1470.5
130°	1485.2	1511.2	1529.0	1546.9	1545.4
132.5°	1566.5	1587.6	1605.4	1620.0	1618.5
135°	1634.8	1660.8	1675.3	1691.7	1688.3
137.5°	1706.1	1725.6	1742.0	1758.2	1753.4
140°	1776.0	1789.1	1806.9	1821.5	1813.4
142.5°	1834.6	1846.0	1867.1	1880.0	1871.9
145°	1896.4	1894.6	1922.2	1933.7	1925.6
147.5°	1949.8	1945.0	1972.6	1980.7	1974.4
150°	2002.0	1990.5	2016.6	2026.3	2018.2
152.5°	2045.8	2032.8	2057.1	2067.0	2055.5
155°	2088.0	2073.5	2093.0	2102.7	2089.7
157.5°	2122.2	2109.2	2123.8	2135.3	2122.2
160°	2151.5	2141.6	2151.5	2161.1	2149.8
162.5°	2177.3	2167.7	2175.7	2187.2	2172.5
165°	2200.1	2190.5	2195.3	2206.7	2195.3
167.5°	2218.0	2208.2	2213.2	2224.7	2209.9
170°	2232.7	2222.9	2226.2	2237.5	2222.9
172.5°	2242.4	2232.7	2236.0	2247.4	2232.7
175°	2250.5	2239.1	2242.4	2253.7	2237.5
177.5°	2253.7	2242.4	2244.1	2255.5	2240.8
180°	2245.6	2245.6	2245.6	2245.6	2245.6

TEST NUMBER: P911985

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.30	14.26	14.17	15.15	16.27	12.86	13.82	13.72	14.70	15.82
	3H	14.96	15.83	15.84	16.72	17.87	14.47	15.34	15.35	16.23	17.38
	4H	15.55	16.37	16.45	17.27	18.43	15.06	15.87	15.95	16.78	17.93
	6H	15.96	16.71	16.86	17.62	18.78	15.46	16.21	16.36	17.12	18.28
	8H	16.06	16.78	16.97	17.70	18.87	15.56	16.27	16.47	17.20	18.37
	12H	16.11	16.79	17.03	17.71	18.91	15.60	16.28	16.52	17.20	18.40
4H	2H	13.77	14.58	14.67	15.49	16.64	13.42	14.23	14.31	15.13	16.29
	3H	15.64	16.32	16.55	17.25	18.42	15.23	15.91	16.14	16.85	18.02
	4H	16.35	16.97	17.28	17.90	19.10	15.93	16.55	16.85	17.48	18.68
	6H	16.87	17.41	17.81	18.36	19.56	16.44	16.97	17.37	17.93	19.12
	8H	17.02	17.52	17.96	18.47	19.68	16.58	17.08	17.52	18.03	19.24
	12H	17.10	17.55	18.05	18.51	19.73	16.65	17.10	17.60	18.06	19.28
8H	4H	16.55	17.05	17.49	18.00	19.21	16.18	16.68	17.12	17.63	18.84
	6H	17.18	17.60	18.15	18.59	19.80	16.80	17.21	17.76	18.20	19.41
	8H	17.40	17.77	18.38	18.75	19.98	17.01	17.38	17.98	18.35	19.58
	12H	17.53	17.86	18.51	18.83	20.11	17.12	17.45	18.10	18.42	19.70
12H	4H	16.54	17.00	17.50	17.96	19.18	16.18	16.63	17.13	17.59	18.81
	6H	17.21	17.58	18.19	18.56	19.79	16.84	17.21	17.81	18.19	19.41
	8H	17.46	17.78	18.43	18.75	20.03	17.07	17.40	18.05	18.37	19.65