

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912023

Luminaire Tested: DFN2DIP-SQ3F0-100D060US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912023
REPORT IS A COMBINATION OF REPORTS P901430 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D060US850-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16013.9 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 143.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912023

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US850-RLLONL

Luminous Intensity Polar Plot

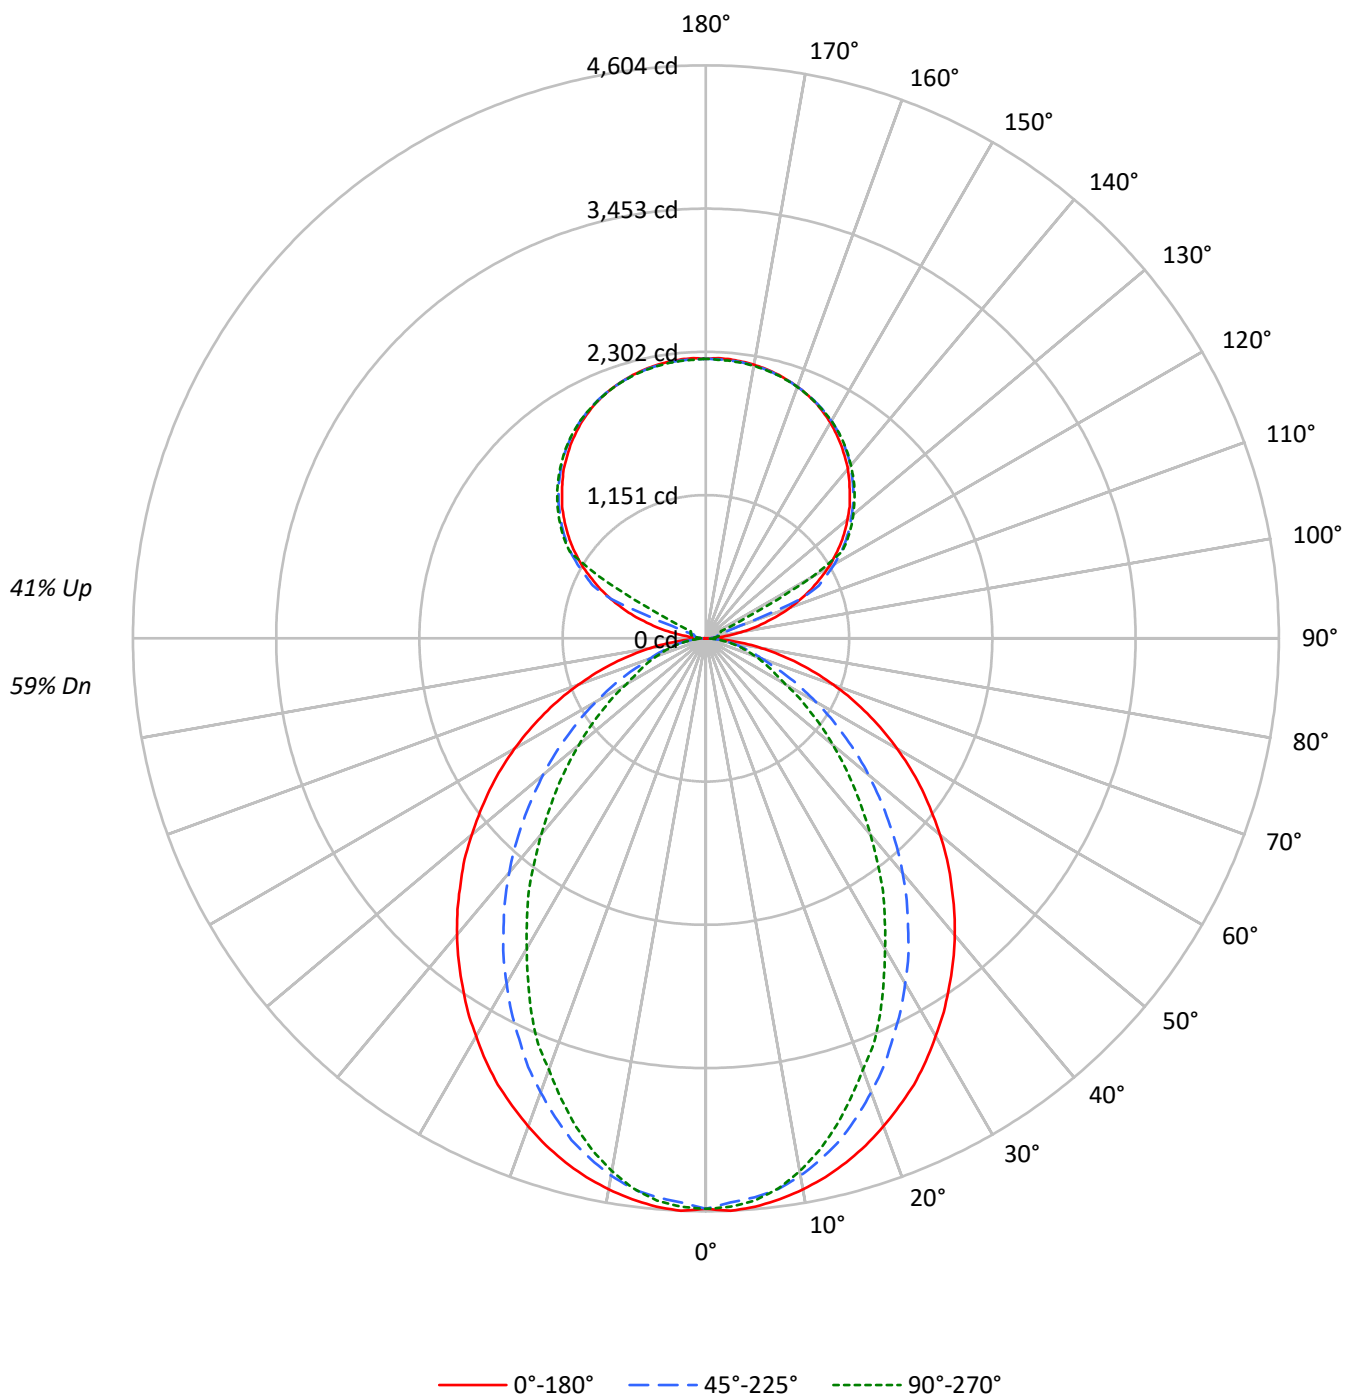

TEST NUMBER: P912023

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	55
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	51	49	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	43	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	38	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	23	21
10	50	38	31	26	46	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5252	5252	5252
5°	5257	5165	5200
10°	5201	5060	5029
15°	5127	4889	4766
20°	5028	4656	4443
25°	4928	4394	4132
30°	4794	4127	3738
35°	4663	3839	3392
40°	4529	3542	2995
45°	4374	3213	2636
50°	4214	2881	2285
55°	4045	2526	1948
60°	3851	2156	1602
65°	3627	1780	1440
70°	3354	1430	1301
75°	3012	1253	1179
80°	2516	1041	1017
85°	1706	677	754

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4374 cd/sqm

TEST NUMBER: P912023

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	429.6	2.7
10°-20°	1179.3	7.4
20°-30°	1655.6	10.3
30°-40°	1804.7	11.3
40°-50°	1658.8	10.4
50°-60°	1302.7	8.1
60°-70°	847.9	5.3
70°-80°	436.5	2.7
80°-90°	115.4	0.7
90°-100°	74.1	0.5
100°-110°	276.0	1.7
110°-120°	732.1	4.6
120°-130°	1214.2	7.6
130°-140°	1289.8	8.1
140°-150°	1198.7	7.5
150°-160°	963.8	6.0
160°-170°	621.0	3.9
170°-180°	213.7	1.3
0°-30°	3264.5	20.4
0°-40°	5069.2	31.7
0°-60°	8030.6	50.1
0°-90°	9430.4	58.9
90°-120°	1082.2	6.8
90°-150°	4785.0	29.9
90°-180°	6583.0	41.1
0°-180°	16013.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4584	4584	4584	4584	4584	
5°	4584	4563	4509	4546	4534	435
15°	4360	4314	4173	4094	4053	1228
25°	3957	3824	3551	3381	3318	1820
35°	3410	3198	2833	2572	2480	2134
45°	2788	2509	2074	1779	1680	2153
55°	2119	1796	1348	1099	1020	1894
65°	1431	1095	722	581	568	1419
75°	763	473	332	303	299	807
85°	178	91	79	79	79	205
90°	2	20	32	41	44	15
95°	106	52	63	72	70	125
105°	494	543	99	117	124	528
115°	934	962	1003	250	133	920
125°	1321	1342	1373	1384	1389	1178
135°	1635	1661	1675	1692	1688	1263
145°	1896	1895	1922	1934	1926	1186
155°	2088	2074	2093	2103	2090	962
165°	2200	2190	2195	2207	2195	622
175°	2250	2239	2242	2254	2238	214
180°	2246	2246	2246	2246	2246	

TEST NUMBER: P912023

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4583.5	4583.5	4583.5	4583.5	4583.5
2.5°	4604.1	4583.5	4537.7	4579.5	4571.2
5°	4583.5	4562.8	4508.6	4546.1	4533.7
7.5°	4546.1	4521.4	4463.3	4479.6	4459.0
10°	4496.3	4467.3	4384.5	4371.8	4347.2
12.5°	4434.3	4396.9	4284.6	4260.0	4214.2
15°	4359.5	4313.7	4172.8	4094.1	4052.7
17.5°	4272.3	4205.9	4031.7	3940.5	3874.1
20°	4172.8	4089.7	3882.4	3779.0	3687.4
22.5°	4065.0	3969.6	3728.8	3588.1	3526.0
25°	3957.2	3824.4	3550.6	3380.7	3318.2
27.5°	3828.7	3687.4	3384.7	3189.7	3094.2
30°	3691.9	3533.8	3202.0	2990.9	2878.6
32.5°	3559.0	3367.9	3028.2	2779.2	2675.2
35°	3409.7	3198.1	2833.3	2571.9	2480.3
37.5°	3264.6	3036.1	2650.6	2364.2	2260.7
40°	3111.0	2862.3	2459.7	2165.2	2057.4
42.5°	2953.4	2688.0	2269.1	1961.9	1858.5
45°	2787.5	2509.3	2074.2	1779.3	1679.8
47.5°	2630.0	2335.6	1887.5	1592.6	1501.6
50°	2455.7	2161.2	1704.9	1418.4	1331.7
52.5°	2285.3	1974.2	1530.6	1256.8	1178.1
55°	2119.4	1796.0	1348.0	1099.4	1020.5
57.5°	1949.6	1617.7	1186.5	954.1	887.6
60°	1775.3	1443.5	1016.2	804.9	738.5
62.5°	1605.4	1273.6	870.9	672.1	639.0
65°	1431.2	1094.9	721.7	580.9	568.1
67.5°	1265.3	929.0	580.9	510.0	497.7
70°	1090.9	767.5	481.0	439.6	423.0
72.5°	925.0	617.8	402.2	369.2	360.9
75°	763.1	472.7	331.8	302.8	298.8
77.5°	601.6	335.8	261.4	244.6	236.3
80°	451.9	240.8	199.0	182.7	182.7
82.5°	315.1	161.9	136.9	128.5	128.5
85°	178.2	91.0	78.7	78.7	78.7
87.5°	66.4	33.0	33.0	29.1	29.1
90°	1.6	19.5	32.4	40.7	43.8
92.5°	40.7	34.2	38.9	42.3	43.8
95°	105.6	51.9	63.3	71.6	69.9
97.5°	190.1	56.9	82.7	87.8	89.4
100°	287.7	65.0	92.6	105.6	108.8
102.5°	394.8	391.7	95.9	113.7	118.7
105°	493.9	542.7	99.1	116.9	123.5
107.5°	609.4	649.9	102.5	120.2	126.8
110°	720.0	753.9	284.5	122.0	128.3

TEST NUMBER: P912023

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	823.9	853.0	825.4	125.0	130.1
115°	934.3	961.9	1002.6	250.3	133.3
117.5°	1030.2	1062.6	1090.4	857.9	432.2
120°	1137.5	1161.8	1191.2	1210.6	991.2
122.5°	1228.3	1254.4	1287.0	1296.6	1298.4
125°	1321.0	1342.2	1373.1	1384.5	1389.2
127.5°	1405.5	1428.3	1452.8	1469.0	1470.5
130°	1485.2	1511.2	1529.0	1546.9	1545.4
132.5°	1566.5	1587.6	1605.4	1620.0	1618.5
135°	1634.8	1660.8	1675.3	1691.7	1688.3
137.5°	1706.1	1725.6	1742.0	1758.2	1753.4
140°	1776.0	1789.1	1806.9	1821.5	1813.4
142.5°	1834.6	1846.0	1867.1	1880.0	1871.9
145°	1896.4	1894.6	1922.2	1933.7	1925.6
147.5°	1949.8	1945.0	1972.6	1980.7	1974.4
150°	2002.0	1990.5	2016.6	2026.3	2018.2
152.5°	2045.8	2032.8	2057.1	2067.0	2055.5
155°	2088.0	2073.5	2093.0	2102.7	2089.7
157.5°	2122.2	2109.2	2123.8	2135.3	2122.2
160°	2151.5	2141.6	2151.5	2161.1	2149.8
162.5°	2177.3	2167.7	2175.7	2187.2	2172.5
165°	2200.1	2190.5	2195.3	2206.7	2195.3
167.5°	2218.0	2208.2	2213.2	2224.7	2209.9
170°	2232.7	2222.9	2226.2	2237.5	2222.9
172.5°	2242.4	2232.7	2236.0	2247.4	2232.7
175°	2250.5	2239.1	2242.4	2253.7	2237.5
177.5°	2253.7	2242.4	2244.1	2255.5	2240.8
180°	2245.6	2245.6	2245.6	2245.6	2245.6

TEST NUMBER: P912023

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.67	14.58	14.55	15.48	16.62	9.63	10.54	10.51	11.44	12.58
	3H	15.35	16.16	16.24	17.07	18.23	10.82	11.63	11.71	12.54	13.70
	4H	15.96	16.72	16.87	17.64	18.81	11.27	12.03	12.18	12.95	14.12
	6H	16.38	17.08	17.30	18.00	19.19	11.58	12.29	12.51	13.21	14.40
	8H	16.50	17.18	17.43	18.11	19.30	11.67	12.35	12.61	13.28	14.47
	12H	16.57	17.21	17.50	18.14	19.35	11.72	12.36	12.65	13.29	14.50
4H	2H	13.69	14.46	14.61	15.37	16.55	10.23	11.00	11.15	11.91	13.09
	3H	15.52	16.16	16.45	17.11	18.30	11.58	12.22	12.51	13.16	14.35
	4H	16.22	16.80	17.15	17.74	18.95	12.13	12.71	13.06	13.65	14.86
	6H	16.73	17.23	17.68	18.19	19.41	12.54	13.04	13.49	14.01	15.22
	8H	16.90	17.37	17.86	18.33	19.56	12.67	13.14	13.62	14.09	15.32
	12H	17.00	17.42	17.97	18.40	19.63	12.73	13.15	13.71	14.13	15.37
8H	4H	16.19	16.65	17.14	17.61	18.84	12.41	12.88	13.36	13.83	15.06
	6H	16.75	17.14	17.73	18.14	19.37	12.92	13.31	13.90	14.31	15.54
	8H	16.96	17.30	17.95	18.29	19.54	13.11	13.45	14.10	14.44	15.69
	12H	17.10	17.40	18.09	18.38	19.68	13.23	13.52	14.22	14.51	15.80
12H	4H	16.14	16.56	17.11	17.54	18.77	12.42	12.84	13.39	13.81	15.05
	6H	16.73	17.07	17.71	18.06	19.30	12.97	13.31	13.96	14.30	15.55
	8H	16.95	17.25	17.94	18.23	19.52	13.18	13.48	14.17	14.46	15.76

END OF REPORT