

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920056

Luminaire Tested: DFN2DIP-SQ3F0-060D050US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920056
REPORT IS A COMBINATION OF REPORTS P899883 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D050US935-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8924.2 lumens
Efficiency: N/A
Efficacy: 98.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920056

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US935-FLLFLL

Luminous Intensity Polar Plot

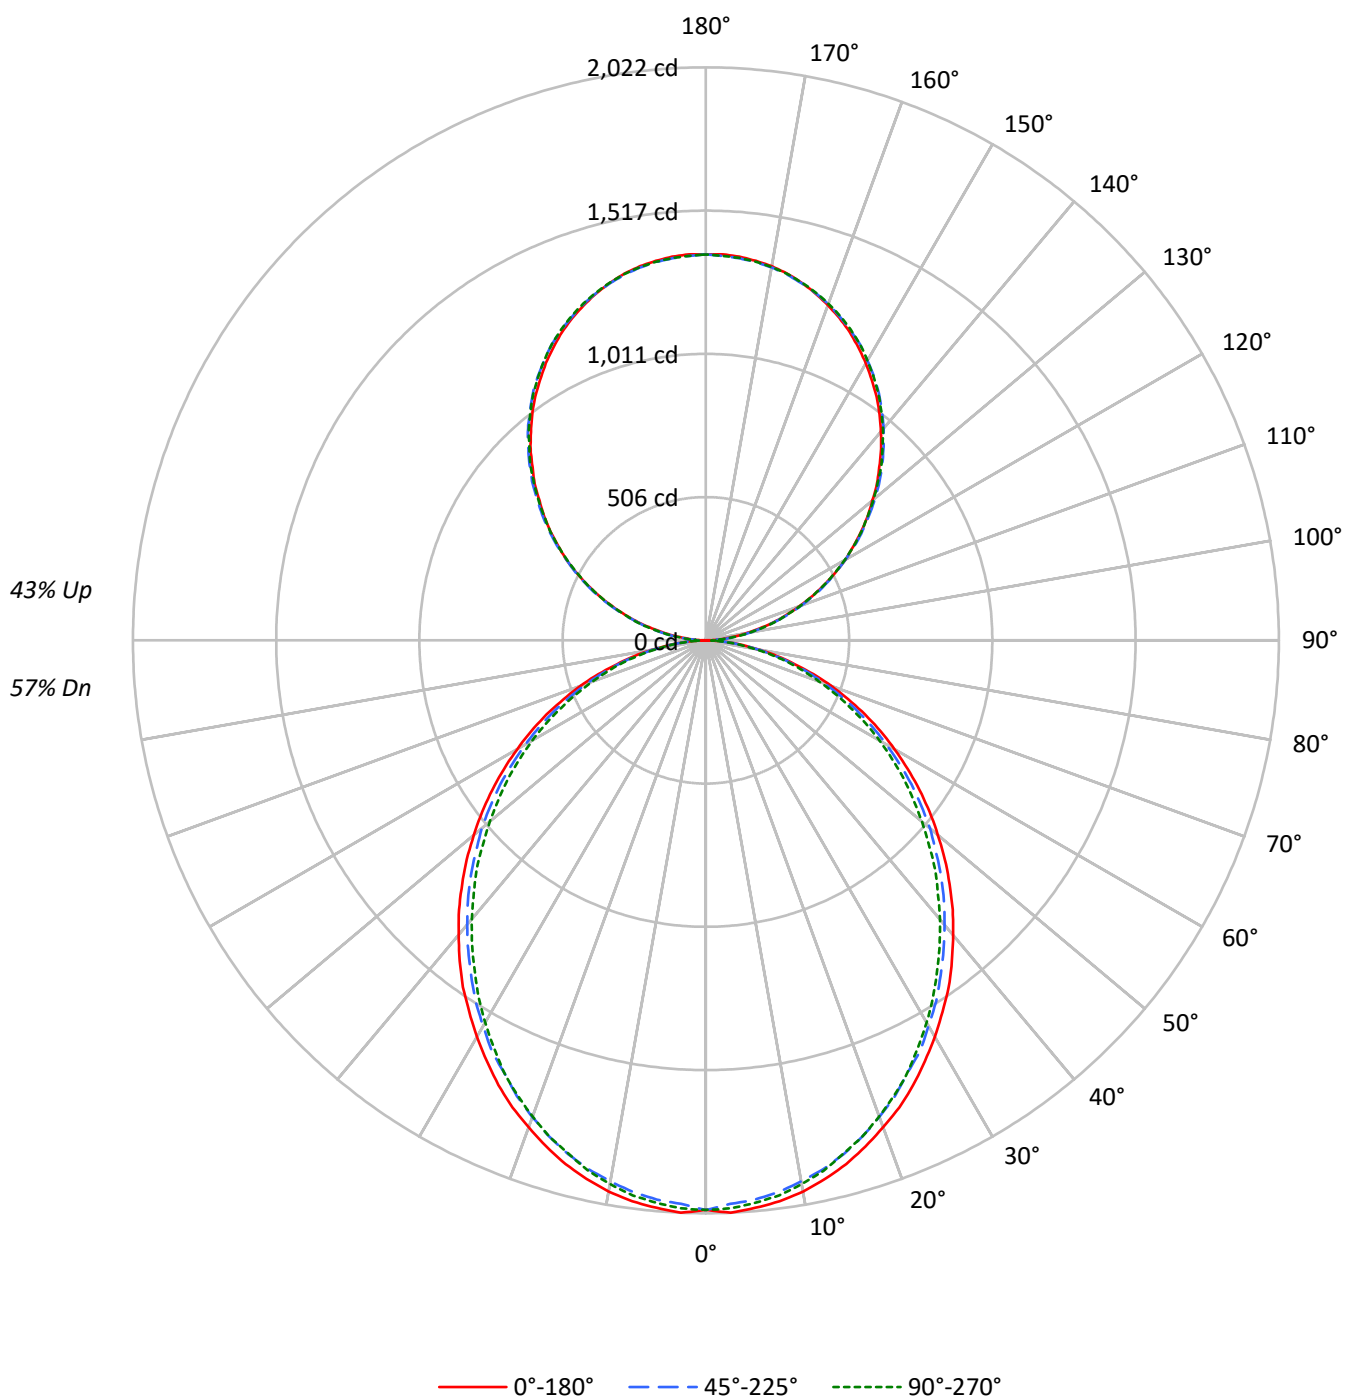

TEST NUMBER: P920056

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	75	75	75	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	56	54	53
2	91	83	77	72	84	78	72	67	67	63	60	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	41	38
4	76	65	57	51	70	61	53	48	53	47	43	46	41	38	39	36	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	32	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	23	30	24	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2303	2303	2303
5°	2305	2270	2286
10°	2285	2237	2254
15°	2250	2199	2205
20°	2203	2146	2155
25°	2157	2084	2097
30°	2099	2025	2023
35°	2043	1956	1945
40°	1975	1887	1871
45°	1908	1817	1796
50°	1834	1744	1708
55°	1756	1659	1627
60°	1668	1559	1535
65°	1572	1455	1425
70°	1450	1327	1308
75°	1281	1175	1198
80°	1077	980	990
85°	757	649	648

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1908 cd/sqm

TEST NUMBER: P920056

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	2.1
10°-20°	532.3	6.0
20°-30°	782.3	8.8
30°-40°	908.6	10.2
40°-50°	907.5	10.2
50°-60°	791.3	8.9
60°-70°	584.9	6.6
70°-80°	330.9	3.7
80°-90°	91.2	1.0
90°-100°	84.2	0.9
100°-110°	267.7	3.0
110°-120°	458.1	5.1
120°-130°	602.5	6.8
130°-140°	676.3	7.6
140°-150°	663.1	7.4
150°-160°	556.3	6.2
160°-170°	368.9	4.1
170°-180°	128.9	1.4
0°-30°	1503.8	16.9
0°-40°	2412.4	27.0
0°-60°	4111.1	46.1
0°-90°	5118.2	57.4
90°-120°	810.0	9.1
90°-150°	2751.9	30.8
90°-180°	3806.0	42.6
0°-180°	8924.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	15	40	38	39	9
95°	60	72	73	73	72	67
105°	247	250	253	255	255	261
115°	460	466	464	463	460	455
125°	669	679	676	672	671	598
135°	865	878	880	879	876	669
145°	1050	1058	1065	1066	1061	656
155°	1201	1204	1208	1213	1210	553
165°	1306	1305	1305	1313	1307	368
175°	1359	1356	1353	1362	1354	129
180°	1362	1362	1362	1362	1362	

TEST NUMBER: P920056

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	1.2	14.8	40.2	37.8	39.0
92.5°	25.5	34.4	35.7	36.9	36.9
95°	59.9	71.5	73.4	73.4	71.5
97.5°	99.7	110.4	114.9	114.9	114.9
100°	145.7	155.2	158.4	158.4	157.2
102.5°	194.2	201.1	205.6	206.9	205.6
105°	247.1	250.4	252.9	254.9	254.9
107.5°	299.6	304.5	304.5	305.4	299.6
110°	350.5	357.1	357.1	357.1	353.8

TEST NUMBER: P920056

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	405.5	412.5	411.3	408.0	405.5
115°	459.7	466.3	464.3	463.0	459.7
117.5°	513.5	522.5	516.8	513.5	510.2
120°	567.7	576.7	567.7	567.7	564.0
122.5°	616.9	628.4	622.7	619.4	616.9
125°	668.7	678.9	675.6	671.9	670.7
127.5°	719.1	731.8	727.4	722.4	719.1
130°	766.4	781.1	779.0	776.6	772.1
132.5°	819.3	830.8	831.6	825.9	822.6
135°	864.9	877.5	880.0	878.8	875.5
137.5°	915.8	926.0	928.1	927.2	922.3
140°	960.4	970.8	976.5	976.5	972.0
142.5°	1006.4	1016.8	1020.0	1021.2	1016.8
145°	1050.0	1058.2	1064.7	1066.0	1061.4
147.5°	1089.0	1099.2	1104.1	1106.2	1101.6
150°	1129.2	1136.2	1140.6	1144.4	1140.6
152.5°	1164.9	1171.9	1177.6	1182.2	1177.6
155°	1200.6	1203.8	1207.5	1213.3	1209.6
157.5°	1231.4	1233.8	1235.9	1244.1	1238.4
160°	1258.9	1261.4	1262.6	1269.5	1264.6
162.5°	1284.4	1284.4	1285.6	1293.4	1287.6
165°	1306.1	1304.8	1304.8	1313.1	1307.3
167.5°	1325.8	1322.1	1322.1	1330.3	1324.6
170°	1340.6	1337.3	1336.1	1344.3	1337.3
172.5°	1350.8	1347.5	1346.3	1354.5	1347.5
175°	1359.1	1355.7	1353.3	1361.5	1354.5
177.5°	1363.6	1360.3	1357.8	1364.8	1357.8
180°	1361.5	1361.5	1361.5	1361.5	1361.5

TEST NUMBER: P920056

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.79	11.72	11.68	12.63	13.79	10.34	11.28	11.23	12.19	13.35
	3H	12.45	13.29	13.35	14.21	15.39	11.96	12.79	12.86	13.72	14.90
	4H	13.04	13.83	13.96	14.75	15.95	12.54	13.33	13.46	14.26	15.46
	6H	13.44	14.17	14.37	15.10	16.31	12.94	13.67	13.87	14.60	15.81
	8H	13.54	14.24	14.48	15.19	16.39	13.04	13.73	13.98	14.68	15.89
	12H	13.59	14.25	14.53	15.20	16.43	13.08	13.74	14.02	14.69	15.92
4H	2H	11.25	12.04	12.18	12.97	14.17	10.90	11.69	11.82	12.62	13.81
	3H	13.12	13.78	14.05	14.74	15.95	12.71	13.37	13.65	14.33	15.54
	4H	13.83	14.44	14.78	15.39	16.62	13.41	14.01	14.35	14.96	16.20
	6H	14.35	14.87	15.31	15.84	17.08	13.92	14.44	14.87	15.41	16.65
	8H	14.50	14.98	15.46	15.95	17.20	14.06	14.55	15.02	15.52	16.77
	12H	14.57	15.01	15.55	16.00	17.25	14.12	14.56	15.10	15.55	16.80
8H	4H	14.03	14.52	14.99	15.49	16.74	13.65	14.14	14.61	15.11	16.36
	6H	14.66	15.06	15.65	16.07	17.32	14.28	14.68	15.26	15.69	16.94
	8H	14.88	15.23	15.87	16.23	17.50	14.48	14.84	15.48	15.84	17.11
	12H	15.01	15.32	16.01	16.32	17.63	14.60	14.91	15.60	15.90	17.22
12H	4H	14.02	14.46	15.00	15.44	16.70	13.65	14.09	14.63	15.08	16.33
	6H	14.69	15.04	15.68	16.04	17.31	14.32	14.67	15.31	15.67	16.94
	8H	14.93	15.24	15.93	16.24	17.55	14.55	14.86	15.55	15.85	17.17