

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922793

Luminaire Tested: DFN2DIP-SQ3F0-060D070US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922793
REPORT IS A COMBINATION OF REPORTS P901439 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D070US940-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11476.3 lumens
Efficiency: N/A
Efficacy: 108.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 105.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922793

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-FLLONL

Luminous Intensity Polar Plot

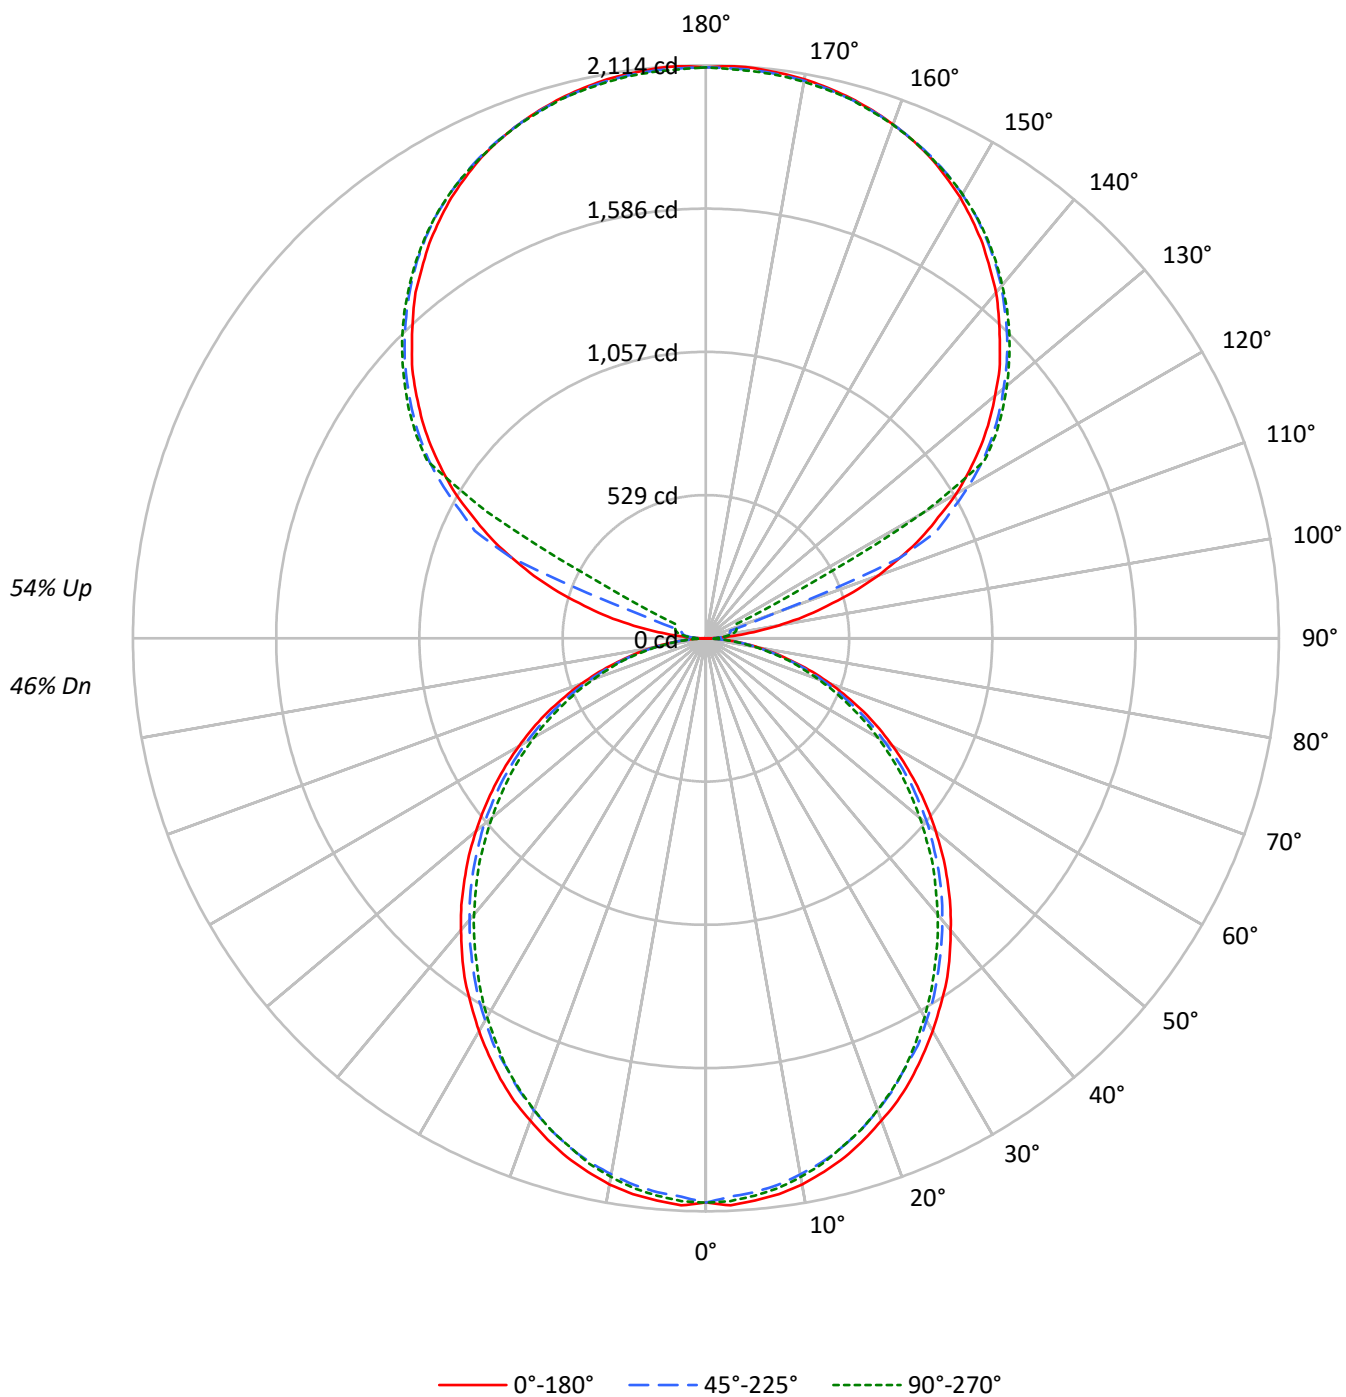

TEST NUMBER: P922793

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	89	85	89	85	82	79	71	69	67	58	57	55	46	45	44
2	88	81	75	70	81	74	69	65	62	59	55	51	48	46	41	39	37
3	81	71	64	58	74	66	59	54	55	50	46	45	42	39	36	34	32
4	74	63	55	49	67	58	51	46	49	44	40	40	37	33	32	30	27
5	68	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	33	29	25	26	23	21
7	58	45	37	32	53	42	35	30	36	30	26	30	26	22	24	21	19
8	53	41	33	28	49	38	31	26	33	27	23	27	23	20	22	19	17
9	50	38	30	25	46	35	28	24	30	24	21	25	21	18	21	17	15
10	46	34	27	22	43	32	26	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2385	2385	2385
5°	2388	2350	2367
10°	2367	2317	2334
15°	2330	2278	2284
20°	2282	2223	2231
25°	2234	2158	2171
30°	2173	2097	2095
35°	2116	2026	2015
40°	2046	1954	1938
45°	1976	1882	1860
50°	1899	1806	1769
55°	1819	1718	1685
60°	1728	1614	1589
65°	1629	1506	1476
70°	1502	1375	1354
75°	1327	1217	1240
80°	1115	1015	1025
85°	784	672	671

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1976 cd/sqm

TEST NUMBER: P922793

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	1.7
10°-20°	551.3	4.8
20°-30°	810.2	7.1
30°-40°	941.0	8.2
40°-50°	939.8	8.2
50°-60°	819.5	7.1
60°-70°	605.8	5.3
70°-80°	342.7	3.0
80°-90°	94.2	0.8
90°-100°	69.5	0.6
100°-110°	259.0	2.3
110°-120°	686.8	6.0
120°-130°	1139.1	9.9
130°-140°	1209.9	10.5
140°-150°	1124.5	9.8
150°-160°	904.1	7.9
160°-170°	582.6	5.1
170°-180°	200.5	1.7
0°-30°	1557.4	13.6
0°-40°	2498.4	21.8
0°-60°	4257.8	37.1
0°-90°	5300.5	46.2
90°-120°	1015.2	8.8
90°-150°	4488.7	39.1
90°-180°	6176.0	53.8
0°-180°	11476.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	1	18	30	38	41	11
95°	99	49	59	67	66	117
105°	463	509	93	110	116	495
115°	876	902	940	235	125	863
125°	1239	1259	1288	1299	1303	1105
135°	1534	1558	1572	1587	1584	1185
145°	1779	1777	1803	1814	1806	1113
155°	1959	1945	1963	1972	1960	903
165°	2064	2055	2059	2070	2059	583
175°	2111	2100	2104	2114	2099	201
180°	2107	2107	2107	2107	2107	

TEST NUMBER: P922793

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	1.4	18.3	30.4	38.2	41.1
92.5°	38.2	32.0	36.6	39.7	41.1
95°	99.0	48.7	59.4	67.1	65.5
97.5°	178.3	53.4	77.7	82.4	83.8
100°	269.9	61.0	86.9	99.0	102.1
102.5°	370.3	367.5	90.0	106.6	111.3
105°	463.4	509.2	93.0	109.7	115.8
107.5°	571.6	609.7	96.1	112.8	119.0
110°	675.4	707.2	266.8	114.4	120.4

TEST NUMBER: P922793

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	772.9	800.2	774.4	117.3	122.0
115°	876.5	902.3	940.5	234.8	125.1
117.5°	966.4	996.8	1022.9	804.8	405.5
120°	1067.0	1089.8	1117.4	1135.7	929.9
122.5°	1152.3	1176.7	1207.4	1216.4	1218.0
125°	1239.2	1259.1	1288.1	1298.8	1303.2
127.5°	1318.5	1339.8	1362.8	1378.0	1379.5
130°	1393.2	1417.6	1434.3	1451.2	1449.7
132.5°	1469.4	1489.3	1506.0	1519.7	1518.3
135°	1533.5	1557.9	1571.6	1586.9	1583.9
137.5°	1600.4	1618.8	1634.1	1649.4	1644.8
140°	1666.0	1678.3	1695.0	1708.7	1701.1
142.5°	1721.0	1731.7	1751.4	1763.5	1756.0
145°	1779.0	1777.4	1803.2	1813.9	1806.3
147.5°	1829.1	1824.6	1850.5	1858.1	1852.1
150°	1877.9	1867.3	1891.8	1900.8	1893.2
152.5°	1919.0	1906.9	1929.8	1938.9	1928.3
155°	1958.7	1945.1	1963.4	1972.5	1960.3
157.5°	1990.7	1978.6	1992.3	2003.0	1990.7
160°	2018.3	2009.0	2018.3	2027.3	2016.6
162.5°	2042.6	2033.5	2041.0	2051.7	2038.0
165°	2063.9	2054.9	2059.3	2070.0	2059.3
167.5°	2080.7	2071.4	2076.2	2086.9	2073.1
170°	2094.4	2085.3	2088.3	2099.0	2085.3
172.5°	2103.5	2094.4	2097.6	2108.2	2094.4
175°	2111.1	2100.4	2103.5	2114.2	2099.0
177.5°	2114.2	2103.5	2105.1	2115.9	2102.0
180°	2106.6	2106.6	2106.6	2106.6	2106.6

TEST NUMBER: P922793

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.90	10.72	10.88	11.72	13.05	9.45	10.28	10.44	11.28	12.61
	3H	11.55	12.29	12.55	13.30	14.65	11.06	11.80	12.06	12.81	14.16
	4H	12.13	12.83	13.14	13.85	15.20	11.64	12.34	12.65	13.35	14.71
	6H	12.53	13.17	13.55	14.19	15.56	12.03	12.67	13.05	13.69	15.06
	8H	12.63	13.24	13.66	14.28	15.64	12.13	12.74	13.16	13.78	15.14
	12H	12.67	13.26	13.71	14.29	15.68	12.16	12.75	13.20	13.78	15.17
4H	2H	10.35	11.05	11.37	12.07	13.42	9.99	10.70	11.01	11.71	13.06
	3H	12.21	12.79	13.23	13.83	15.20	11.80	12.38	12.83	13.43	14.79
	4H	12.92	13.45	13.95	14.49	15.88	12.49	13.03	13.53	14.06	15.45
	6H	13.42	13.89	14.47	14.94	16.33	12.99	13.45	14.04	14.51	15.90
	8H	13.57	14.00	14.62	15.05	16.45	13.13	13.56	14.18	14.61	16.02
	12H	13.64	14.03	14.70	15.09	16.50	13.19	13.58	14.26	14.65	16.05
8H	4H	13.10	13.54	14.15	14.59	15.99	12.73	13.16	13.77	14.21	15.61
	6H	13.73	14.09	14.80	15.18	16.58	13.34	13.70	14.41	14.79	16.19
	8H	13.95	14.26	15.02	15.34	16.75	13.55	13.87	14.63	14.94	16.36
	12H	14.07	14.35	15.15	15.42	16.88	13.66	13.94	14.74	15.01	16.47
12H	4H	13.09	13.48	14.15	14.54	15.95	12.72	13.11	13.78	14.17	15.58
	6H	13.76	14.07	14.83	15.15	16.56	13.38	13.70	14.46	14.77	16.19
	8H	13.99	14.27	15.07	15.34	16.80	13.61	13.89	14.69	14.96	16.42

END OF REPORT