

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922985

Luminaire Tested: DFN2DIP-SQ3F0-110D100US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922985
REPORT IS A COMBINATION OF REPORTS P901503 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D100US940-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18538.7 lumens
Efficiency: N/A
Efficacy: 97.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 189.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922985

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US940-FLLONL

Luminous Intensity Polar Plot

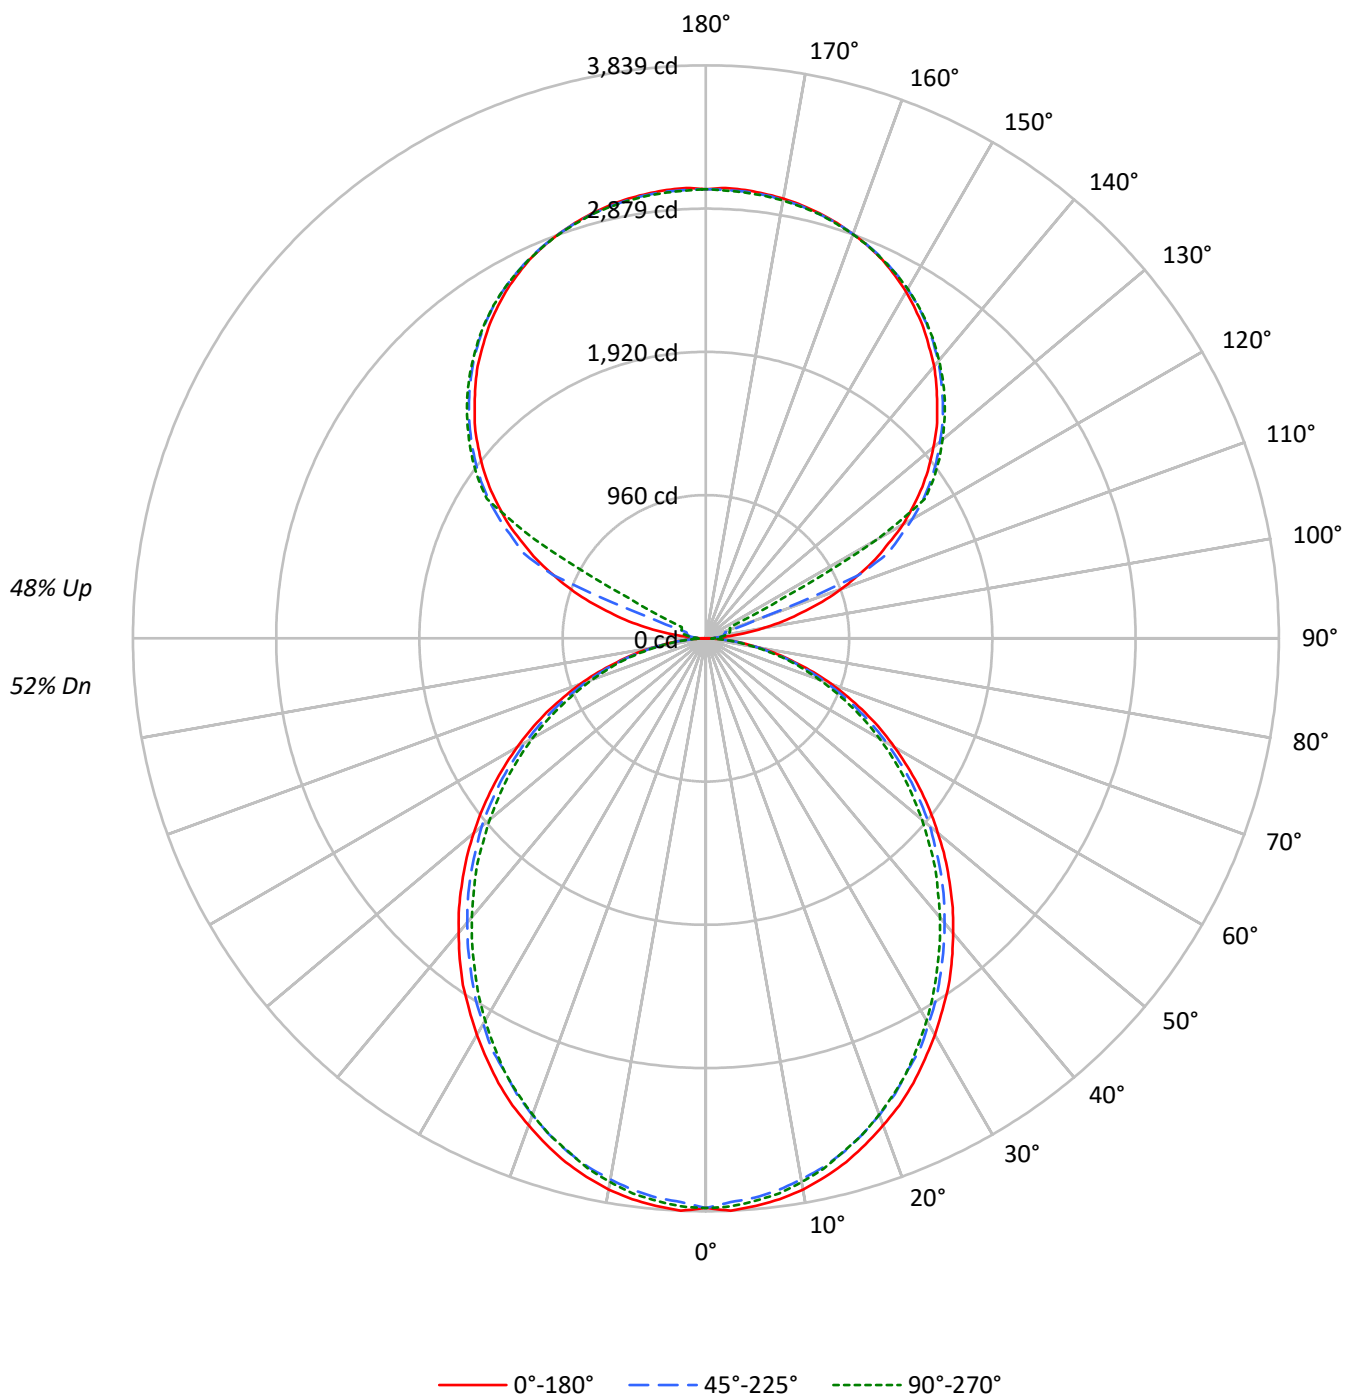

TEST NUMBER: P922985

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	58	58	58
1	98	94	90	87	91	87	84	81	74	72	70	62	61	59	52	50	49
2	90	82	76	71	83	76	71	66	65	61	58	55	52	49	45	43	42
3	82	72	65	59	75	67	61	55	57	53	48	49	45	42	40	38	35
4	75	64	56	50	69	59	52	47	51	46	41	43	39	36	36	33	30
5	69	57	49	43	63	53	46	40	46	40	36	39	34	31	32	29	27
6	63	51	43	37	58	48	40	35	41	35	31	35	31	27	29	26	23
7	58	46	38	33	54	43	36	31	37	32	27	32	27	24	27	23	21
8	54	42	34	29	50	39	32	27	34	28	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	22	19	23	19	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4373	4373	4373
5°	4377	4309	4340
10°	4339	4248	4280
15°	4273	4175	4186
20°	4183	4075	4091
25°	4095	3956	3981
30°	3984	3845	3841
35°	3880	3715	3694
40°	3751	3583	3553
45°	3623	3450	3409
50°	3482	3311	3243
55°	3335	3150	3089
60°	3168	2960	2914
65°	2985	2762	2706
70°	2753	2520	2483
75°	2433	2231	2274
80°	2045	1861	1880
85°	1439	1233	1230

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3623 cd/sqm

TEST NUMBER: P922985

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	359.2	1.9
10°-20°	1010.7	5.5
20°-30°	1485.4	8.0
30°-40°	1725.2	9.3
40°-50°	1723.0	9.3
50°-60°	1502.4	8.1
60°-70°	1110.6	6.0
70°-80°	628.4	3.4
80°-90°	171.2	0.9
90°-100°	99.2	0.5
100°-110°	369.9	2.0
110°-120°	981.1	5.3
120°-130°	1627.2	8.8
130°-140°	1728.5	9.3
140°-150°	1606.5	8.7
150°-160°	1291.5	7.0
160°-170°	832.2	4.5
170°-180°	286.4	1.5
0°-30°	2855.3	15.4
0°-40°	4580.5	24.7
0°-60°	7805.9	42.1
0°-90°	9716.1	52.4
90°-120°	1450.3	7.8
90°-150°	6412.5	34.6
90°-180°	8823.0	47.6
0°-180°	18538.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3817	3817	3817	3817	3817	
5°	3817	3802	3762	3791	3784	362
15°	3633	3611	3564	3578	3560	1023
25°	3288	3259	3197	3204	3197	1513
35°	2837	2800	2742	2719	2701	1772
45°	2309	2283	2228	2188	2173	1782
55°	1747	1725	1681	1637	1619	1562
65°	1178	1156	1120	1086	1068	1165
75°	616	609	591	569	576	658
85°	150	147	143	132	128	168
90°	2	26	43	55	59	17
95°	141	70	85	96	94	168
105°	662	727	133	157	166	707
115°	1252	1289	1344	335	179	1233
125°	1770	1799	1840	1855	1862	1579
135°	2191	2226	2245	2267	2263	1692
145°	2541	2539	2576	2591	2580	1589
155°	2798	2779	2805	2818	2800	1289
165°	2948	2935	2942	2957	2942	833
175°	3016	3001	3005	3020	2999	287
180°	3009	3009	3009	3009	3009	

TEST NUMBER: P922985

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US940-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3816.7	3816.7	3816.7	3816.7	3816.7
2.5°	3838.8	3820.5	3780.0	3816.7	3809.7
5°	3816.7	3802.3	3761.8	3790.9	3784.0
7.5°	3790.9	3769.2	3728.7	3758.3	3750.9
10°	3750.9	3725.1	3681.2	3710.3	3699.4
12.5°	3695.6	3673.8	3629.8	3648.1	3640.7
15°	3633.3	3611.4	3563.5	3578.3	3560.1
17.5°	3556.1	3534.4	3486.5	3504.8	3486.5
20°	3471.7	3449.8	3398.5	3409.4	3395.0
22.5°	3387.6	3354.4	3306.6	3306.6	3299.1
25°	3288.3	3259.1	3196.8	3203.8	3196.8
27.5°	3178.1	3152.4	3104.8	3094.0	3075.7
30°	3068.3	3038.7	2983.8	2972.9	2958.1
32.5°	2950.7	2928.9	2870.1	2847.9	2833.1
35°	2837.0	2800.4	2741.6	2719.4	2701.1
37.5°	2708.5	2675.4	2616.6	2590.9	2572.6
40°	2576.5	2546.9	2488.1	2455.4	2440.6
42.5°	2448.0	2418.4	2360.0	2323.0	2301.2
45°	2308.6	2282.9	2227.6	2187.5	2172.7
47.5°	2172.7	2147.1	2088.2	2047.7	2025.9
50°	2029.4	2011.2	1959.7	1908.3	1890.1
52.5°	1890.1	1864.3	1816.9	1776.3	1750.6
55°	1747.1	1724.9	1681.0	1636.9	1618.6
57.5°	1603.8	1585.6	1537.7	1493.6	1478.8
60°	1460.5	1446.2	1394.7	1354.2	1343.4
62.5°	1321.2	1295.5	1258.8	1222.3	1207.5
65°	1178.2	1156.0	1119.5	1086.4	1068.1
67.5°	1031.4	1012.8	980.1	954.4	939.6
70°	895.5	880.7	847.7	822.0	807.5
72.5°	756.2	741.4	723.1	697.4	686.4
75°	616.4	609.4	590.7	568.9	576.3
77.5°	491.8	477.0	469.6	458.7	447.8
80°	367.2	363.3	355.9	345.0	337.6
82.5°	249.6	249.6	246.1	231.3	231.3
85°	150.3	146.8	143.3	132.0	128.5
87.5°	66.2	58.8	51.4	40.5	36.6
90°	2.1	26.1	43.4	54.6	58.7
92.5°	54.6	45.7	52.3	56.6	58.7
95°	141.4	69.6	84.8	95.9	93.6
97.5°	254.7	76.2	110.9	117.6	119.8
100°	385.6	87.1	124.1	141.4	145.9
102.5°	529.1	524.9	128.5	152.3	159.0
105°	662.0	727.4	133.0	156.7	165.5
107.5°	816.6	870.9	137.3	161.1	169.9
110°	964.7	1010.3	381.1	163.5	171.9

TEST NUMBER: P922985

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US940-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1104.1	1143.2	1106.3	167.6	174.3
115°	1252.1	1289.1	1343.6	335.4	178.7
117.5°	1380.5	1424.1	1461.2	1149.7	579.3
120°	1524.4	1556.9	1596.3	1622.4	1328.4
122.5°	1646.2	1681.1	1724.7	1737.7	1740.0
125°	1770.3	1798.8	1840.1	1855.4	1861.8
127.5°	1883.6	1914.1	1946.9	1968.6	1970.7
130°	1990.3	2025.3	2049.1	2073.0	2071.0
132.5°	2099.2	2127.6	2151.4	2171.0	2169.0
135°	2190.8	2225.6	2245.1	2267.0	2262.6
137.5°	2286.4	2312.6	2334.5	2356.3	2349.7
140°	2380.0	2397.6	2421.4	2441.1	2430.2
142.5°	2458.6	2473.9	2502.1	2519.3	2508.6
145°	2541.4	2539.1	2576.1	2591.3	2580.4
147.5°	2613.0	2606.6	2643.5	2654.4	2645.9
150°	2682.8	2667.6	2702.5	2715.4	2704.6
152.5°	2741.5	2724.2	2756.8	2769.9	2754.7
155°	2798.2	2778.7	2804.9	2817.8	2800.5
157.5°	2843.9	2826.6	2846.3	2861.5	2843.9
160°	2883.3	2870.1	2883.3	2896.2	2880.9
162.5°	2917.9	2904.9	2915.8	2931.1	2911.4
165°	2948.4	2935.4	2941.9	2957.2	2941.9
167.5°	2972.4	2959.2	2966.0	2981.3	2961.5
170°	2992.0	2978.9	2983.3	2998.6	2978.9
172.5°	3005.0	2992.0	2996.5	3011.8	2992.0
175°	3015.9	3000.6	3005.0	3020.3	2998.6
177.5°	3020.3	3005.0	3007.4	3022.6	3002.9
180°	3009.4	3009.4	3009.4	3009.4	3009.4

TEST NUMBER: P922985

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.58	13.47	13.52	14.42	15.66	12.14	13.02	13.08	13.98	15.21
	3H	14.24	15.03	15.19	16.00	17.26	13.75	14.54	14.70	15.51	16.77
	4H	14.83	15.58	15.79	16.54	17.81	14.33	15.08	15.30	16.05	17.32
	6H	15.23	15.92	16.20	16.89	18.17	14.72	15.42	15.70	16.39	17.67
	8H	15.33	15.99	16.31	16.98	18.25	14.83	15.49	15.81	16.47	17.75
	12H	15.38	16.00	16.36	16.99	18.29	14.87	15.49	15.85	16.48	17.78
4H	2H	13.04	13.79	14.01	14.76	16.03	12.69	13.44	13.66	14.41	15.67
	3H	14.91	15.53	15.88	16.53	17.81	14.50	15.12	15.48	16.12	17.40
	4H	15.62	16.19	16.60	17.18	18.49	15.19	15.77	16.18	16.76	18.06
	6H	16.13	16.62	17.13	17.64	18.94	15.70	16.19	16.70	17.20	18.51
	8H	16.28	16.74	17.28	17.75	19.06	15.84	16.30	16.84	17.31	18.63
	12H	16.35	16.77	17.37	17.79	19.11	15.90	16.32	16.92	17.34	18.66
8H	4H	15.81	16.27	16.81	17.28	18.60	15.44	15.90	16.44	16.90	18.22
	6H	16.44	16.82	17.46	17.87	19.19	16.05	16.44	17.08	17.48	18.80
	8H	16.66	16.99	17.69	18.03	19.36	16.26	16.60	17.30	17.63	18.97
	12H	16.79	17.08	17.82	18.11	19.49	16.37	16.67	17.41	17.70	19.08
12H	4H	15.80	16.21	16.82	17.24	18.56	15.43	15.85	16.45	16.87	18.19
	6H	16.47	16.80	17.50	17.84	19.17	16.09	16.43	17.13	17.47	18.80
	8H	16.71	17.00	17.74	18.03	19.41	16.33	16.62	17.36	17.65	19.03