

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906955

Luminaire Tested: DFN2DIP-SQ4F0-160D060US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906955
REPORT IS A COMBINATION OF REPORTS P901596 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D060US835-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19540.0 lumens
Efficiency: N/A
Efficacy: 92.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 211.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906955

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US835-RLLONL

Luminous Intensity Polar Plot

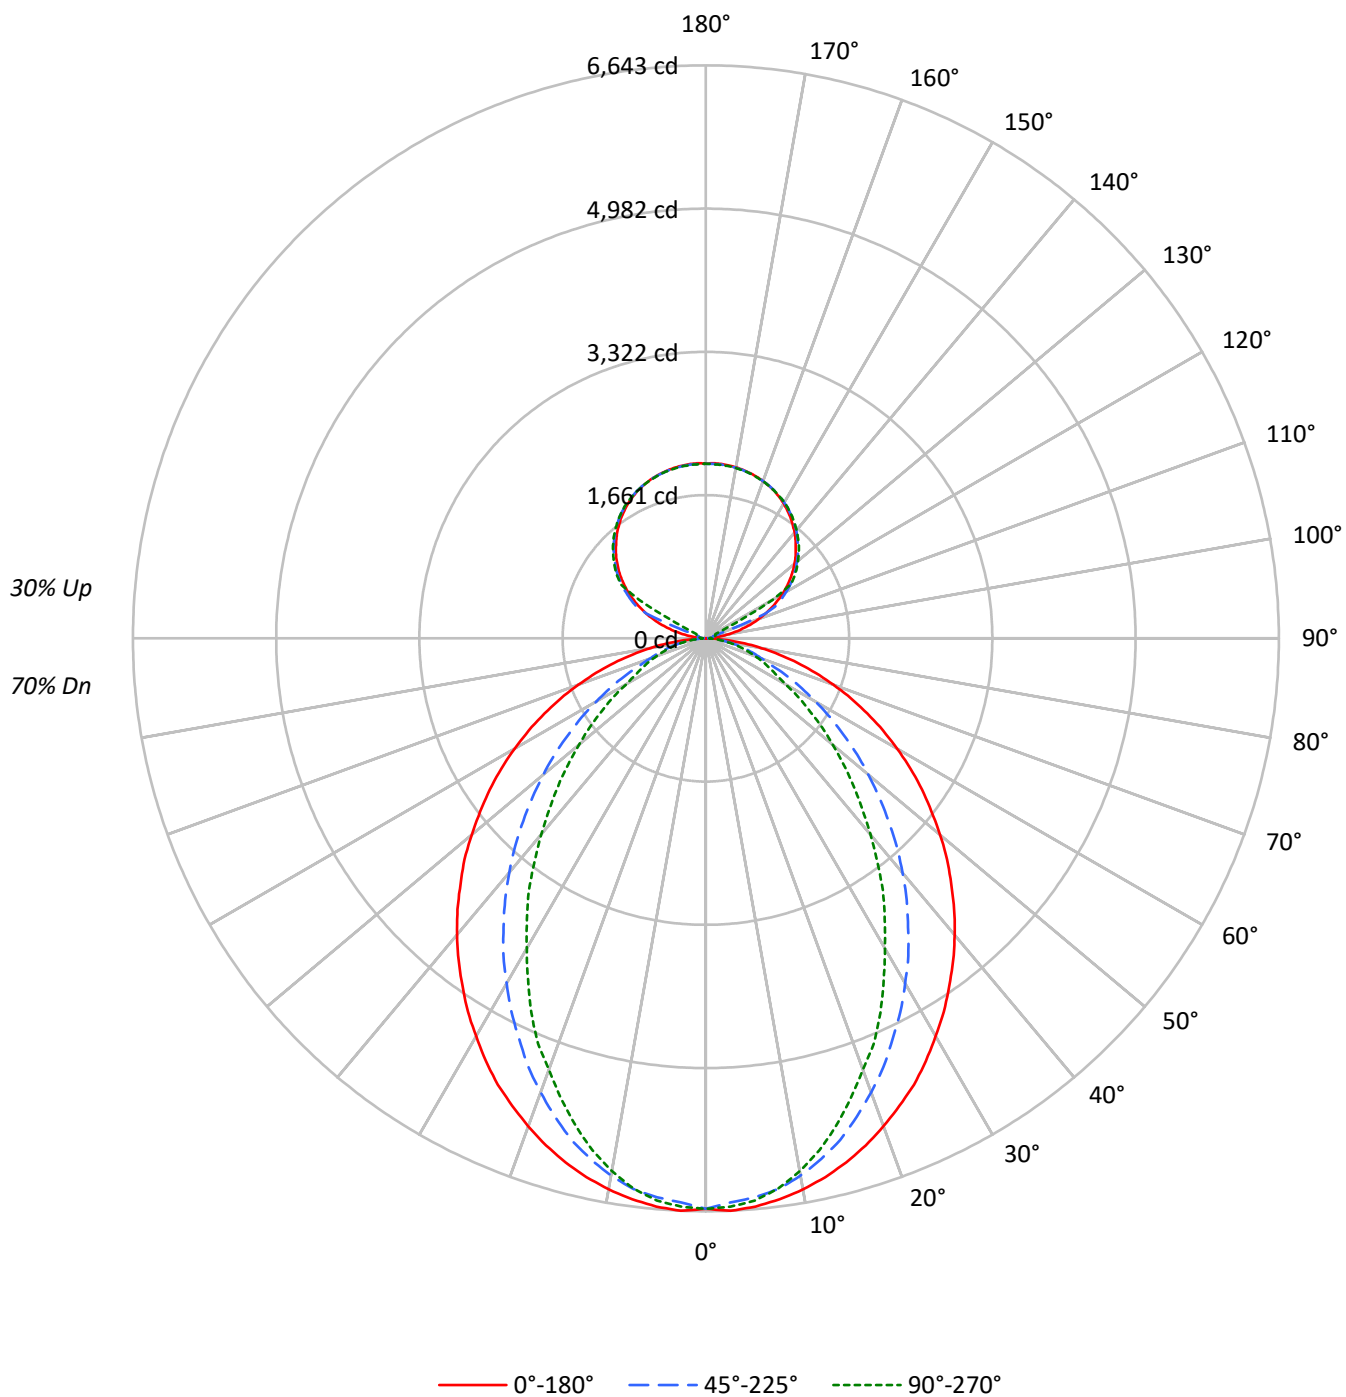

TEST NUMBER: P906955

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	84	84	84	74	74	74
1	103	99	95	92	97	93	90	87	84	81	79	75	73	71	67	65	64
2	94	87	81	76	89	83	77	73	74	70	67	67	63	61	59	57	55
3	86	77	70	64	82	73	67	62	66	61	57	59	55	52	53	50	48
4	79	69	61	55	75	65	58	53	59	54	49	53	49	45	48	45	42
5	73	62	54	48	69	59	52	46	53	47	43	48	44	40	44	40	37
6	68	56	48	42	64	53	46	41	49	42	38	44	39	35	40	36	33
7	63	51	43	37	60	49	41	36	44	38	34	40	35	32	37	32	29
8	59	46	39	33	56	44	37	32	41	35	30	37	32	28	34	30	27
9	55	43	35	30	52	41	34	29	37	32	27	34	29	26	31	27	24
10	51	39	32	27	49	38	31	26	35	29	25	32	27	24	29	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4640	4640	4640
5°	4647	4567	4597
10°	4601	4479	4449
15°	4538	4331	4219
20°	4454	4128	3936
25°	4368	3900	3663
30°	4253	3667	3316
35°	4140	3415	3011
40°	4025	3155	2662
45°	3891	2866	2345
50°	3753	2574	2035
55°	3609	2262	1738
60°	3442	1936	1432
65°	3250	1605	1290
70°	3017	1295	1170
75°	2725	1144	1067
80°	2302	963	930
85°	1602	648	709

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3891 cd/sqm

TEST NUMBER: P906955

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	619.8	3.2
10°-20°	1701.4	8.7
20°-30°	2388.6	12.2
30°-40°	2603.8	13.3
40°-50°	2393.2	12.2
50°-60°	1879.5	9.6
60°-70°	1223.3	6.3
70°-80°	629.7	3.2
80°-90°	164.3	0.8
90°-100°	66.8	0.3
100°-110°	248.9	1.3
110°-120°	660.2	3.4
120°-130°	1094.9	5.6
130°-140°	1163.0	6.0
140°-150°	1080.9	5.5
150°-160°	869.0	4.4
160°-170°	560.0	2.9
170°-180°	192.7	1.0
0°-30°	4709.8	24.1
0°-40°	7313.5	37.4
0°-60°	11586.2	59.3
0°-90°	13603.6	69.6
90°-120°	975.8	5.0
90°-150°	4314.7	22.1
90°-180°	5936.0	30.4
0°-180°	19540.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	6613	6613	6613	6613	6613	
5°	6613	6583	6505	6559	6541	627
15°	6290	6224	6020	5907	5847	1772
25°	5709	5518	5123	4878	4787	2626
35°	4919	4614	4088	3710	3578	3079
45°	4022	3620	2992	2567	2424	3106
55°	3058	2591	1945	1586	1472	2732
65°	2065	1580	1041	838	820	2047
75°	1101	682	479	437	431	1164
85°	257	131	114	114	114	295
90°	1	18	29	37	40	19
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	

TEST NUMBER: P906955

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	6612.8	6612.8	6612.8	6612.8	6612.8
2.5°	6642.6	6612.8	6546.7	6607.1	6595.0
5°	6612.8	6582.9	6504.8	6558.8	6541.0
7.5°	6558.8	6523.2	6439.4	6462.9	6433.1
10°	6487.1	6445.2	6325.8	6307.4	6271.8
12.5°	6397.5	6343.6	6181.7	6146.1	6080.1
15°	6289.6	6223.6	6020.4	5906.7	5847.0
17.5°	6163.9	6068.0	5816.6	5685.1	5589.3
20°	6020.4	5900.4	5601.3	5452.1	5320.1
22.5°	5864.8	5727.0	5379.7	5176.6	5087.0
25°	5709.3	5517.5	5122.6	4877.5	4787.4
27.5°	5523.9	5320.1	4883.2	4602.0	4464.2
30°	5326.4	5098.5	4619.7	4315.0	4153.1
32.5°	5134.7	4859.1	4368.9	4009.6	3859.7
35°	4919.4	4614.0	4087.7	3710.5	3578.5
37.5°	4709.9	4380.4	3824.2	3410.8	3261.6
40°	4488.3	4129.6	3548.6	3123.8	2968.3
42.5°	4261.0	3878.1	3273.7	2830.5	2681.3
45°	4021.6	3620.4	2992.4	2567.0	2423.5
47.5°	3794.3	3369.6	2723.2	2297.8	2166.4
50°	3542.9	3118.1	2459.7	2046.4	1921.3
52.5°	3297.2	2848.3	2208.3	1813.4	1699.7
55°	3057.8	2591.1	1944.8	1586.0	1472.4
57.5°	2812.7	2334.0	1711.8	1376.5	1280.6
60°	2561.3	2082.6	1466.0	1161.3	1065.4
62.5°	2316.2	1837.5	1256.5	969.5	921.9
65°	2064.8	1579.7	1041.3	838.1	819.7
67.5°	1825.4	1340.3	838.1	735.9	718.1
70°	1574.0	1107.3	694.0	634.3	610.2
72.5°	1334.6	891.4	580.3	532.7	520.6
75°	1101.0	681.9	478.7	436.8	431.1
77.5°	867.9	484.4	377.1	353.0	341.0
80°	652.1	347.3	287.0	263.5	263.5
82.5°	454.6	233.7	197.5	185.4	185.4
85°	257.1	131.4	113.7	113.7	113.7
87.5°	95.9	47.6	47.6	41.9	41.9
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7

TEST NUMBER: P906955

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9

TEST NUMBER: P906955

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.15	15.18	14.93	15.97	16.93	10.12	11.14	10.89	11.93	12.89
	3H	15.85	16.76	16.64	17.57	18.56	11.32	12.23	12.11	13.03	14.03
	4H	16.47	17.33	17.28	18.14	19.15	11.78	12.64	12.59	13.45	14.46
	6H	16.91	17.70	17.73	18.52	19.54	12.11	12.90	12.93	13.72	14.74
	8H	17.04	17.79	17.87	18.63	19.65	12.21	12.96	13.03	13.80	14.82
	12H	17.11	17.83	17.94	18.66	19.70	12.26	12.97	13.09	13.81	14.85
4H	2H	14.20	15.06	15.01	15.87	16.87	10.74	11.60	11.55	12.41	13.41
	3H	16.05	16.76	16.87	17.61	18.63	12.10	12.82	12.93	13.66	14.69
	4H	16.75	17.40	17.59	18.24	19.29	12.66	13.31	13.50	14.15	15.20
	6H	17.28	17.84	18.13	18.71	19.76	13.09	13.65	13.94	14.52	15.57
	8H	17.46	17.98	18.32	18.85	19.91	13.22	13.75	14.08	14.61	15.68
	12H	17.57	18.04	18.44	18.92	19.99	13.30	13.77	14.17	14.65	15.72
8H	4H	16.73	17.26	17.59	18.12	19.18	12.96	13.48	13.81	14.34	15.41
	6H	17.31	17.74	18.19	18.65	19.71	13.48	13.92	14.37	14.82	15.89
	8H	17.53	17.91	18.42	18.81	19.90	13.68	14.06	14.57	14.96	16.04
	12H	17.68	18.02	18.58	18.91	20.05	13.80	14.14	14.70	15.03	16.17
12H	4H	16.69	17.16	17.57	18.05	19.12	12.97	13.44	13.85	14.32	15.40
	6H	17.29	17.67	18.18	18.57	19.65	13.53	13.92	14.43	14.82	15.90
	8H	17.52	17.86	18.41	18.75	19.88	13.76	14.09	14.65	14.98	16.12

END OF REPORT