

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923327

Luminaire Tested: DFN2DIP-SQ4F0-160D070US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923327
REPORT IS A COMBINATION OF REPORTS P901614 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D070US940-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18306.8 lumens
Efficiency: N/A
Efficacy: 83.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 218.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923327

CATALOG NUMBER: DFN2DIP-SQ4F0-160D070US940-RLLONL

Luminous Intensity Polar Plot

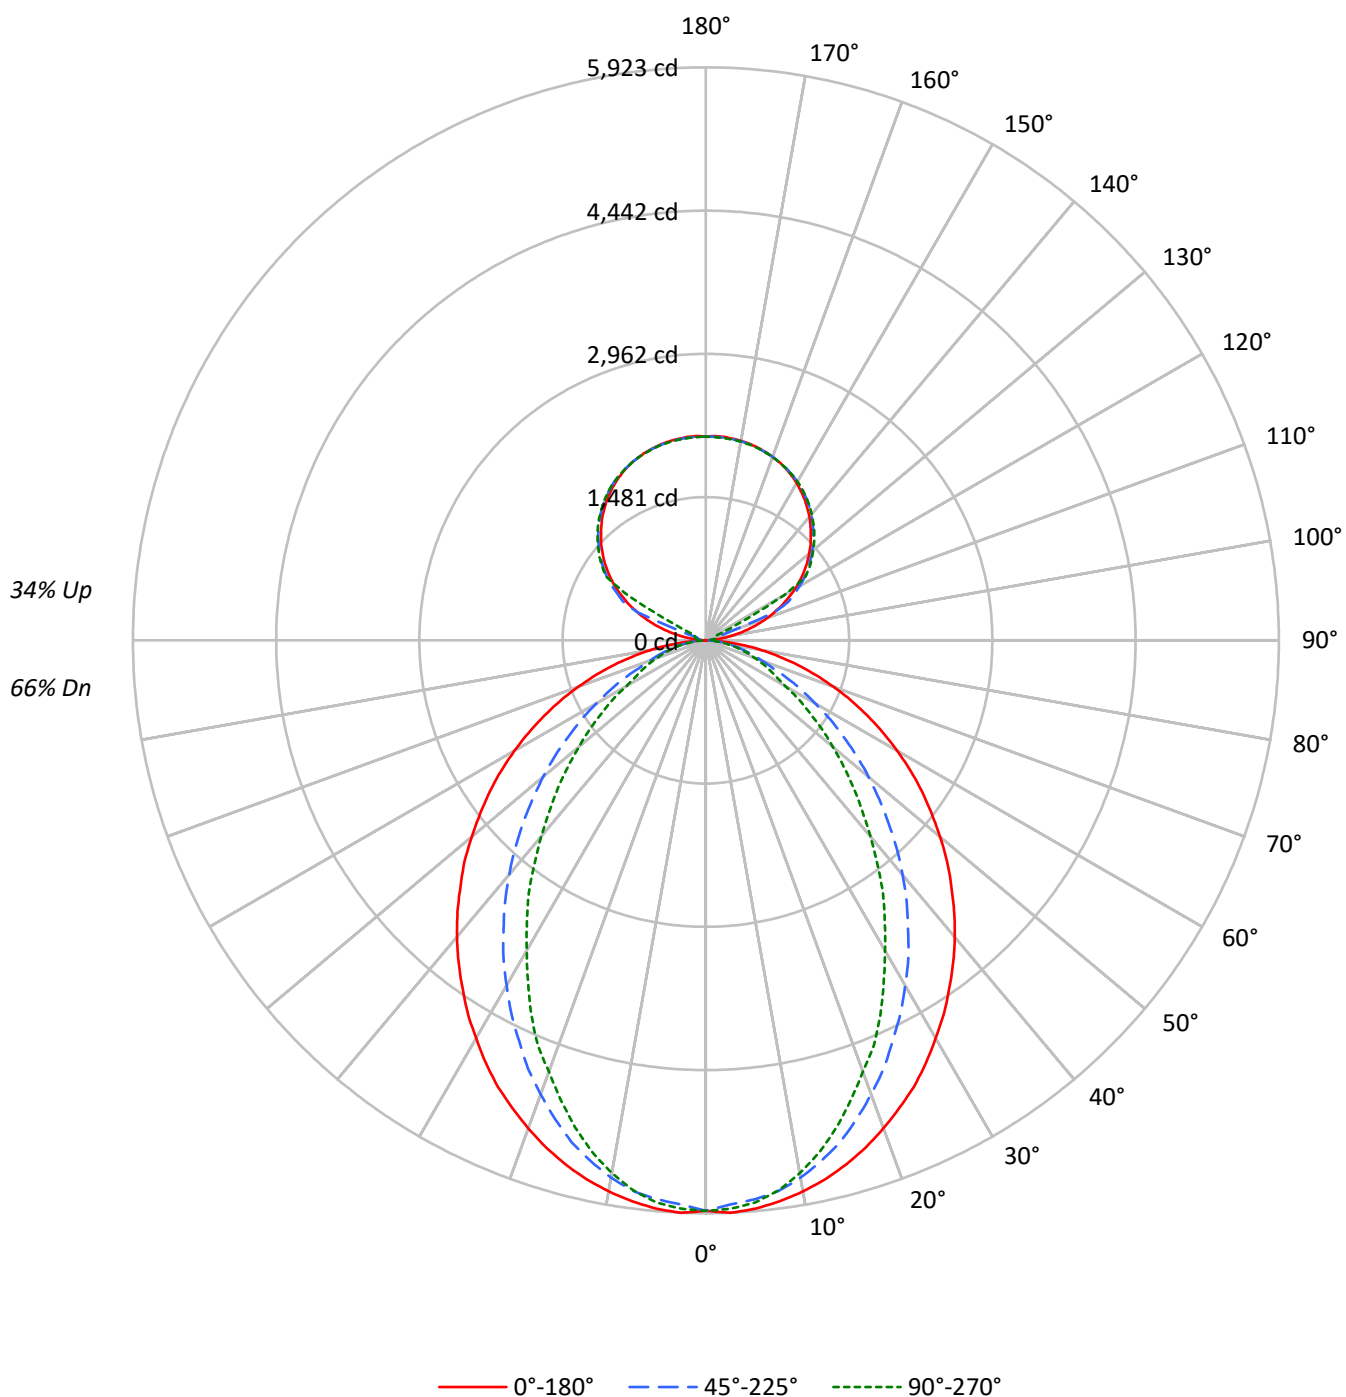

TEST NUMBER: P923327

CATALOG NUMBER: DFN2DIP-SQ4F0-160D070US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	92	92	92	81	81	81	71	71	71
1	102	98	94	91	96	92	89	86	82	80	77	73	71	69	64	63	61
2	93	86	80	75	88	82	76	72	73	69	65	65	61	59	57	55	53
3	86	76	69	64	81	72	66	61	65	60	56	58	54	50	51	48	46
4	79	68	60	54	74	65	58	52	58	52	48	52	47	44	46	43	40
5	73	61	53	47	68	58	51	45	52	46	42	47	42	38	42	38	35
6	67	55	47	41	63	53	45	40	47	41	37	43	38	34	38	34	31
7	62	50	42	37	59	48	41	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	37	32	40	34	30	36	31	27	32	28	25
9	54	42	35	30	51	40	33	29	37	31	27	33	28	25	30	26	23
10	51	39	32	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4138	4138	4138
5°	4144	4073	4099
10°	4103	3994	3967
15°	4046	3862	3762
20°	3972	3681	3510
25°	3895	3478	3266
30°	3792	3269	2957
35°	3692	3045	2685
40°	3589	2813	2374
45°	3470	2556	2091
50°	3347	2295	1815
55°	3218	2017	1550
60°	3069	1726	1277
65°	2898	1431	1151
70°	2691	1155	1043
75°	2430	1020	951
80°	2053	858	829
85°	1429	578	632

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3470 cd/sqm

TEST NUMBER: P923327

CATALOG NUMBER: DFN2DIP-SQ4F0-160D070US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	552.6	3.0
10°-20°	1517.1	8.3
20°-30°	2130.0	11.6
30°-40°	2321.8	12.7
40°-50°	2134.0	11.7
50°-60°	1675.9	9.2
60°-70°	1090.9	6.0
70°-80°	561.5	3.1
80°-90°	147.1	0.8
90°-100°	69.5	0.4
100°-110°	259.0	1.4
110°-120°	686.8	3.8
120°-130°	1139.1	6.2
130°-140°	1209.9	6.6
140°-150°	1124.5	6.1
150°-160°	904.1	4.9
160°-170°	582.6	3.2
170°-180°	200.5	1.1
0°-30°	4199.7	22.9
0°-40°	6521.6	35.6
0°-60°	10331.5	56.4
0°-90°	12130.9	66.3
90°-120°	1015.2	5.5
90°-150°	4488.7	24.5
90°-180°	6176.0	33.7
0°-180°	18306.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5897	5897	5897	5897	5897	
5°	5897	5870	5800	5848	5833	559
15°	5608	5550	5368	5267	5214	1580
25°	5091	4920	4568	4349	4269	2341
35°	4387	4114	3645	3309	3191	2746
45°	3586	3228	2668	2289	2161	2769
55°	2727	2310	1734	1414	1313	2437
65°	1841	1409	928	747	731	1825
75°	982	608	427	390	384	1038
85°	229	117	101	101	101	263
90°	1	18	30	38	41	17
95°	99	49	59	67	66	117
105°	463	509	93	110	116	495
115°	876	902	940	235	125	863
125°	1239	1259	1288	1299	1303	1105
135°	1534	1558	1572	1587	1584	1185
145°	1779	1777	1803	1814	1806	1113
155°	1959	1945	1963	1972	1960	903
165°	2064	2055	2059	2070	2059	583
175°	2111	2100	2104	2114	2099	201
180°	2107	2107	2107	2107	2107	

TEST NUMBER: P923327

CATALOG NUMBER: DFN2DIP-SQ4F0-160D070US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5896.7	5896.7	5896.7	5896.7	5896.7
2.5°	5923.3	5896.7	5837.8	5891.6	5880.8
5°	5896.7	5870.0	5800.4	5848.5	5832.7
7.5°	5848.5	5816.8	5742.1	5763.0	5736.5
10°	5784.6	5747.3	5640.8	5624.4	5592.6
12.5°	5704.7	5656.7	5512.3	5480.5	5421.7
15°	5608.5	5549.6	5368.5	5267.1	5213.8
17.5°	5496.4	5410.9	5186.7	5069.5	4984.0
20°	5368.5	5261.4	4994.7	4861.7	4744.0
22.5°	5229.7	5106.8	4797.1	4616.0	4536.1
25°	5091.0	4920.0	4567.9	4349.3	4269.0
27.5°	4925.7	4744.0	4354.4	4103.7	3980.8
30°	4749.6	4546.4	4119.4	3847.7	3703.4
32.5°	4578.7	4332.9	3895.8	3575.4	3441.7
35°	4386.7	4114.4	3645.0	3308.7	3191.0
37.5°	4199.9	3906.0	3410.1	3041.4	2908.4
40°	4002.3	3682.4	3164.3	2785.5	2646.9
42.5°	3799.6	3458.1	2919.2	2524.0	2390.9
45°	3586.1	3228.3	2668.4	2289.0	2161.1
47.5°	3383.4	3004.7	2428.3	2049.0	1931.8
50°	3159.2	2780.4	2193.3	1824.8	1713.2
52.5°	2940.1	2539.9	1969.2	1617.0	1515.6
55°	2726.7	2310.5	1734.2	1414.3	1313.0
57.5°	2508.1	2081.3	1526.4	1227.4	1141.9
60°	2283.9	1857.1	1307.2	1035.5	950.0
62.5°	2065.4	1638.5	1120.4	864.5	822.1
65°	1841.2	1408.6	928.5	747.3	730.9
67.5°	1627.7	1195.2	747.3	656.2	640.3
70°	1403.6	987.4	618.8	565.6	544.1
72.5°	1190.1	794.9	517.5	475.0	464.2
75°	981.8	608.1	426.9	389.5	384.4
77.5°	773.9	431.9	336.3	314.8	304.1
80°	581.5	309.7	255.9	235.0	235.0
82.5°	405.4	208.4	176.1	165.3	165.3
85°	229.3	117.2	101.4	101.4	101.4
87.5°	85.5	42.4	42.4	37.4	37.4
90°	1.4	18.3	30.4	38.2	41.1
92.5°	38.2	32.0	36.6	39.7	41.1
95°	99.0	48.7	59.4	67.1	65.5
97.5°	178.3	53.4	77.7	82.4	83.8
100°	269.9	61.0	86.9	99.0	102.1
102.5°	370.3	367.5	90.0	106.6	111.3
105°	463.4	509.2	93.0	109.7	115.8
107.5°	571.6	609.7	96.1	112.8	119.0
110°	675.4	707.2	266.8	114.4	120.4

TEST NUMBER: P923327

CATALOG NUMBER: DFN2DIP-SQ4F0-160D070US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	772.9	800.2	774.4	117.3	122.0
115°	876.5	902.3	940.5	234.8	125.1
117.5°	966.4	996.8	1022.9	804.8	405.5
120°	1067.0	1089.8	1117.4	1135.7	929.9
122.5°	1152.3	1176.7	1207.4	1216.4	1218.0
125°	1239.2	1259.1	1288.1	1298.8	1303.2
127.5°	1318.5	1339.8	1362.8	1378.0	1379.5
130°	1393.2	1417.6	1434.3	1451.2	1449.7
132.5°	1469.4	1489.3	1506.0	1519.7	1518.3
135°	1533.5	1557.9	1571.6	1586.9	1583.9
137.5°	1600.4	1618.8	1634.1	1649.4	1644.8
140°	1666.0	1678.3	1695.0	1708.7	1701.1
142.5°	1721.0	1731.7	1751.4	1763.5	1756.0
145°	1779.0	1777.4	1803.2	1813.9	1806.3
147.5°	1829.1	1824.6	1850.5	1858.1	1852.1
150°	1877.9	1867.3	1891.8	1900.8	1893.2
152.5°	1919.0	1906.9	1929.8	1938.9	1928.3
155°	1958.7	1945.1	1963.4	1972.5	1960.3
157.5°	1990.7	1978.6	1992.3	2003.0	1990.7
160°	2018.3	2009.0	2018.3	2027.3	2016.6
162.5°	2042.6	2033.5	2041.0	2051.7	2038.0
165°	2063.9	2054.9	2059.3	2070.0	2059.3
167.5°	2080.7	2071.4	2076.2	2086.9	2073.1
170°	2094.4	2085.3	2088.3	2099.0	2085.3
172.5°	2103.5	2094.4	2097.6	2108.2	2094.4
175°	2111.1	2100.4	2103.5	2114.2	2099.0
177.5°	2114.2	2103.5	2105.1	2115.9	2102.0
180°	2106.6	2106.6	2106.6	2106.6	2106.6

TEST NUMBER: P923327

CATALOG NUMBER: DFN2DIP-SQ4F0-160D070US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.49	14.48	14.30	15.30	16.32	9.45	10.44	10.26	11.26	12.28
	3H	15.19	16.07	16.01	16.90	17.95	10.65	11.53	11.48	12.37	13.42
	4H	15.80	16.63	16.65	17.48	18.54	11.11	11.94	11.95	12.79	13.85
	6H	16.24	17.00	17.09	17.85	18.93	11.44	12.20	12.29	13.06	14.13
	8H	16.37	17.10	17.23	17.97	19.04	11.54	12.26	12.40	13.13	14.21
	12H	16.44	17.13	17.31	18.00	19.09	11.58	12.28	12.45	13.14	14.24
4H	2H	13.53	14.36	14.37	15.20	16.26	10.07	10.90	10.91	11.74	12.80
	3H	15.38	16.07	16.23	16.94	18.02	11.43	12.12	12.29	13.00	14.08
	4H	16.08	16.70	16.95	17.58	18.68	11.99	12.61	12.86	13.49	14.59
	6H	16.61	17.15	17.49	18.05	19.15	12.42	12.96	13.30	13.86	14.96
	8H	16.79	17.29	17.67	18.18	19.30	12.55	13.05	13.44	13.95	15.07
	12H	16.89	17.34	17.80	18.26	19.38	12.62	13.07	13.53	13.99	15.11
8H	4H	16.06	16.56	16.94	17.46	18.58	12.28	12.79	13.17	13.68	14.80
	6H	16.63	17.05	17.55	17.99	19.11	12.81	13.22	13.72	14.16	15.28
	8H	16.85	17.22	17.78	18.15	19.29	13.00	13.37	13.93	14.30	15.43
	12H	17.00	17.33	17.93	18.25	19.44	13.13	13.45	14.05	14.37	15.56
12H	4H	16.02	16.47	16.92	17.38	18.51	12.29	12.75	13.20	13.66	14.79
	6H	16.61	16.98	17.53	17.91	19.04	12.86	13.23	13.78	14.16	15.29
	8H	16.84	17.16	17.77	18.09	19.27	13.08	13.40	14.00	14.32	15.51

END OF REPORT