

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909805

Luminaire Tested: DFN2DIP-TR2F0-060D040US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909805
REPORT IS A COMBINATION OF REPORTS P901769 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D040US840-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9573.5 lumens
Efficiency: N/A
Efficacy: 107.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 88.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909805

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US840-FLLONL

Luminous Intensity Polar Plot

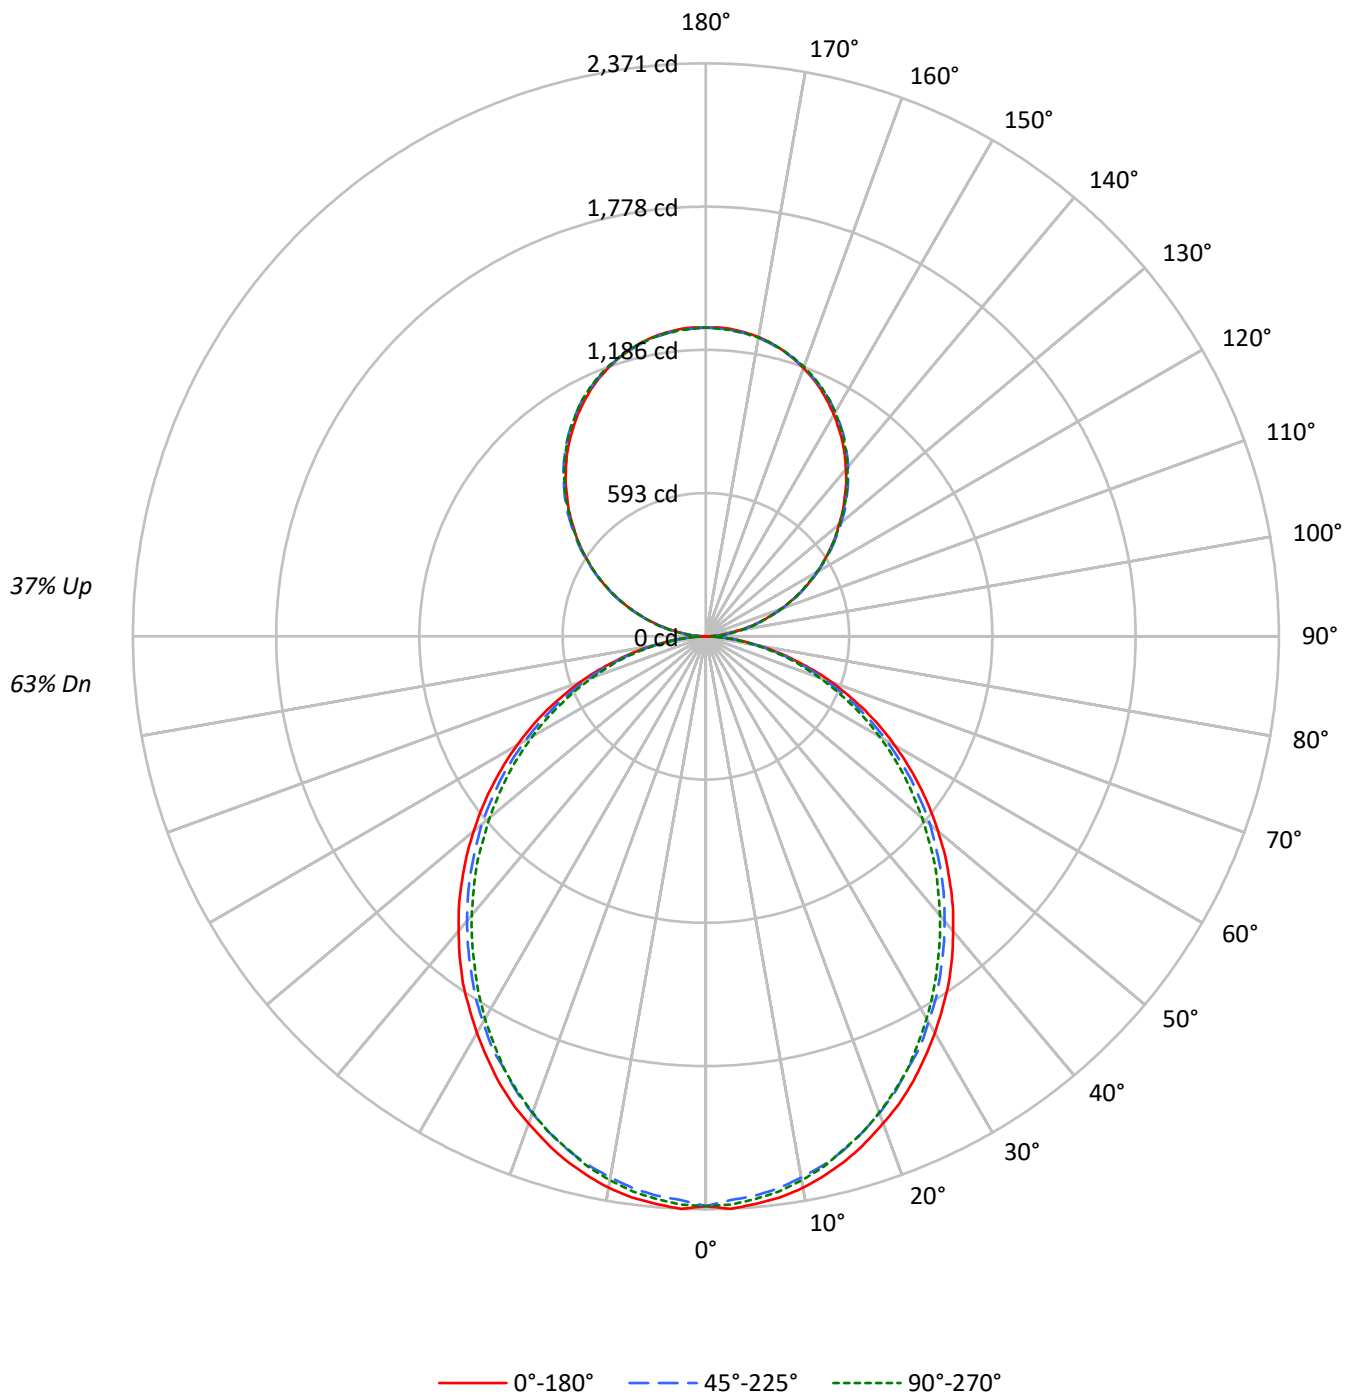

TEST NUMBER: P909805

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90		79	79	79		68
1	101	96	92	89	94	90	87	84	79	77	74		69	67	66		60
2	92	84	78	72	86	79	73	69	70	65	62		61	58	55		53
3	84	74	66	60	78	70	63	58	61	56	52		54	50	46		47
4	77	66	57	51	71	62	54	49	55	49	44		48	43	40		42
5	70	58	50	44	66	55	48	42	49	43	38		43	38	35		38
6	65	53	44	38	61	50	42	37	44	38	33		39	34	30		34
7	60	48	39	34	56	45	38	32	40	34	30		36	31	27		31
8	56	43	35	30	52	41	34	29	37	31	26		33	28	24		29
9	52	40	32	27	49	38	30	26	34	28	24		30	25	22		27
10	49	36	29	24	46	35	28	23	31	25	21		28	23	20		25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5258	5258	5258
5°	5259	5173	5211
10°	5209	5092	5131
15°	5124	4997	5012
20°	5013	4868	4891
25°	4902	4718	4751
30°	4765	4577	4577
35°	4634	4412	4393
40°	4475	4245	4216
45°	4316	4077	4036
50°	4141	3901	3828
55°	3957	3697	3634
60°	3750	3457	3412
65°	3521	3206	3151
70°	3232	2900	2868
75°	2833	2534	2594
80°	2349	2067	2096
85°	1600	1303	1303

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4316 cd/sqm

TEST NUMBER: P909805

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	2.3
10°-20°	624.4	6.5
20°-30°	917.5	9.6
30°-40°	1065.7	11.1
40°-50°	1064.4	11.1
50°-60°	928.1	9.7
60°-70°	686.1	7.2
70°-80°	388.2	4.1
80°-90°	106.1	1.1
90°-100°	79.1	0.8
100°-110°	251.2	2.6
110°-120°	429.8	4.5
120°-130°	565.3	5.9
130°-140°	634.5	6.6
140°-150°	622.2	6.5
150°-160°	522.0	5.5
160°-170°	346.2	3.6
170°-180°	121.0	1.3
0°-30°	1763.8	18.4
0°-40°	2829.5	29.6
0°-60°	4821.9	50.4
0°-90°	6002.2	62.7
90°-120°	760.1	7.9
90°-150°	2582.2	27.0
90°-180°	3571.0	37.3
0°-180°	9573.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	1	14	38	35	37	9
95°	56	67	69	69	67	63
105°	232	235	237	239	239	245
115°	431	438	436	434	431	427
125°	627	637	634	630	629	561
135°	812	823	826	825	822	627
145°	985	993	999	1000	996	616
155°	1126	1130	1133	1138	1135	519
165°	1226	1224	1224	1232	1227	346
175°	1275	1272	1270	1278	1271	121
180°	1278	1278	1278	1278	1278	

TEST NUMBER: P909805

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.1	13.8	37.8	35.4	36.6
92.5°	23.8	32.3	33.5	34.6	34.6
95°	56.2	67.1	69.0	69.0	67.1
97.5°	93.6	103.6	107.9	107.9	107.9
100°	136.7	145.6	148.7	148.7	147.5
102.5°	182.2	188.7	193.0	194.1	193.0
105°	231.9	234.9	237.2	239.1	239.1
107.5°	281.1	285.8	285.8	286.5	281.1
110°	328.9	335.1	335.1	335.1	332.0

TEST NUMBER: P909805

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	380.5	387.1	385.9	382.8	380.5
115°	431.3	437.6	435.6	434.4	431.3
117.5°	481.8	490.3	484.9	481.8	478.8
120°	532.7	541.1	532.7	532.7	529.2
122.5°	578.9	589.7	584.3	581.2	578.9
125°	627.4	637.0	634.0	630.5	629.3
127.5°	674.8	686.7	682.5	677.8	674.8
130°	719.0	733.0	731.0	728.7	724.5
132.5°	768.7	779.5	780.3	774.9	771.8
135°	811.5	823.4	825.8	824.6	821.5
137.5°	859.3	868.9	870.8	870.0	865.5
140°	901.2	910.9	916.3	916.3	912.0
142.5°	944.4	954.0	957.0	958.3	954.0
145°	985.2	992.9	999.1	1000.3	996.0
147.5°	1021.8	1031.4	1036.0	1037.9	1033.7
150°	1059.6	1066.1	1070.4	1073.8	1070.4
152.5°	1093.1	1099.5	1105.0	1109.2	1105.0
155°	1126.5	1129.6	1133.1	1138.5	1135.0
157.5°	1155.5	1157.7	1159.6	1167.4	1162.0
160°	1181.2	1183.6	1184.7	1191.2	1186.6
162.5°	1205.1	1205.1	1206.3	1213.6	1208.2
165°	1225.6	1224.4	1224.4	1232.0	1226.7
167.5°	1244.1	1240.5	1240.5	1248.3	1242.8
170°	1257.9	1254.8	1253.6	1261.3	1254.8
172.5°	1267.5	1264.5	1263.2	1271.0	1264.5
175°	1275.3	1272.1	1269.8	1277.5	1271.0
177.5°	1279.5	1276.4	1274.0	1280.6	1274.0
180°	1277.5	1277.5	1277.5	1277.5	1277.5

TEST NUMBER: P909805

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.01	14.99	14.85	15.86	16.93	13.58	14.57	14.42	15.43	16.51
	3H	15.65	16.54	16.50	17.41	18.51	15.19	16.08	16.04	16.95	18.05
	4H	16.23	17.07	17.10	17.95	19.06	15.77	16.61	16.64	17.49	18.60
	6H	16.62	17.39	17.50	18.28	19.40	16.16	16.93	17.04	17.82	18.94
	8H	16.72	17.45	17.61	18.36	19.48	16.26	16.99	17.15	17.90	19.03
	12H	16.76	17.46	17.66	18.36	19.51	16.30	17.00	17.19	17.90	19.05
4H	2H	14.47	15.31	15.35	16.19	17.30	14.13	14.97	15.01	15.85	16.97
	3H	16.32	17.02	17.21	17.93	19.06	15.94	16.64	16.82	17.55	18.68
	4H	17.02	17.66	17.92	18.57	19.72	16.63	17.27	17.53	18.17	19.33
	6H	17.52	18.08	18.43	19.01	20.16	17.13	17.68	18.04	18.61	19.77
	8H	17.66	18.18	18.58	19.11	20.28	17.27	17.78	18.18	18.71	19.88
	12H	17.73	18.20	18.67	19.14	20.32	17.33	17.79	18.26	18.74	19.91
8H	4H	17.22	17.74	18.13	18.66	19.83	16.87	17.38	17.78	18.31	19.48
	6H	17.83	18.26	18.77	19.22	20.39	17.48	17.90	18.42	18.87	20.04
	8H	18.04	18.41	18.99	19.37	20.56	17.68	18.06	18.63	19.01	20.20
	12H	18.16	18.49	19.11	19.44	20.68	17.79	18.12	18.74	19.07	20.31
12H	4H	17.21	17.67	18.14	18.62	19.79	16.87	17.33	17.80	18.27	19.45
	6H	17.85	18.23	18.81	19.19	20.38	17.51	17.89	18.46	18.85	20.04
	8H	18.09	18.42	19.04	19.37	20.61	17.74	18.07	18.69	19.02	20.26

END OF REPORT