

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909900

Luminaire Tested: DFN2DIP-TR3F0-060D040US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909900
REPORT IS A COMBINATION OF REPORTS P900292 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D040US840-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8725.3 lumens
Efficiency: N/A
Efficacy: 100.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 86.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909900

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US840-RLLFLL

Luminous Intensity Polar Plot

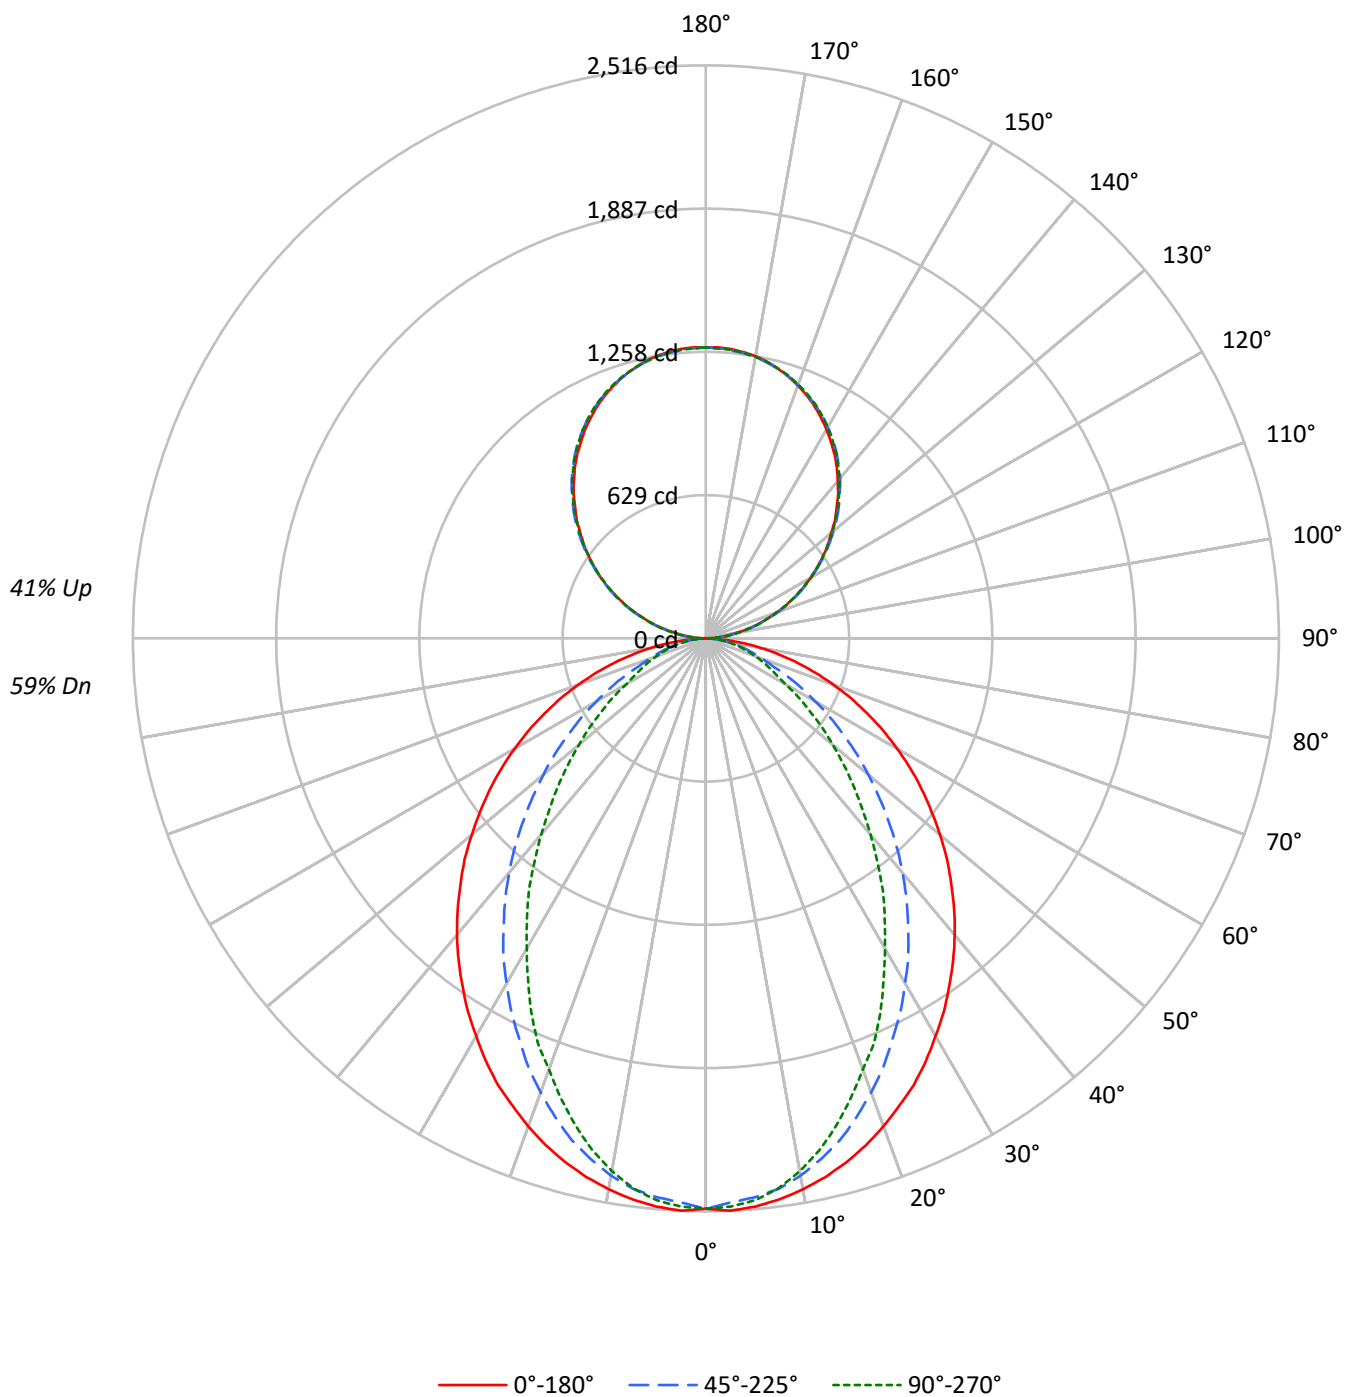

TEST NUMBER: P909900

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	56
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	52	50	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	44	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	39	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3121	3121	3121
5°	3124	3068	3089
10°	3091	3006	2986
15°	3047	2904	2829
20°	2989	2764	2637
25°	2929	2609	2451
30°	2850	2449	2216
35°	2773	2278	2010
40°	2693	2101	1774
45°	2602	1905	1560
50°	2506	1708	1352
55°	2407	1497	1151
60°	2292	1277	945
65°	2159	1054	849
70°	1998	845	765
75°	1796	740	692
80°	1502	612	593
85°	1023	396	434

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2602 cd/sqm

TEST NUMBER: P909900

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US840-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	234.7	2.7
10°-20°	644.3	7.4
20°-30°	904.6	10.4
30°-40°	986.1	11.3
40°-50°	906.3	10.4
50°-60°	711.7	8.2
60°-70°	463.3	5.3
70°-80°	238.5	2.7
80°-90°	64.5	0.7
90°-100°	79.1	0.9
100°-110°	251.2	2.9
110°-120°	429.8	4.9
120°-130°	565.3	6.5
130°-140°	634.5	7.3
140°-150°	622.2	7.1
150°-160°	522.0	6.0
160°-170°	346.2	4.0
170°-180°	121.0	1.4
0°-30°	1783.6	20.4
0°-40°	2769.6	31.7
0°-60°	4387.7	50.3
0°-90°	5154.0	59.1
90°-120°	760.1	8.7
90°-150°	2582.2	29.6
90°-180°	3571.0	40.9
0°-180°	8725.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2504	2504	2504	2504	2504	
5°	2504	2493	2463	2484	2477	237
15°	2382	2357	2280	2237	2214	671
25°	2162	2090	1940	1847	1813	994
35°	1863	1747	1548	1405	1355	1166
45°	1523	1371	1133	972	918	1176
55°	1158	981	736	601	558	1035
65°	782	598	394	317	310	775
75°	417	258	181	165	163	441
85°	97	50	43	43	43	112
90°	1	14	38	35	37	9
95°	56	67	69	69	67	63
105°	232	235	237	239	239	245
115°	431	438	436	434	431	427
125°	627	637	634	630	629	561
135°	812	823	826	825	822	627
145°	985	993	999	1000	996	616
155°	1126	1130	1133	1138	1135	519
165°	1226	1224	1224	1232	1227	346
175°	1275	1272	1270	1278	1271	121
180°	1278	1278	1278	1278	1278	

TEST NUMBER: P909900

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US840-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2504.3	2504.3	2504.3	2504.3	2504.3
2.5°	2515.6	2504.3	2479.2	2502.0	2497.5
5°	2504.3	2493.0	2463.4	2483.9	2477.1
7.5°	2483.9	2470.3	2438.6	2447.5	2436.2
10°	2456.6	2440.7	2395.6	2388.6	2375.1
12.5°	2422.8	2402.3	2341.0	2327.5	2302.5
15°	2381.9	2356.8	2279.9	2236.9	2214.2
17.5°	2334.3	2297.9	2202.7	2152.9	2116.7
20°	2279.9	2234.4	2121.2	2064.7	2014.7
22.5°	2221.0	2168.8	2037.3	1960.4	1926.4
25°	2162.1	2089.5	1940.0	1847.1	1813.0
27.5°	2091.9	2014.7	1849.3	1742.7	1690.6
30°	2017.1	1930.8	1749.5	1634.1	1572.8
32.5°	1944.5	1840.2	1654.6	1518.4	1461.7
35°	1863.0	1747.4	1548.0	1405.1	1355.1
37.5°	1783.6	1658.8	1448.2	1291.7	1235.2
40°	1699.7	1563.9	1343.8	1183.0	1124.1
42.5°	1613.7	1468.6	1239.7	1071.9	1015.4
45°	1523.0	1371.0	1133.3	972.1	917.8
47.5°	1436.9	1276.1	1031.3	870.2	820.4
50°	1341.7	1180.8	931.5	775.0	727.6
52.5°	1248.6	1078.6	836.3	686.7	643.7
55°	1158.0	981.3	736.5	600.7	557.5
57.5°	1065.2	883.8	648.2	521.3	484.9
60°	970.0	788.7	555.2	439.8	403.4
62.5°	877.2	695.9	475.8	367.2	349.1
65°	781.9	598.2	394.4	317.4	310.4
67.5°	691.3	507.6	317.4	278.7	272.0
70°	596.0	419.3	262.8	240.2	231.1
72.5°	505.4	337.6	219.7	201.8	197.1
75°	417.0	258.2	181.3	165.4	163.3
77.5°	328.7	183.5	142.8	133.7	129.2
80°	246.9	131.5	108.7	99.8	99.8
82.5°	172.2	88.5	74.7	70.2	70.2
85°	97.4	49.8	43.0	43.0	43.0
87.5°	36.4	18.1	18.1	15.9	15.9
90°	1.1	13.8	37.8	35.4	36.6
92.5°	23.8	32.3	33.5	34.6	34.6
95°	56.2	67.1	69.0	69.0	67.1
97.5°	93.6	103.6	107.9	107.9	107.9
100°	136.7	145.6	148.7	148.7	147.5
102.5°	182.2	188.7	193.0	194.1	193.0
105°	231.9	234.9	237.2	239.1	239.1
107.5°	281.1	285.8	285.8	286.5	281.1
110°	328.9	335.1	335.1	335.1	332.0

TEST NUMBER: P909900

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US840-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	380.5	387.1	385.9	382.8	380.5
115°	431.3	437.6	435.6	434.4	431.3
117.5°	481.8	490.3	484.9	481.8	478.8
120°	532.7	541.1	532.7	532.7	529.2
122.5°	578.9	589.7	584.3	581.2	578.9
125°	627.4	637.0	634.0	630.5	629.3
127.5°	674.8	686.7	682.5	677.8	674.8
130°	719.0	733.0	731.0	728.7	724.5
132.5°	768.7	779.5	780.3	774.9	771.8
135°	811.5	823.4	825.8	824.6	821.5
137.5°	859.3	868.9	870.8	870.0	865.5
140°	901.2	910.9	916.3	916.3	912.0
142.5°	944.4	954.0	957.0	958.3	954.0
145°	985.2	992.9	999.1	1000.3	996.0
147.5°	1021.8	1031.4	1036.0	1037.9	1033.7
150°	1059.6	1066.1	1070.4	1073.8	1070.4
152.5°	1093.1	1099.5	1105.0	1109.2	1105.0
155°	1126.5	1129.6	1133.1	1138.5	1135.0
157.5°	1155.5	1157.7	1159.6	1167.4	1162.0
160°	1181.2	1183.6	1184.7	1191.2	1186.6
162.5°	1205.1	1205.1	1206.3	1213.6	1208.2
165°	1225.6	1224.4	1224.4	1232.0	1226.7
167.5°	1244.1	1240.5	1240.5	1248.3	1242.8
170°	1257.9	1254.8	1253.6	1261.3	1254.8
172.5°	1267.5	1264.5	1263.2	1271.0	1264.5
175°	1275.3	1272.1	1269.8	1277.5	1271.0
177.5°	1279.5	1276.4	1274.0	1280.6	1274.0
180°	1277.5	1277.5	1277.5	1277.5	1277.5

TEST NUMBER: P909900

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.85	12.77	12.74	13.66	14.80	7.83	8.74	8.71	9.64	10.78
	3H	13.53	14.34	14.42	15.25	16.41	9.02	9.84	9.92	10.74	11.91
	4H	14.14	14.90	15.05	15.82	16.99	9.47	10.24	10.38	11.15	12.33
	6H	14.55	15.26	15.47	16.18	17.37	9.79	10.50	10.71	11.42	12.61
	8H	14.68	15.35	15.61	16.29	17.47	9.88	10.56	10.81	11.49	12.68
	12H	14.74	15.38	15.67	16.31	17.52	9.93	10.57	10.86	11.50	12.71
4H	2H	11.88	12.65	12.80	13.56	14.74	8.43	9.20	9.35	10.11	11.29
	3H	13.71	14.35	14.63	15.29	16.48	9.78	10.42	10.71	11.37	12.55
	4H	14.40	14.98	15.33	15.92	17.13	10.33	10.91	11.27	11.85	13.06
	6H	14.91	15.41	15.86	16.37	17.58	10.75	11.25	11.70	12.21	13.43
	8H	15.08	15.55	16.03	16.50	17.73	10.87	11.34	11.83	12.30	13.53
	12H	15.17	15.59	16.14	16.57	17.80	10.94	11.36	11.91	12.33	13.57
8H	4H	14.37	14.84	15.32	15.79	17.02	10.61	11.08	11.56	12.03	13.26
	6H	14.93	15.31	15.90	16.31	17.54	11.12	11.51	12.10	12.51	13.73
	8H	15.14	15.48	16.12	16.47	17.71	11.31	11.65	12.30	12.64	13.88
	12H	15.27	15.57	16.26	16.55	17.85	11.43	11.73	12.42	12.71	14.00
12H	4H	14.32	14.74	15.29	15.72	16.95	10.62	11.04	11.59	12.01	13.24
	6H	14.90	15.24	15.89	16.23	17.48	11.17	11.51	12.16	12.50	13.74
	8H	15.12	15.42	16.11	16.40	17.69	11.38	11.68	12.37	12.66	13.95