

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920809

Luminaire Tested: DFN2DIP-TR3F0-060D030US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920809
REPORT IS A COMBINATION OF REPORTS P901798 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D030US935-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6948.3 lumens
Efficiency: N/A
Efficacy: 86.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 80.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920809

CATALOG NUMBER: DFN2DIP-TR3F0-060D030US935-RLLONL

Luminous Intensity Polar Plot

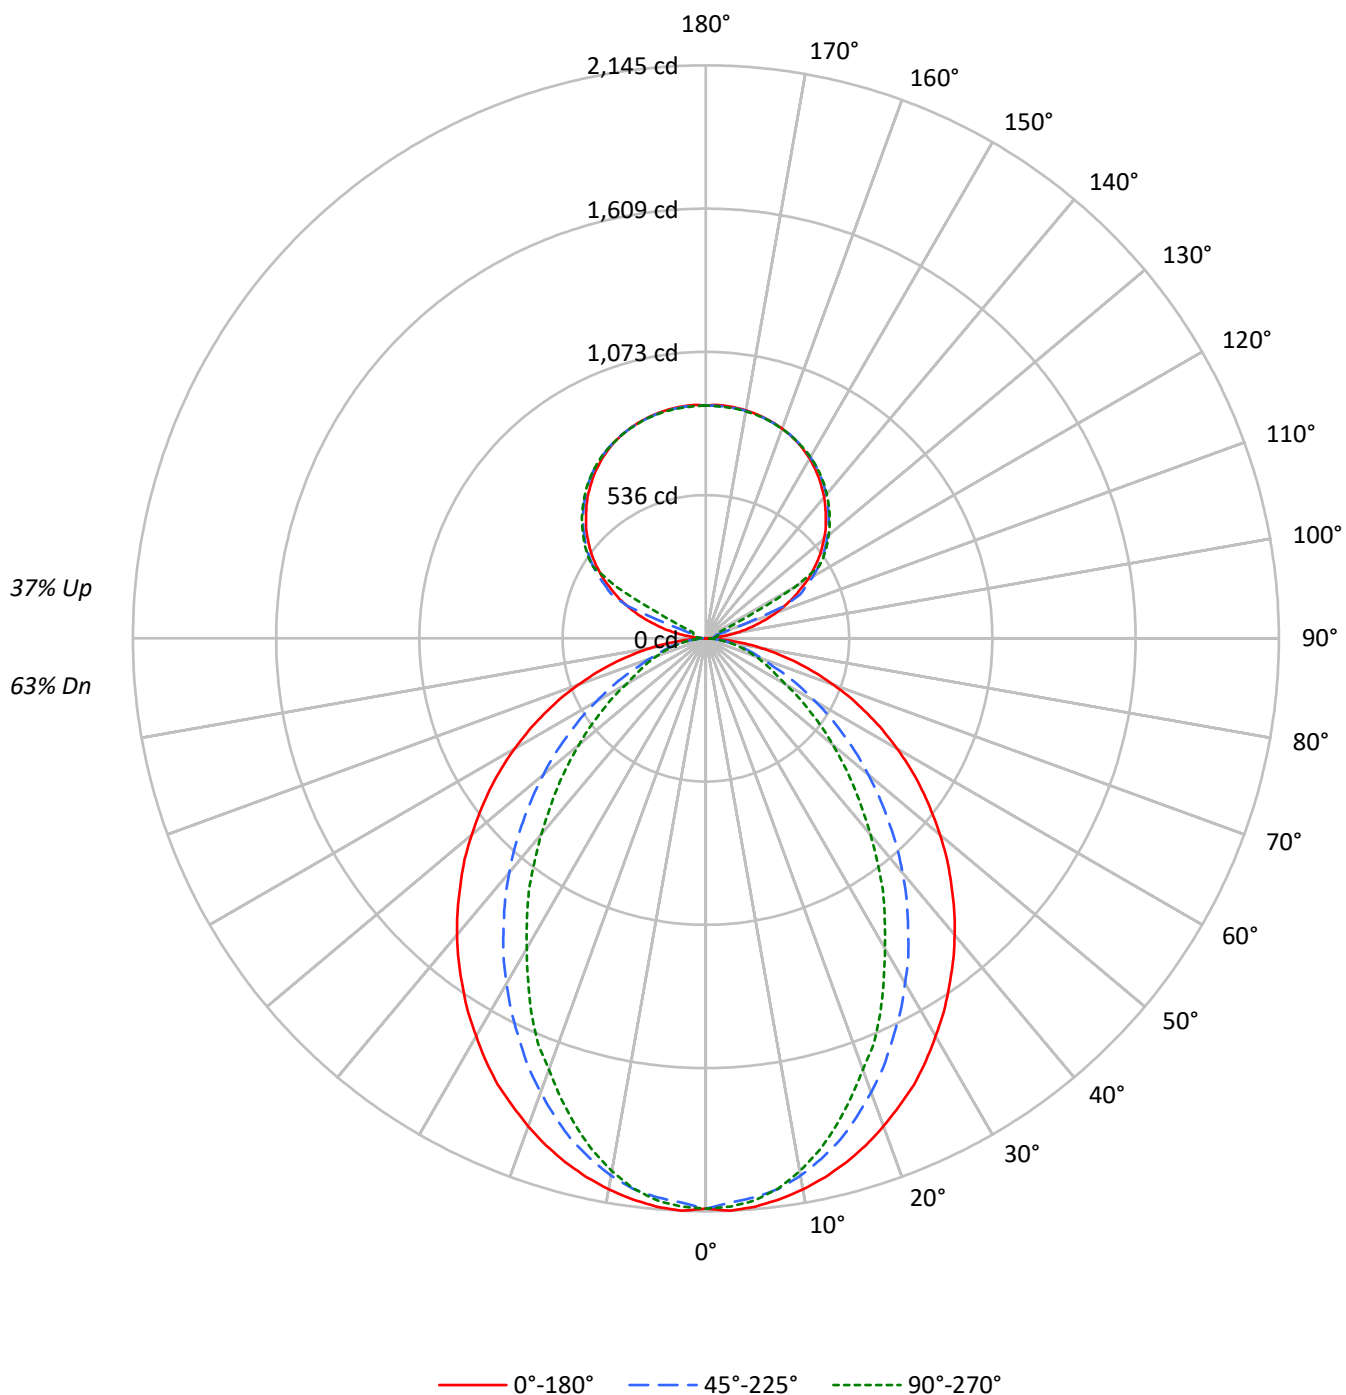

TEST NUMBER: P920809

CATALOG NUMBER: DFN2DIP-TR3F0-060D030US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	91	91	91	79	79	79	68	68	68
1	101	97	93	90	95	91	88	85	80	78	76	71	69	67	61	60	59
2	93	86	80	75	87	81	75	71	71	67	64	63	60	57	55	52	51
3	85	76	69	63	80	72	65	60	63	58	54	56	52	49	49	46	44
4	78	68	60	54	73	64	57	52	57	51	47	50	46	43	44	41	38
5	72	61	53	47	67	57	50	45	51	45	41	46	41	37	40	37	34
6	67	55	47	41	62	52	45	39	46	41	36	41	37	33	37	33	30
7	62	50	42	36	58	47	40	35	42	36	32	38	33	30	34	30	27
8	58	45	38	32	54	43	36	31	39	33	29	35	30	27	31	27	24
9	54	42	34	29	51	40	33	28	36	30	26	32	27	24	29	25	22
10	50	38	31	26	47	37	30	25	33	28	24	30	25	22	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2661	2661	2661
5°	2663	2616	2633
10°	2636	2563	2546
15°	2598	2476	2412
20°	2548	2357	2248
25°	2498	2224	2090
30°	2430	2088	1890
35°	2364	1942	1714
40°	2296	1791	1513
45°	2218	1624	1330
50°	2137	1456	1152
55°	2052	1276	982
60°	1954	1089	806
65°	1841	898	724
70°	1703	721	652
75°	1531	630	590
80°	1281	522	506
85°	871	338	370

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2218 cd/sqm

TEST NUMBER: P920809

CATALOG NUMBER: DFN2DIP-TR3F0-060D030US935-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	2.9
10°-20°	549.3	7.9
20°-30°	771.2	11.1
30°-40°	840.7	12.1
40°-50°	772.7	11.1
50°-60°	606.8	8.7
60°-70°	395.0	5.7
70°-80°	203.3	2.9
80°-90°	53.4	0.8
90°-100°	28.7	0.4
100°-110°	107.2	1.5
110°-120°	284.2	4.1
120°-130°	471.3	6.8
130°-140°	500.7	7.2
140°-150°	465.3	6.7
150°-160°	374.1	5.4
160°-170°	241.1	3.5
170°-180°	83.0	1.2
0°-30°	1520.7	21.9
0°-40°	2361.4	34.0
0°-60°	3740.9	53.8
0°-90°	4392.6	63.2
90°-120°	420.1	6.0
90°-150°	1857.5	26.7
90°-180°	2556.0	36.8
0°-180°	6948.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	1	8	13	16	17	7
95°	41	20	24	28	27	49
105°	192	211	38	45	48	205
115°	363	373	389	97	52	357
125°	513	521	533	537	539	457
135°	635	645	650	657	655	490
145°	736	736	746	751	747	460
155°	810	805	812	816	811	373
165°	854	850	852	857	852	241
175°	874	869	870	875	869	83
180°	872	872	872	872	872	

TEST NUMBER: P920809

CATALOG NUMBER: DFN2DIP-TR3F0-060D030US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.7	2135.1	2113.7	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2080.9	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.7	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.7
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.1	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.3
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	0.6	7.6	12.6	15.8	17.0
92.5°	15.8	13.3	15.2	16.4	17.0
95°	41.0	20.1	24.5	27.8	27.1
97.5°	73.8	22.1	32.1	34.1	34.7
100°	111.7	25.2	36.0	41.0	42.3
102.5°	153.3	152.1	37.2	44.1	46.1
105°	191.7	210.7	38.5	45.4	48.0
107.5°	236.5	252.3	39.8	46.7	49.2
110°	279.5	292.7	110.4	47.4	49.9

TEST NUMBER: P920809

CATALOG NUMBER: DFN2DIP-TR3F0-060D030US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	319.9	331.1	320.5	48.6	50.5
115°	362.7	373.4	389.2	97.1	51.7
117.5°	399.9	412.5	423.3	333.0	167.8
120°	441.5	451.0	462.4	469.9	384.8
122.5°	476.8	487.0	499.6	503.3	504.0
125°	512.8	521.0	533.0	537.4	539.3
127.5°	545.6	554.4	564.0	570.2	570.8
130°	576.5	586.7	593.6	600.5	599.9
132.5°	608.0	616.3	623.2	628.9	628.3
135°	634.6	644.7	650.3	656.7	655.4
137.5°	662.3	669.9	676.2	682.5	680.6
140°	689.4	694.5	701.4	707.1	704.0
142.5°	712.2	716.6	724.8	729.8	726.7
145°	736.2	735.5	746.2	750.6	747.4
147.5°	756.9	755.0	765.8	768.9	766.4
150°	777.1	772.7	782.8	786.5	783.4
152.5°	794.1	789.1	798.6	802.4	798.0
155°	810.5	804.9	812.4	816.2	811.2
157.5°	823.8	818.8	824.5	828.9	823.8
160°	835.2	831.4	835.2	839.0	834.5
162.5°	845.2	841.5	844.6	849.0	843.3
165°	854.0	850.3	852.2	856.6	852.2
167.5°	861.0	857.2	859.1	863.6	857.9
170°	866.7	862.9	864.2	868.6	862.9
172.5°	870.5	866.7	868.0	872.4	866.7
175°	873.6	869.2	870.5	874.9	868.6
177.5°	874.9	870.5	871.2	875.5	869.9
180°	871.8	871.8	871.8	871.8	871.8

TEST NUMBER: P920809

CATALOG NUMBER: DFN2DIP-TR3F0-060D030US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.65	12.60	12.49	13.46	14.53	7.62	8.57	8.47	9.43	10.51
	3H	13.32	14.18	14.18	15.04	16.14	8.82	9.67	9.67	10.54	11.64
	4H	13.93	14.73	14.80	15.61	16.72	9.27	10.07	10.14	10.95	12.06
	6H	14.35	15.09	15.24	15.97	17.10	9.59	10.33	10.47	11.21	12.33
	8H	14.48	15.18	15.37	16.08	17.20	9.68	10.39	10.57	11.28	12.41
	12H	14.54	15.21	15.44	16.10	17.25	9.73	10.40	10.62	11.29	12.44
4H	2H	11.68	12.48	12.55	13.36	14.47	8.23	9.03	9.10	9.91	11.02
	3H	13.51	14.17	14.40	15.08	16.21	9.58	10.25	10.47	11.16	12.28
	4H	14.20	14.80	15.10	15.71	16.86	10.13	10.74	11.03	11.64	12.79
	6H	14.71	15.23	15.62	16.16	17.31	10.55	11.07	11.46	12.00	13.15
	8H	14.88	15.37	15.80	16.29	17.46	10.68	11.17	11.59	12.09	13.25
	12H	14.98	15.42	15.91	16.36	17.53	10.75	11.19	11.68	12.13	13.30
8H	4H	14.17	14.66	15.09	15.58	16.75	10.41	10.90	11.33	11.82	12.99
	6H	14.73	15.14	15.68	16.10	17.27	10.93	11.33	11.87	12.30	13.46
	8H	14.94	15.30	15.90	16.26	17.44	11.12	11.47	12.07	12.43	13.61
	12H	15.08	15.40	16.04	16.34	17.58	11.24	11.55	12.19	12.50	13.73
12H	4H	14.13	14.57	15.06	15.51	16.68	10.42	10.86	11.36	11.80	12.97
	6H	14.71	15.07	15.66	16.02	17.20	10.98	11.33	11.93	12.29	13.47
	8H	14.93	15.24	15.88	16.19	17.42	11.19	11.50	12.14	12.45	13.68

END OF REPORT