

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920820

Luminaire Tested: DFN2DIP-TR3F0-060D060US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920820
REPORT IS A COMBINATION OF REPORTS P900320 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D060US935-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8963.0 lumens
Efficiency: N/A
Efficacy: 87.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920820

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US935-RLLFLL

Luminous Intensity Polar Plot

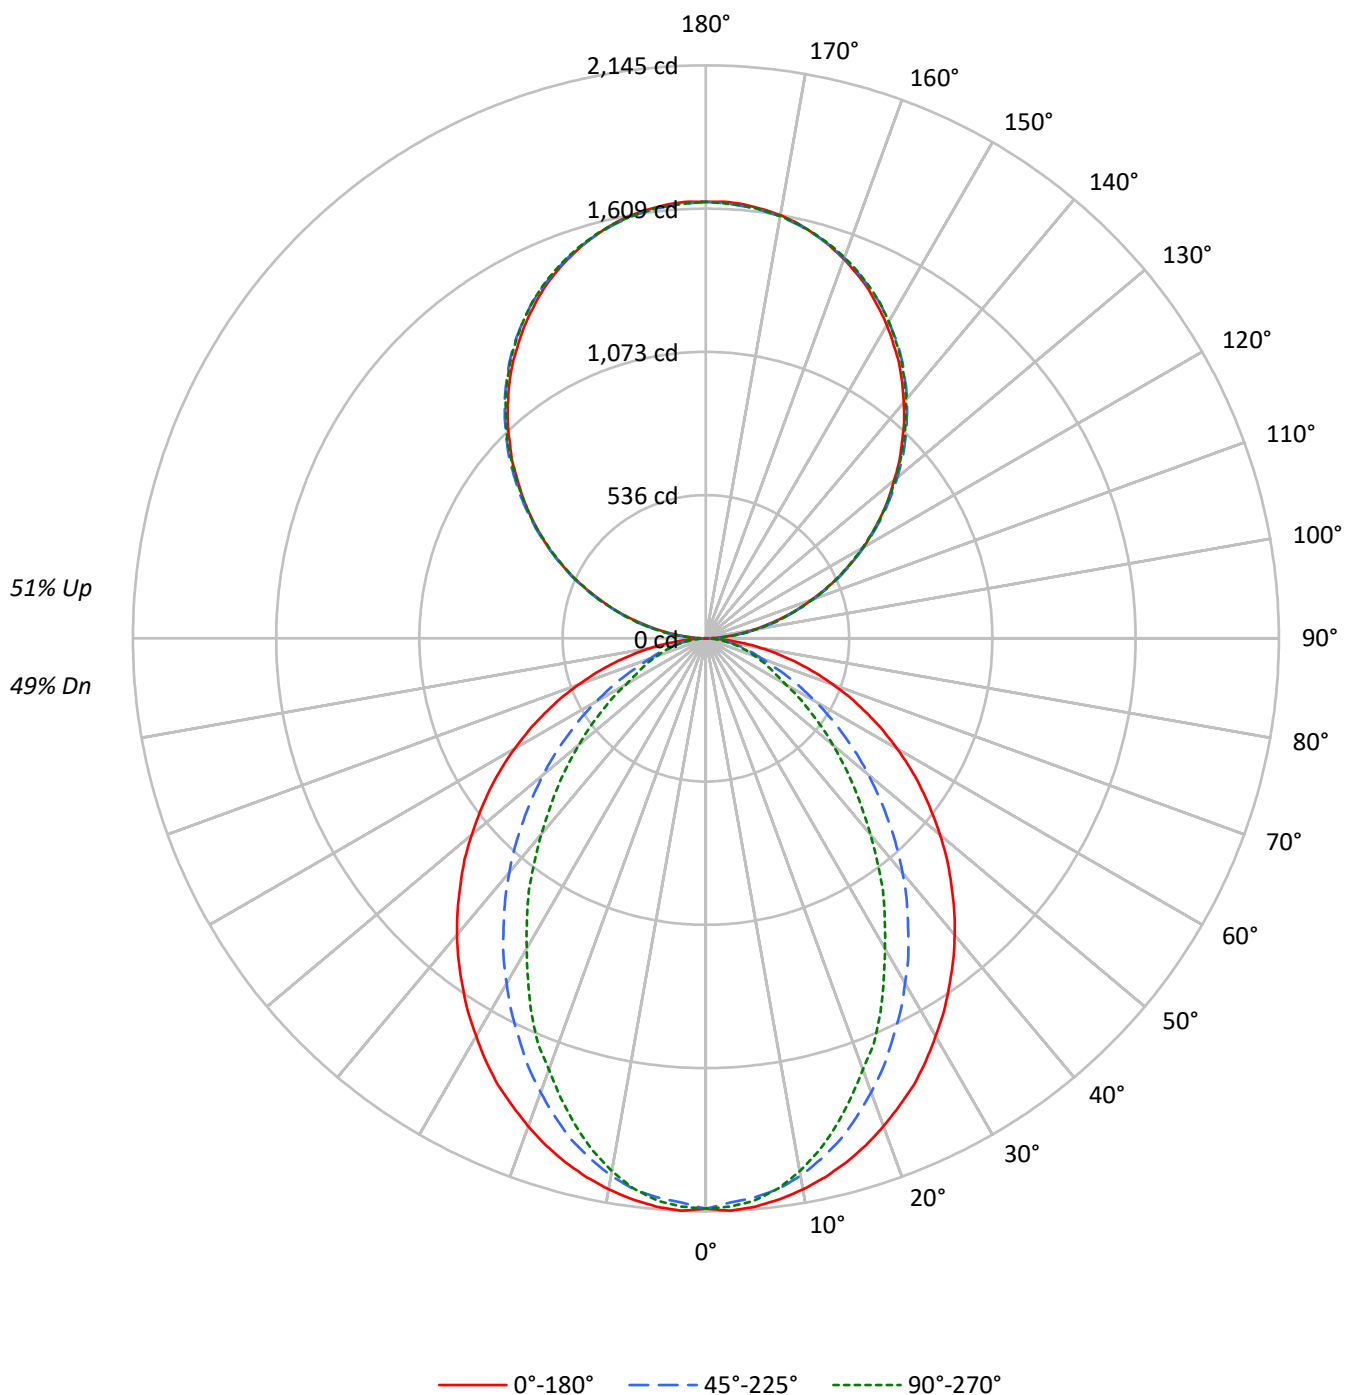

TEST NUMBER: P920820

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2661	2661	2661
5°	2663	2616	2633
10°	2636	2563	2546
15°	2598	2476	2412
20°	2548	2357	2248
25°	2498	2224	2090
30°	2430	2088	1890
35°	2364	1942	1714
40°	2296	1791	1513
45°	2218	1624	1330
50°	2137	1456	1152
55°	2052	1276	982
60°	1954	1089	806
65°	1841	898	724
70°	1703	721	652
75°	1531	630	590
80°	1281	522	506
85°	871	338	370

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2218 cd/sqm

TEST NUMBER: P920820

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	2.2
10°-20°	549.3	6.1
20°-30°	771.2	8.6
30°-40°	840.7	9.4
40°-50°	772.7	8.6
50°-60°	606.8	6.8
60°-70°	395.0	4.4
70°-80°	203.3	2.3
80°-90°	56.5	0.6
90°-100°	101.1	1.1
100°-110°	321.2	3.6
110°-120°	549.7	6.1
120°-130°	723.0	8.1
130°-140°	811.5	9.1
140°-150°	795.8	8.9
150°-160°	667.5	7.4
160°-170°	442.7	4.9
170°-180°	154.7	1.7
0°-30°	1520.7	17.0
0°-40°	2361.4	26.3
0°-60°	3740.9	41.7
0°-90°	4395.7	49.0
90°-120°	972.0	10.8
90°-150°	3302.3	36.8
90°-180°	4567.0	51.0
0°-180°	8963.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	2	18	48	45	47	9
95°	72	86	88	88	86	80
105°	296	300	303	306	306	313
115°	552	560	557	556	552	546
125°	802	815	811	806	805	717
135°	1038	1053	1056	1055	1051	802
145°	1260	1270	1278	1279	1274	787
155°	1441	1445	1449	1456	1452	663
165°	1567	1566	1566	1576	1569	442
175°	1631	1627	1624	1634	1625	155
180°	1634	1634	1634	1634	1634	

TEST NUMBER: P920820

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.7	2135.1	2113.7	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2080.9	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.7	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.7
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.1	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.3
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	1.5	17.7	48.3	45.3	46.8
92.5°	30.6	41.4	42.9	44.3	44.3
95°	71.9	85.7	88.2	88.2	85.7
97.5°	119.7	132.5	137.9	137.9	137.9
100°	174.9	186.1	190.1	190.1	188.6
102.5°	233.0	241.3	246.8	248.2	246.8
105°	296.5	300.5	303.4	305.9	305.9
107.5°	359.6	365.5	365.5	366.4	359.6
110°	420.7	428.5	428.5	428.5	424.6

TEST NUMBER: P920820

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	486.6	495.0	493.5	489.6	486.6
115°	551.6	559.6	557.1	555.6	551.6
117.5°	616.2	627.1	620.1	616.2	612.3
120°	681.2	692.1	681.2	681.2	676.7
122.5°	740.3	754.1	747.2	743.3	740.3
125°	802.4	814.7	810.7	806.3	804.9
127.5°	863.0	878.2	872.8	866.9	863.0
130°	919.6	937.4	934.9	931.9	926.5
132.5°	983.2	996.9	997.9	991.0	987.0
135°	1037.8	1053.1	1056.0	1054.6	1050.6
137.5°	1098.9	1111.2	1113.7	1112.7	1106.8
140°	1152.6	1164.9	1171.8	1171.8	1166.4
142.5°	1207.7	1220.0	1224.0	1225.5	1220.0
145°	1260.0	1269.8	1277.7	1279.2	1273.8
147.5°	1306.7	1319.0	1325.0	1327.4	1322.0
150°	1355.0	1363.4	1368.8	1373.2	1368.8
152.5°	1397.8	1406.3	1413.2	1418.6	1413.2
155°	1440.7	1444.7	1449.1	1456.0	1451.6
157.5°	1477.6	1480.7	1483.1	1493.0	1486.1
160°	1510.7	1513.6	1515.1	1523.4	1517.6
162.5°	1541.2	1541.2	1542.6	1552.0	1545.1
165°	1567.3	1565.8	1565.8	1575.7	1568.8
167.5°	1591.0	1586.6	1586.6	1596.4	1589.5
170°	1608.7	1604.7	1603.3	1613.1	1604.7
172.5°	1621.0	1617.0	1615.6	1625.4	1617.0
175°	1630.8	1626.9	1623.9	1633.8	1625.4
177.5°	1636.2	1632.4	1629.4	1637.7	1629.4
180°	1633.8	1633.8	1633.8	1633.8	1633.8

TEST NUMBER: P920820

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.40	11.23	11.37	12.21	13.49	6.38	7.20	7.35	8.18	9.47
	3H	12.07	12.81	13.05	13.80	15.11	7.56	8.30	8.55	9.29	10.60
	4H	12.67	13.37	13.67	14.36	15.68	8.01	8.70	9.01	9.70	11.02
	6H	13.09	13.73	14.09	14.73	16.06	8.32	8.96	9.33	9.96	11.29
	8H	13.21	13.82	14.22	14.83	16.16	8.41	9.02	9.42	10.04	11.36
	12H	13.27	13.84	14.28	14.85	16.20	8.45	9.03	9.47	10.04	11.39
4H	2H	10.42	11.11	11.42	12.11	13.43	6.97	7.66	7.97	8.66	9.98
	3H	12.24	12.81	13.25	13.84	15.17	8.31	8.89	9.32	9.91	11.24
	4H	12.92	13.45	13.94	14.47	15.82	8.85	9.38	9.87	10.40	11.75
	6H	13.43	13.88	14.46	14.92	16.27	9.27	9.72	10.30	10.76	12.11
	8H	13.60	14.02	14.63	15.05	16.42	9.39	9.82	10.42	10.85	12.21
	12H	13.69	14.07	14.73	15.12	16.49	9.45	9.84	10.50	10.88	12.25
8H	4H	12.89	13.31	13.92	14.34	15.71	9.13	9.55	10.16	10.58	11.95
	6H	13.44	13.79	14.50	14.87	16.23	9.64	9.99	10.69	11.06	12.43
	8H	13.65	13.96	14.72	15.02	16.40	9.82	10.13	10.89	11.19	12.57
	12H	13.78	14.06	14.85	15.11	16.53	9.94	10.21	11.00	11.26	12.69
12H	4H	12.84	13.22	13.89	14.27	15.64	9.13	9.51	10.18	10.56	11.93
	6H	13.42	13.73	14.48	14.78	16.17	9.69	9.99	10.75	11.05	12.43
	8H	13.63	13.90	14.70	14.96	16.38	9.89	10.16	10.95	11.21	12.64

END OF REPORT