

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904607

Luminaire Tested: DFN2DIP-TR4F0-050D110US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904607
REPORT IS A COMBINATION OF REPORTS P902017 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D110US830-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14929.8 lumens
Efficiency: N/A
Efficacy: 117.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 126.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904607

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US830-FLLONL

Luminous Intensity Polar Plot

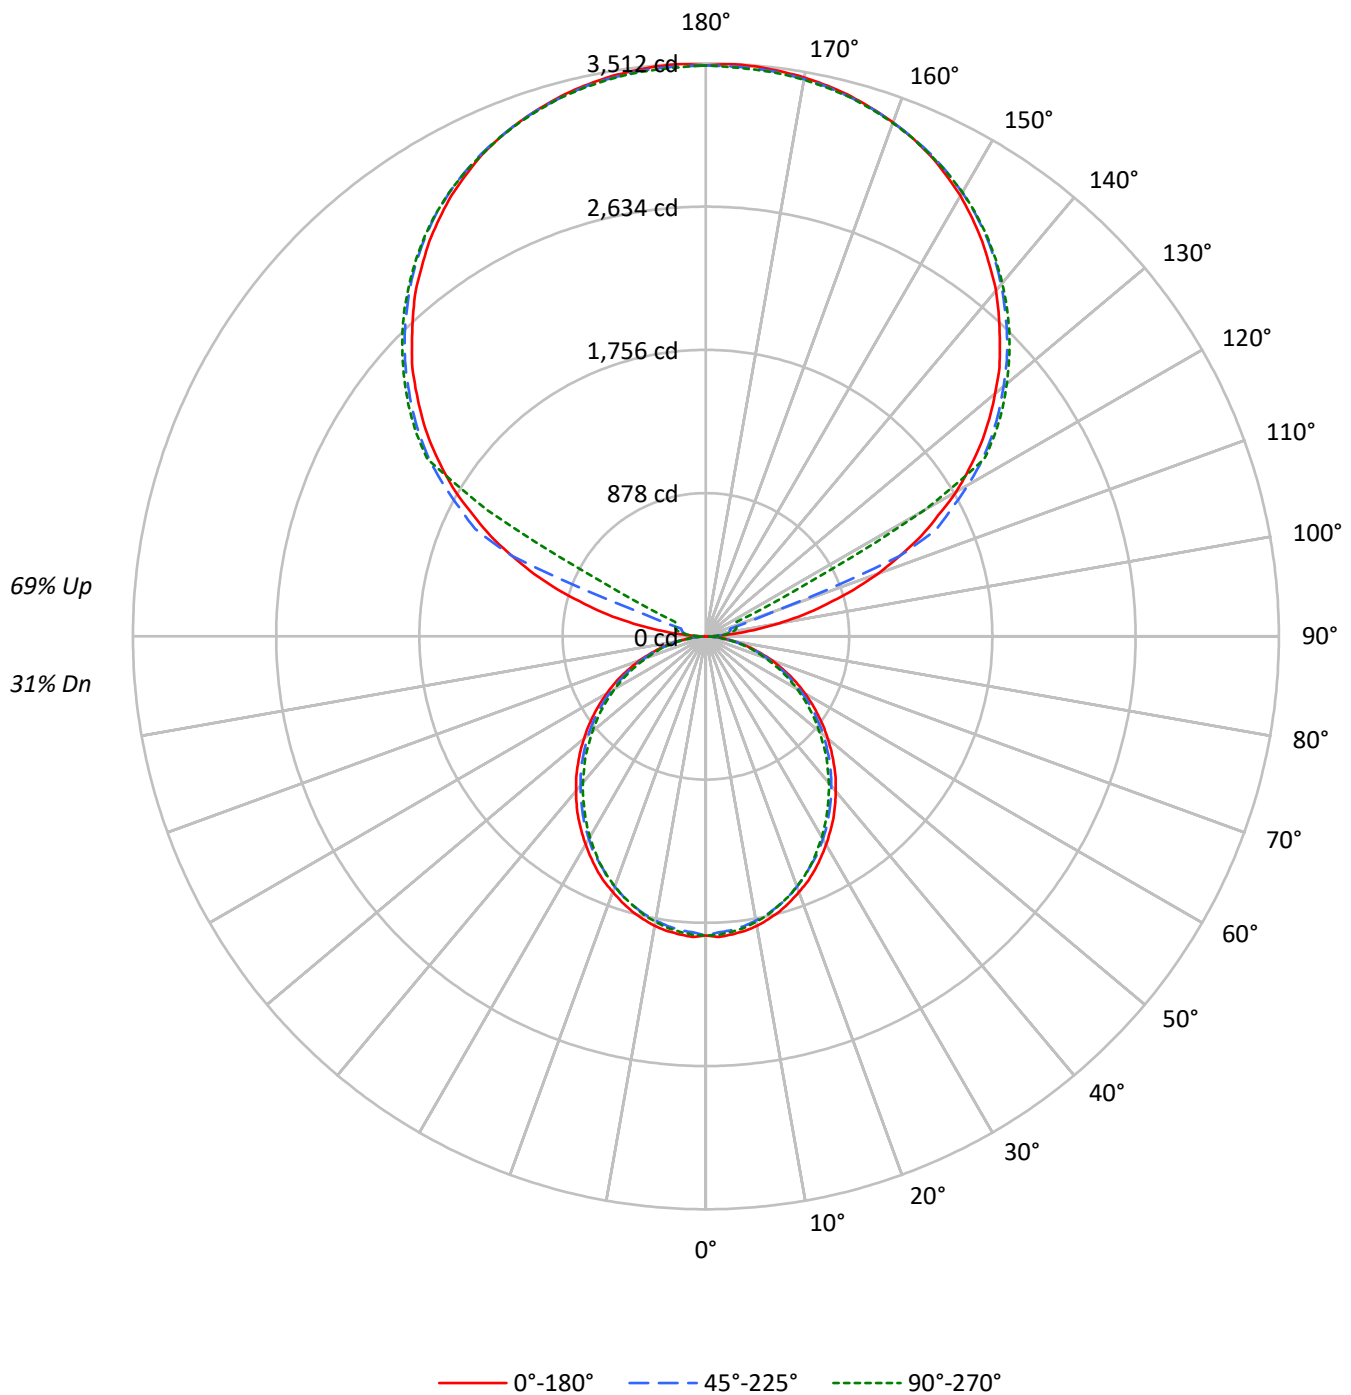

TEST NUMBER: P904607

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	92	92	92	92	73	73	73	55	55	55	39	39	39
1	94	89	86	82	84	80	77	74	64	62	60	48	47	46	34	34	33
2	85	78	72	67	76	70	65	61	56	52	49	43	40	38	30	29	28
3	78	69	61	56	70	62	56	51	49	45	41	38	35	32	27	25	24
4	71	61	53	47	64	55	48	43	44	39	35	33	30	28	24	22	20
5	65	54	46	40	58	49	42	37	39	34	30	30	27	24	22	19	18
6	60	48	40	35	54	44	37	32	35	30	26	27	24	21	20	17	15
7	55	43	36	30	50	39	33	28	32	27	23	25	21	18	18	15	14
8	51	39	32	27	46	36	29	24	29	24	20	22	19	16	16	14	12
9	48	36	28	24	43	32	26	22	26	22	18	21	17	15	15	13	11
10	44	33	26	21	40	30	24	19	24	19	16	19	16	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1457	1457	1457
5°	1459	1436	1446
10°	1447	1417	1426
15°	1426	1394	1396
20°	1397	1361	1365
25°	1369	1323	1328
30°	1333	1286	1282
35°	1299	1244	1233
40°	1257	1201	1187
45°	1215	1158	1140
50°	1170	1113	1084
55°	1122	1060	1034
60°	1068	998	976
65°	1009	934	908
70°	935	856	834
75°	830	762	766
80°	706	642	637
85°	511	435	422

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1856 cd/sqm

TEST NUMBER: P904607

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.6	1.2
10°-20°	485.6	3.3
20°-30°	713.7	4.8
30°-40°	828.9	5.6
40°-50°	827.8	5.5
50°-60°	721.8	4.8
60°-70°	533.6	3.6
70°-80°	301.9	2.0
80°-90°	85.8	0.6
90°-100°	115.4	0.8
100°-110°	430.1	2.9
110°-120°	1140.7	7.6
120°-130°	1892.0	12.7
130°-140°	2009.7	13.5
140°-150°	1867.8	12.5
150°-160°	1501.7	10.1
160°-170°	967.6	6.5
170°-180°	333.0	2.2
0°-30°	1371.9	9.2
0°-40°	2200.7	14.7
0°-60°	3750.4	25.1
0°-90°	4671.7	31.3
90°-120°	1686.2	11.3
90°-150°	7455.8	49.9
90°-180°	10258.0	68.7
0°-180°	14929.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1834	1834	1834	1834	1834	
5°	1834	1827	1807	1821	1818	174
15°	1746	1735	1712	1719	1710	492
25°	1580	1566	1536	1539	1536	727
35°	1363	1346	1317	1307	1298	851
45°	1109	1097	1070	1051	1044	856
55°	839	829	808	786	778	750
65°	566	555	538	522	513	560
75°	296	293	284	273	277	316
85°	72	70	69	63	62	81
90°	2	30	50	63	68	14
95°	164	81	99	112	109	195
105°	770	846	155	182	192	822
115°	1456	1499	1562	390	208	1433
125°	2058	2091	2140	2157	2165	1836
135°	2547	2588	2610	2636	2631	1968
145°	2955	2952	2995	3013	3000	1848
155°	3254	3231	3261	3276	3256	1499
165°	3428	3413	3421	3438	3421	969
175°	3506	3489	3494	3512	3486	334
180°	3499	3499	3499	3499	3499	

TEST NUMBER: P904607

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.7	1833.7	1833.7	1833.7	1833.7
2.5°	1844.4	1835.6	1816.2	1833.7	1830.4
5°	1833.7	1826.8	1807.3	1821.4	1818.1
7.5°	1821.4	1810.9	1791.5	1805.7	1802.1
10°	1802.1	1789.8	1768.7	1782.6	1777.4
12.5°	1775.6	1765.1	1744.0	1752.8	1749.2
15°	1745.6	1735.1	1712.1	1719.3	1710.4
17.5°	1708.5	1698.1	1675.1	1683.9	1675.1
20°	1668.0	1657.6	1632.9	1638.0	1631.2
22.5°	1627.6	1611.7	1588.7	1588.7	1585.1
25°	1579.9	1565.8	1535.9	1539.3	1535.9
27.5°	1526.9	1514.6	1491.8	1486.5	1477.7
30°	1474.1	1460.0	1433.6	1428.3	1421.3
32.5°	1417.7	1407.2	1378.9	1368.3	1361.2
35°	1363.0	1345.5	1317.2	1306.6	1297.8
37.5°	1301.3	1285.4	1257.2	1244.8	1236.0
40°	1237.9	1223.7	1195.4	1179.7	1172.6
42.5°	1176.2	1162.0	1133.9	1116.1	1105.6
45°	1109.2	1096.8	1070.3	1051.0	1043.9
47.5°	1043.9	1031.5	1003.3	983.8	973.4
50°	975.1	966.3	941.6	916.9	908.0
52.5°	908.0	895.7	872.9	853.5	841.1
55°	839.4	828.8	807.6	786.5	777.7
57.5°	770.5	761.8	738.8	717.7	710.5
60°	701.7	694.8	670.1	650.6	645.5
62.5°	634.8	622.5	604.8	587.2	580.1
65°	566.1	555.4	537.8	522.0	513.1
67.5°	495.6	486.6	470.9	458.5	451.4
70°	430.3	423.2	407.3	394.9	388.0
72.5°	363.4	356.2	347.4	335.1	329.8
75°	296.1	292.8	283.8	273.3	276.9
77.5°	236.3	229.1	225.6	220.4	215.2
80°	176.4	174.6	171.0	165.8	162.2
82.5°	119.9	119.9	118.2	111.1	111.1
85°	72.2	70.5	68.8	63.4	61.7
87.5°	31.8	28.3	24.7	19.4	17.6
90°	2.5	30.3	50.5	63.4	68.2
92.5°	63.4	53.3	60.7	65.9	68.2
95°	164.5	80.9	98.6	111.5	108.9
97.5°	296.1	88.7	128.9	136.8	139.2
100°	448.3	101.3	144.3	164.5	169.6
102.5°	615.1	610.3	149.4	177.1	184.9
105°	769.7	845.7	154.6	182.2	192.5
107.5°	949.5	1012.6	159.7	187.3	197.6
110°	1121.7	1174.7	443.2	190.0	199.9

TEST NUMBER: P904607

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1283.8	1329.2	1286.2	194.8	202.6
115°	1455.8	1498.7	1562.3	389.9	207.7
117.5°	1605.2	1655.8	1699.0	1336.7	673.4
120°	1772.4	1810.2	1856.0	1886.3	1544.4
122.5°	1914.0	1954.5	2005.4	2020.4	2023.2
125°	2058.3	2091.4	2139.5	2157.2	2164.7
127.5°	2190.0	2225.4	2263.6	2288.9	2291.3
130°	2314.1	2354.8	2382.4	2410.4	2408.0
132.5°	2440.7	2473.8	2501.5	2524.3	2522.0
135°	2547.2	2587.7	2610.3	2635.9	2630.7
137.5°	2658.4	2688.8	2714.3	2739.6	2732.1
140°	2767.3	2787.7	2815.4	2838.2	2825.6
142.5°	2858.6	2876.4	2909.2	2929.3	2916.7
145°	2954.9	2952.1	2995.1	3012.9	3000.3
147.5°	3038.2	3030.7	3073.6	3086.3	3076.4
150°	3119.3	3101.6	3142.2	3157.2	3144.6
152.5°	3187.6	3167.4	3205.3	3220.7	3202.9
155°	3253.5	3230.8	3261.2	3276.3	3256.1
157.5°	3306.6	3286.5	3309.4	3327.1	3306.6
160°	3352.3	3337.0	3352.3	3367.3	3349.6
162.5°	3392.6	3377.6	3390.2	3408.0	3385.1
165°	3428.1	3413.0	3420.6	3438.3	3420.6
167.5°	3456.0	3440.8	3448.6	3466.3	3443.5
170°	3478.9	3463.6	3468.6	3486.5	3463.6
172.5°	3493.9	3478.9	3484.0	3501.7	3478.9
175°	3506.5	3488.8	3493.9	3511.7	3486.5
177.5°	3511.7	3493.9	3496.6	3514.4	3491.6
180°	3499.1	3499.1	3499.1	3499.1	3499.1

TEST NUMBER: P904607

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.53	7.25	7.64	8.35	9.86	6.10	6.82	7.21	7.92	9.43
	3H	8.18	8.82	9.29	9.93	11.46	7.71	8.35	8.82	9.46	10.99
	4H	8.76	9.37	9.88	10.48	12.02	8.29	8.90	9.41	10.01	11.54
	6H	9.16	9.71	10.29	10.83	12.38	8.68	9.24	9.81	10.35	11.90
	8H	9.26	9.79	10.39	10.91	12.46	8.78	9.31	9.91	10.44	11.98
	12H	9.30	9.80	10.44	10.92	12.49	8.82	9.32	9.96	10.44	12.01
4H	2H	6.98	7.59	8.11	8.69	10.23	6.63	7.24	7.76	8.35	9.89
	3H	8.83	9.34	9.96	10.47	12.02	8.44	8.94	9.57	10.08	11.63
	4H	9.54	10.00	10.68	11.13	12.70	9.13	9.60	10.27	10.72	12.29
	6H	10.04	10.44	11.19	11.59	13.15	9.64	10.03	10.78	11.18	12.74
	8H	10.19	10.56	11.33	11.70	13.28	9.78	10.15	10.92	11.29	12.87
	12H	10.26	10.59	11.42	11.74	13.33	9.83	10.17	11.00	11.32	12.91
8H	4H	9.72	10.10	10.87	11.23	12.81	9.36	9.74	10.51	10.87	12.45
	6H	10.35	10.66	11.51	11.84	13.41	9.99	10.29	11.15	11.47	13.05
	8H	10.57	10.84	11.74	12.00	13.59	10.20	10.47	11.37	11.63	13.22
	12H	10.69	10.93	11.87	12.08	13.71	10.31	10.54	11.48	11.70	13.33
12H	4H	9.70	10.04	10.86	11.19	12.77	9.35	9.69	10.51	10.84	12.42
	6H	10.38	10.65	11.55	11.81	13.40	10.02	10.29	11.20	11.45	13.05
	8H	10.61	10.85	11.79	12.00	13.63	10.25	10.49	11.43	11.65	13.28

END OF REPORT