

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904619

Luminaire Tested: DFN2DIP-TR4F0-060D050US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904619
REPORT IS A COMBINATION OF REPORTS P901911 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D050US830-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10264.3 lumens
Efficiency: N/A
Efficacy: 112.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 91.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904619

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US830-FLLONL

Luminous Intensity Polar Plot

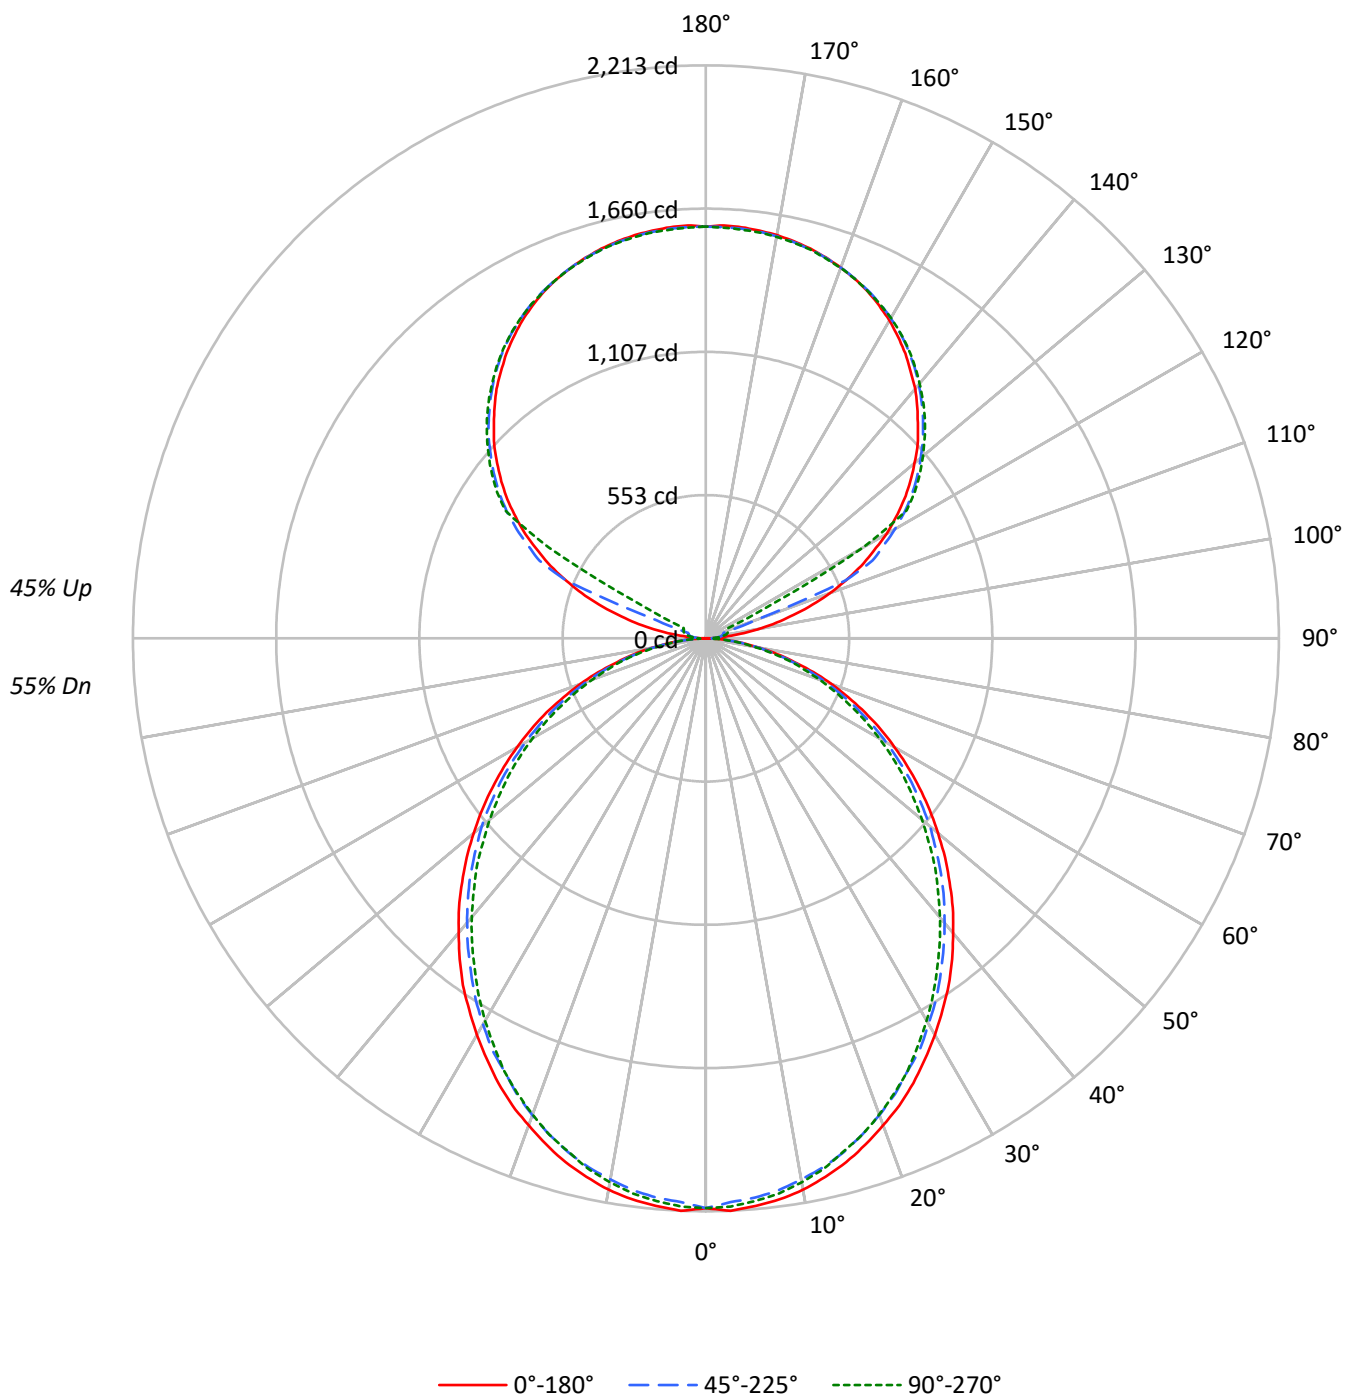

TEST NUMBER: P904619

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1748	1748	1748
5°	1751	1724	1735
10°	1737	1700	1712
15°	1711	1673	1675
20°	1677	1634	1637
25°	1642	1587	1594
30°	1600	1544	1538
35°	1559	1493	1480
40°	1508	1441	1424
45°	1459	1389	1367
50°	1404	1335	1302
55°	1347	1272	1241
60°	1282	1198	1171
65°	1211	1121	1089
70°	1121	1027	1001
75°	997	914	920
80°	847	770	764
85°	612	523	506

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1459 cd/sqm

TEST NUMBER: P904619

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	2.0
10°-20°	582.7	5.7
20°-30°	856.4	8.3
30°-40°	994.6	9.7
40°-50°	993.4	9.7
50°-60°	866.2	8.4
60°-70°	640.3	6.2
70°-80°	362.3	3.5
80°-90°	98.4	1.0
90°-100°	52.5	0.5
100°-110°	195.5	1.9
110°-120°	518.5	5.1
120°-130°	860.0	8.4
130°-140°	913.5	8.9
140°-150°	849.0	8.3
150°-160°	682.6	6.7
160°-170°	439.8	4.3
170°-180°	151.4	1.5
0°-30°	1646.2	16.0
0°-40°	2640.9	25.7
0°-60°	4500.5	43.8
0°-90°	5601.5	54.6
90°-120°	766.5	7.5
90°-150°	3389.0	33.0
90°-180°	4663.0	45.4
0°-180°	10264.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	1	14	23	29	31	9
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P904619

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9



TEST NUMBER: P904619

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P904619

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.62	10.52	10.54	11.46	12.66	9.19	10.09	10.11	11.03	12.23
	3H	11.28	12.09	12.21	13.04	14.27	10.81	11.62	11.74	12.57	13.79
	4H	11.87	12.64	12.82	13.59	14.83	11.40	12.17	12.34	13.12	14.35
	6H	12.27	12.98	13.23	13.94	15.19	11.80	12.51	12.75	13.46	14.71
	8H	12.38	13.05	13.34	14.03	15.27	11.91	12.58	12.87	13.55	14.80
	12H	12.43	13.07	13.40	14.04	15.31	11.95	12.59	12.92	13.56	14.83
4H	2H	10.09	10.85	11.04	11.80	13.04	9.74	10.51	10.69	11.46	12.70
	3H	11.96	12.60	12.92	13.58	14.83	11.56	12.20	12.52	13.18	14.44
	4H	12.67	13.26	13.64	14.23	15.51	12.27	12.85	13.24	13.83	15.10
	6H	13.19	13.69	14.17	14.69	15.97	12.78	13.29	13.76	14.28	15.56
	8H	13.34	13.81	14.32	14.80	16.09	12.93	13.40	13.91	14.39	15.68
	12H	13.42	13.84	14.42	14.85	16.14	12.99	13.42	14.00	14.43	15.72
8H	4H	12.87	13.34	13.86	14.33	15.62	12.51	12.98	13.50	13.97	15.26
	6H	13.51	13.90	14.51	14.93	16.22	13.14	13.53	14.15	14.57	15.85
	8H	13.73	14.07	14.74	15.09	16.40	13.36	13.70	14.37	14.72	16.03
	12H	13.86	14.16	14.88	15.18	16.53	13.48	13.78	14.50	14.79	16.14
12H	4H	12.86	13.29	13.86	14.29	15.59	12.51	12.93	13.51	13.94	15.24
	6H	13.54	13.88	14.55	14.90	16.21	13.18	13.53	14.20	14.55	15.85
	8H	13.78	14.08	14.80	15.10	16.45	13.42	13.73	14.44	14.74	16.09