

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912830

Luminaire Tested: DFN2DIP-TR4F0-060D120US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912830
REPORT IS A COMBINATION OF REPORTS P900517 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D120US850-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18365.0 lumens
Efficiency: N/A
Efficacy: 126.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 144.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912830

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US850-FLLFLL

Luminous Intensity Polar Plot

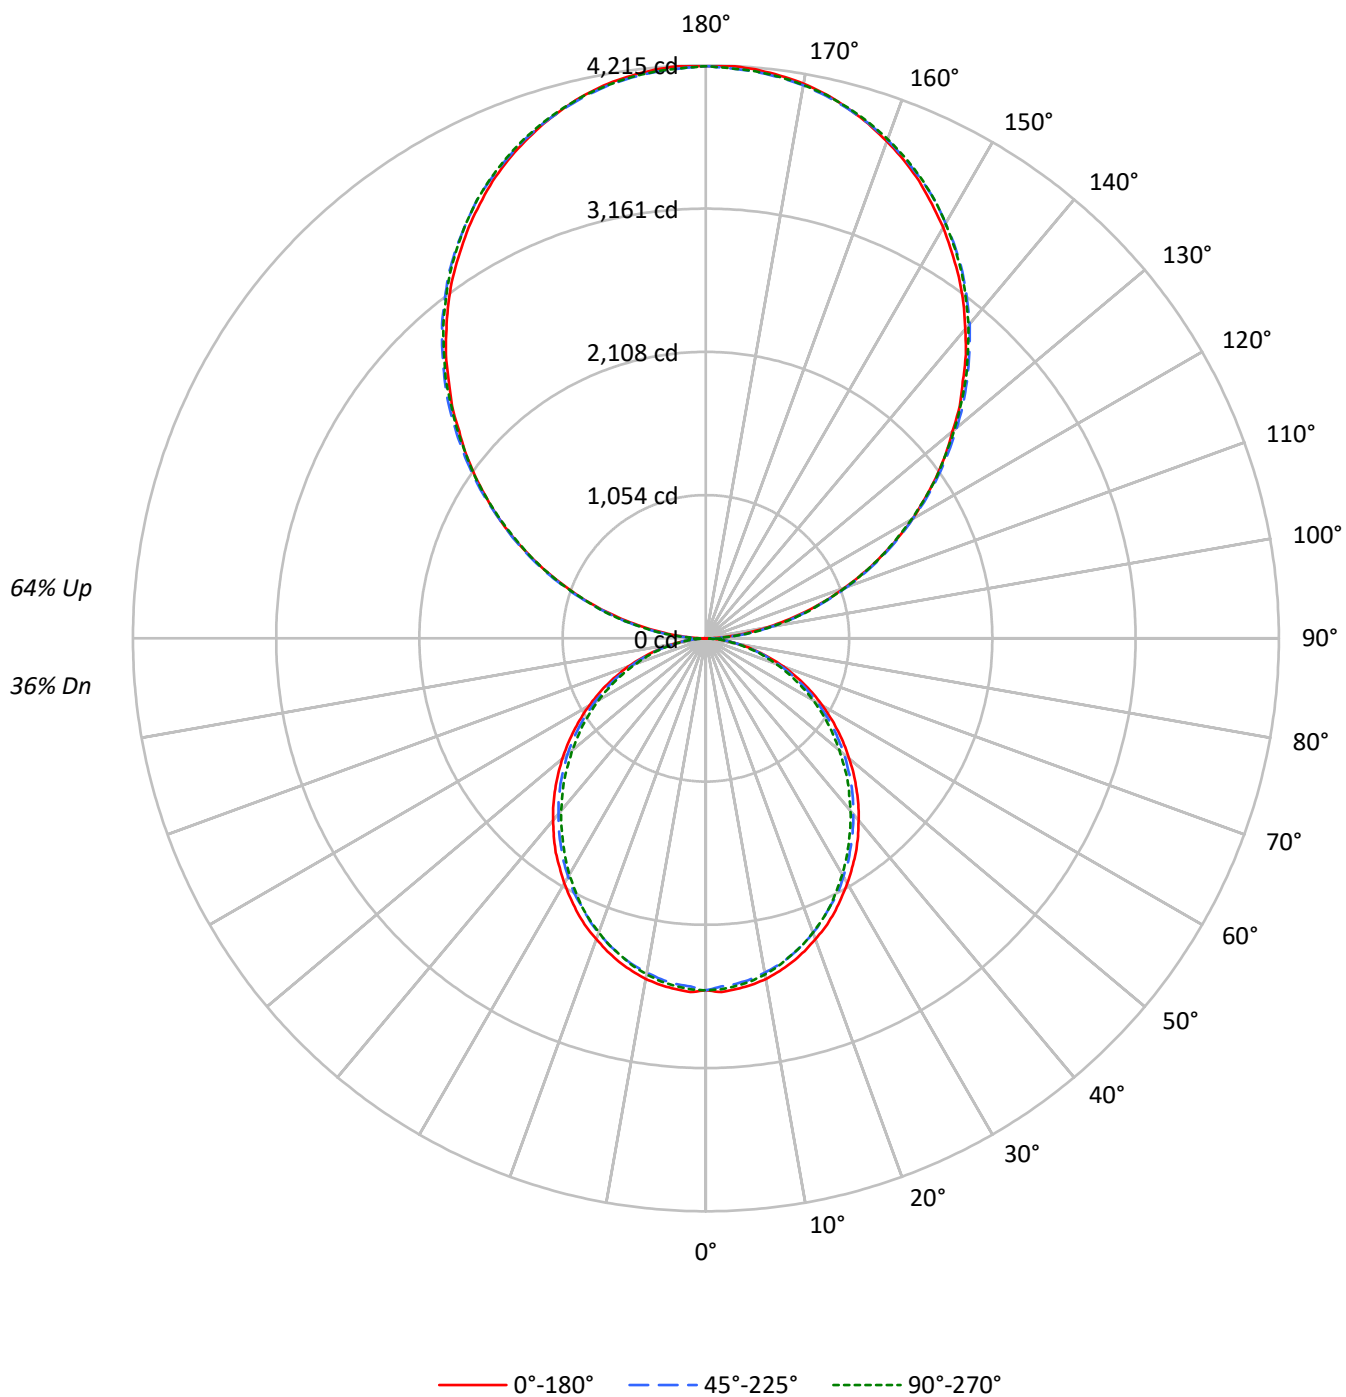

TEST NUMBER: P912830

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2057	2057	2057
5°	2060	2028	2042
10°	2044	2001	2014
15°	2013	1968	1971
20°	1973	1922	1927
25°	1932	1867	1875
30°	1882	1816	1810
35°	1834	1756	1741
40°	1775	1696	1676
45°	1716	1635	1609
50°	1652	1571	1531
55°	1584	1497	1460
60°	1508	1409	1378
65°	1425	1319	1282
70°	1319	1208	1178
75°	1173	1075	1082
80°	997	906	899
85°	721	615	596

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3280 cd/sqm

TEST NUMBER: P912830

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.7	1.3
10°-20°	685.6	3.7
20°-30°	1007.6	5.5
30°-40°	1170.3	6.4
40°-50°	1168.8	6.4
50°-60°	1019.2	5.5
60°-70°	753.4	4.1
70°-80°	426.3	2.3
80°-90°	124.4	0.7
90°-100°	260.4	1.4
100°-110°	827.5	4.5
110°-120°	1416.1	7.7
120°-130°	1862.4	10.1
130°-140°	2090.5	11.4
140°-150°	2050.0	11.2
150°-160°	1719.6	9.4
160°-170°	1140.4	6.2
170°-180°	398.6	2.2
0°-30°	1937.0	10.5
0°-40°	3107.2	16.9
0°-60°	5295.3	28.8
0°-90°	6599.4	35.9
90°-120°	2504.0	13.6
90°-150°	8506.9	46.3
90°-180°	11766.0	64.1
0°-180°	18365.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2589	2589	2589	2589	2589	
5°	2589	2579	2552	2572	2567	246
15°	2465	2450	2417	2428	2415	694
25°	2231	2211	2168	2173	2168	1026
35°	1925	1900	1860	1845	1832	1202
45°	1566	1549	1511	1484	1474	1209
55°	1185	1170	1140	1110	1098	1060
65°	799	784	759	737	724	790
75°	418	413	401	386	391	446
85°	102	100	97	90	87	114
90°	4	46	124	117	120	18
95°	185	221	227	227	221	206
105°	764	774	782	788	788	806
115°	1421	1442	1435	1431	1421	1406
125°	2067	2099	2089	2077	2073	1847
135°	2674	2713	2720	2717	2706	2066
145°	3246	3271	3291	3295	3281	2028
155°	3711	3722	3733	3751	3739	1708
165°	4038	4034	4034	4059	4041	1139
175°	4201	4191	4184	4209	4187	399
180°	4209	4209	4209	4209	4209	

TEST NUMBER: P912830

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2589.1	2589.1	2589.1	2589.1	2589.1
2.5°	2604.2	2591.7	2564.2	2589.1	2584.3
5°	2589.1	2579.3	2551.8	2571.7	2566.9
7.5°	2571.7	2556.9	2529.4	2549.5	2544.5
10°	2544.5	2527.1	2497.1	2517.0	2509.6
12.5°	2507.0	2492.1	2462.3	2474.7	2469.7
15°	2464.6	2449.9	2417.4	2427.5	2415.1
17.5°	2412.4	2397.7	2365.2	2377.5	2365.2
20°	2355.1	2340.3	2305.4	2312.8	2303.1
22.5°	2298.1	2275.6	2243.1	2243.1	2238.1
25°	2230.6	2210.9	2168.5	2173.3	2168.5
27.5°	2155.9	2138.5	2106.2	2098.9	2086.5
30°	2081.5	2061.3	2024.1	2016.7	2006.6
32.5°	2001.6	1986.9	1947.0	1931.9	1921.9
35°	1924.6	1899.7	1859.8	1844.7	1832.3
37.5°	1837.4	1814.9	1775.1	1757.5	1745.1
40°	1747.8	1727.7	1687.9	1665.7	1655.6
42.5°	1660.6	1640.5	1601.0	1575.9	1561.0
45°	1566.1	1548.6	1511.1	1484.0	1473.9
47.5°	1473.9	1456.4	1416.6	1389.1	1374.3
50°	1376.7	1364.3	1329.5	1294.5	1282.1
52.5°	1282.1	1264.7	1232.4	1205.0	1187.6
55°	1185.2	1170.1	1140.3	1110.4	1098.0
57.5°	1088.0	1075.6	1043.1	1013.3	1003.2
60°	990.8	981.0	946.2	918.7	911.3
62.5°	896.2	878.8	853.9	829.1	819.1
65°	799.3	784.3	759.4	736.9	724.5
67.5°	699.7	687.0	664.8	647.4	637.3
70°	607.5	597.5	575.0	557.6	547.8
72.5°	512.9	502.9	490.5	473.1	465.7
75°	418.1	413.4	400.7	385.9	390.9
77.5°	333.6	323.6	318.5	311.2	303.8
80°	249.1	246.4	241.4	234.0	229.0
82.5°	169.3	169.3	166.9	156.9	156.9
85°	101.9	99.6	97.1	89.5	87.2
87.5°	44.9	39.9	34.8	27.5	24.8
90°	3.8	45.7	124.3	116.8	120.5
92.5°	78.6	106.6	110.3	114.2	114.2
95°	185.2	220.8	227.1	227.1	220.8
97.5°	308.3	341.4	355.3	355.3	355.3
100°	450.5	479.6	489.7	489.7	486.0
102.5°	600.2	621.7	635.7	639.6	635.7
105°	763.9	774.0	781.6	787.9	787.9
107.5°	926.2	941.5	941.5	944.0	926.2
110°	1083.6	1103.9	1103.9	1103.9	1093.8



TEST NUMBER: P912830

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1253.6	1275.2	1271.4	1261.3	1253.6
115°	1421.1	1441.5	1435.0	1431.3	1421.1
117.5°	1587.3	1615.3	1597.5	1587.3	1577.2
120°	1754.9	1782.7	1754.9	1754.9	1743.5
122.5°	1907.1	1942.6	1924.9	1914.7	1907.1
125°	2067.0	2098.7	2088.6	2077.2	2073.3
127.5°	2223.1	2262.4	2248.4	2233.2	2223.1
130°	2368.9	2414.6	2408.3	2400.7	2386.7
132.5°	2532.6	2568.2	2570.7	2552.9	2542.8
135°	2673.5	2712.8	2720.5	2716.6	2706.5
137.5°	2830.8	2862.6	2868.9	2866.3	2851.1
140°	2969.1	3000.8	3018.6	3018.6	3004.6
142.5°	3111.3	3143.0	3153.1	3156.9	3143.0
145°	3245.7	3271.1	3291.4	3295.3	3281.3
147.5°	3366.3	3398.0	3413.3	3419.6	3405.6
150°	3490.7	3512.2	3526.2	3537.6	3526.2
152.5°	3601.0	3622.5	3640.4	3654.4	3640.4
155°	3711.4	3721.6	3733.0	3750.7	3739.3
157.5°	3806.6	3814.2	3820.5	3845.9	3828.2
160°	3891.6	3899.2	3903.0	3924.6	3909.3
162.5°	3970.2	3970.2	3974.1	3998.2	3980.4
165°	4037.5	4033.8	4033.8	4059.1	4041.3
167.5°	4098.4	4087.0	4087.0	4112.4	4094.6
170°	4144.1	4133.9	4130.1	4155.5	4133.9
172.5°	4175.8	4165.6	4161.9	4187.3	4165.6
175°	4201.2	4191.0	4183.5	4208.8	4187.3
177.5°	4215.2	4205.0	4197.3	4219.0	4197.3
180°	4208.8	4208.8	4208.8	4208.8	4208.8

TEST NUMBER: P912830

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.31	9.06	9.38	10.13	11.59	7.88	8.62	8.95	9.70	11.15
	3H	9.96	10.63	11.04	11.71	13.19	9.49	10.16	10.57	11.24	12.71
	4H	10.54	11.18	11.63	12.26	13.74	10.07	10.70	11.16	11.79	13.27
	6H	10.94	11.52	12.03	12.60	14.10	10.46	11.05	11.56	12.13	13.63
	8H	11.04	11.59	12.14	12.69	14.18	10.56	11.12	11.66	12.22	13.71
	12H	11.08	11.61	12.19	12.70	14.22	10.60	11.13	11.71	12.22	13.74
4H	2H	8.76	9.39	9.85	10.47	11.96	8.41	9.05	9.51	10.13	11.61
	3H	10.61	11.14	11.71	12.25	13.75	10.22	10.75	11.32	11.86	13.35
	4H	11.32	11.81	12.43	12.91	14.42	10.92	11.40	12.02	12.50	14.02
	6H	11.83	12.25	12.94	13.37	14.88	11.42	11.84	12.54	12.96	14.47
	8H	11.98	12.37	13.09	13.48	15.00	11.56	11.95	12.68	13.07	14.59
	12H	12.04	12.40	13.18	13.52	15.05	11.62	11.98	12.75	13.10	14.63
8H	4H	11.51	11.90	12.62	13.01	14.54	11.15	11.54	12.26	12.65	14.18
	6H	12.13	12.46	13.27	13.61	15.13	11.77	12.09	12.91	13.25	14.77
	8H	12.35	12.64	13.50	13.77	15.31	11.99	12.27	13.13	13.40	14.95
	12H	12.48	12.73	13.63	13.86	15.44	12.10	12.34	13.24	13.48	15.05
12H	4H	11.49	11.84	12.62	12.97	14.50	11.14	11.49	12.27	12.62	14.15
	6H	12.16	12.45	13.31	13.58	15.12	11.81	12.09	12.95	13.23	14.77
	8H	12.40	12.65	13.55	13.78	15.36	12.04	12.29	13.19	13.42	15.00

END OF REPORT