

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912847

Luminaire Tested: DFN2DIP-TR4F0-070D070US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912847
REPORT IS A COMBINATION OF REPORTS P901949 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D070US850-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15370.8 lumens
Efficiency: N/A
Efficacy: 130.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 117.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912847

CATALOG NUMBER: DFN2DIP-TR4F0-070D070US850-FLLONL

Luminous Intensity Polar Plot

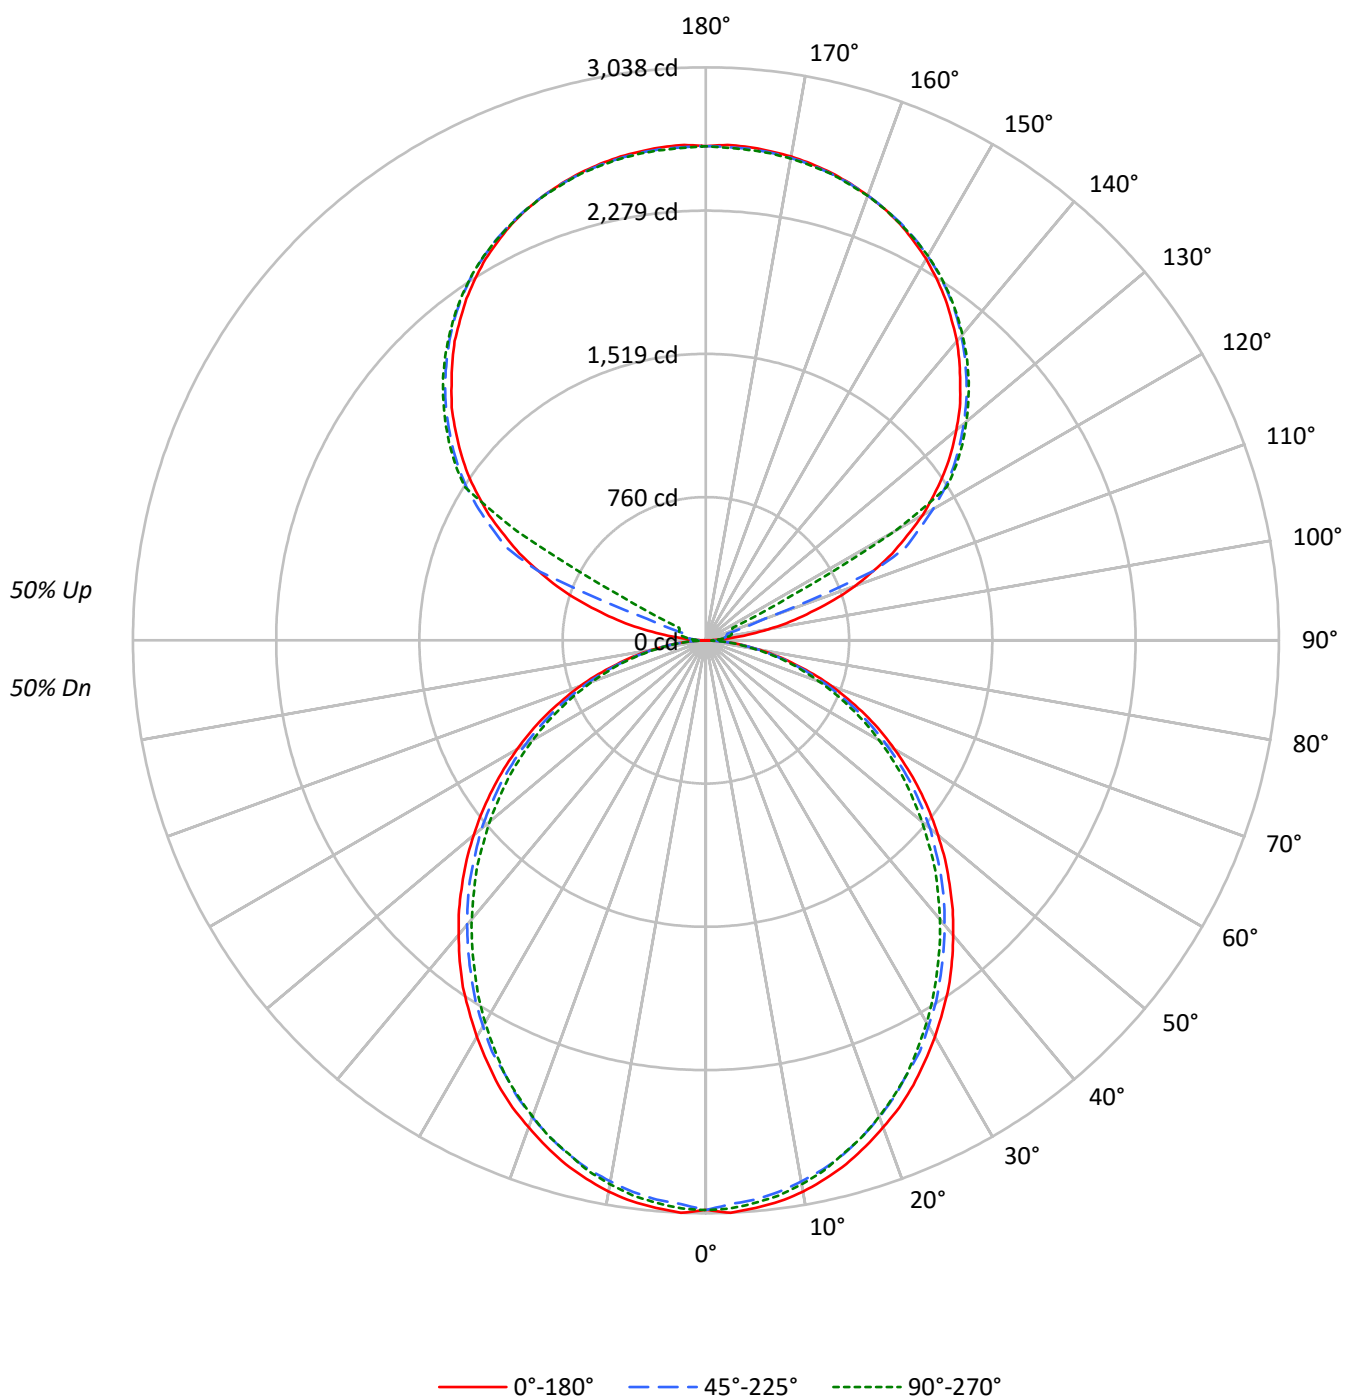

TEST NUMBER: P912847

CATALOG NUMBER: DFN2DIP-TR4F0-070D070US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2400	2400	2400
5°	2404	2366	2382
10°	2384	2334	2350
15°	2349	2296	2299
20°	2302	2242	2248
25°	2255	2179	2188
30°	2196	2119	2112
35°	2140	2049	2032
40°	2071	1978	1955
45°	2002	1907	1877
50°	1927	1833	1787
55°	1848	1747	1703
60°	1760	1644	1608
65°	1663	1538	1495
70°	1539	1409	1374
75°	1368	1254	1262
80°	1163	1058	1049
85°	842	718	695

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2002 cd/sqm

TEST NUMBER: P912847

CATALOG NUMBER: DFN2DIP-TR4F0-070D070US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	284.3	1.8
10°-20°	799.9	5.2
20°-30°	1175.6	7.6
30°-40°	1365.3	8.9
40°-50°	1363.6	8.9
50°-60°	1189.1	7.7
60°-70°	879.0	5.7
70°-80°	497.3	3.2
80°-90°	135.9	0.9
90°-100°	86.4	0.6
100°-110°	322.1	2.1
110°-120°	854.1	5.6
120°-130°	1416.6	9.2
130°-140°	1504.8	9.8
140°-150°	1398.5	9.1
150°-160°	1124.4	7.3
160°-170°	724.5	4.7
170°-180°	249.4	1.6
0°-30°	2259.8	14.7
0°-40°	3625.1	23.6
0°-60°	6177.8	40.2
0°-90°	7690.0	50.0
90°-120°	1262.6	8.2
90°-150°	5582.5	36.3
90°-180°	7681.0	50.0
0°-180°	15370.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3021	3021	3021	3021	3021	
5°	3021	3009	2977	3000	2995	287
15°	2876	2858	2820	2832	2818	810
25°	2602	2579	2530	2536	2530	1198
35°	2245	2216	2170	2152	2138	1402
45°	1827	1807	1763	1731	1720	1410
55°	1383	1365	1330	1296	1281	1236
65°	933	915	886	860	845	922
75°	488	482	467	450	456	521
85°	119	116	114	104	102	133
90°	2	23	38	48	51	14
95°	123	61	74	84	82	146
105°	576	633	116	136	144	616
115°	1090	1122	1170	292	156	1073
125°	1541	1566	1602	1615	1621	1375
135°	1907	1938	1954	1974	1970	1473
145°	2212	2210	2243	2256	2246	1384
155°	2436	2419	2442	2453	2438	1123
165°	2567	2556	2561	2574	2561	725
175°	2626	2612	2616	2629	2610	250
180°	2620	2620	2620	2620	2620	

TEST NUMBER: P912847

CATALOG NUMBER: DFN2DIP-TR4F0-070D070US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3020.6	3020.6	3020.6	3020.6	3020.6
2.5°	3038.2	3023.7	2991.6	3020.6	3015.0
5°	3020.6	3009.3	2977.2	3000.3	2994.7
7.5°	3000.3	2983.0	2950.9	2974.4	2968.6
10°	2968.6	2948.2	2913.3	2936.5	2927.9
12.5°	2924.8	2907.6	2872.8	2887.2	2881.3
15°	2875.5	2858.2	2820.3	2832.1	2817.5
17.5°	2814.4	2797.2	2759.3	2773.8	2759.3
20°	2747.5	2730.4	2689.7	2698.3	2686.9
22.5°	2681.0	2654.8	2616.9	2616.9	2611.0
25°	2602.5	2579.3	2530.1	2535.6	2530.1
27.5°	2515.2	2494.9	2457.3	2448.7	2434.1
30°	2428.4	2404.9	2361.5	2352.9	2341.1
32.5°	2335.2	2318.0	2271.5	2253.9	2242.2
35°	2245.3	2216.3	2169.8	2152.2	2137.7
37.5°	2143.6	2117.4	2070.8	2050.5	2036.0
40°	2039.1	2015.7	1969.1	1943.3	1931.5
42.5°	1937.4	1914.0	1867.8	1838.5	1821.2
45°	1827.1	1806.8	1763.0	1731.3	1719.5
47.5°	1719.5	1699.2	1652.6	1620.6	1603.4
50°	1606.2	1591.6	1550.9	1510.3	1495.8
52.5°	1495.8	1475.5	1437.9	1405.9	1385.5
55°	1382.7	1365.2	1330.4	1295.5	1281.0
57.5°	1269.4	1254.8	1216.9	1182.1	1170.4
60°	1155.9	1144.5	1103.9	1071.8	1063.2
62.5°	1045.6	1025.3	996.3	967.4	955.6
65°	932.6	914.9	886.0	859.8	845.3
67.5°	816.3	801.6	775.6	755.3	743.6
70°	708.8	697.1	670.8	650.5	639.1
72.5°	598.4	586.8	572.2	551.9	543.3
75°	487.8	482.3	467.4	450.3	456.1
77.5°	389.3	377.5	371.6	363.0	354.4
80°	290.6	287.6	281.7	273.0	267.2
82.5°	197.5	197.5	194.7	183.1	183.1
85°	119.0	116.2	113.5	104.5	101.7
87.5°	52.3	46.6	40.7	32.1	28.9
90°	1.8	22.7	37.8	47.5	51.1
92.5°	47.5	39.8	45.5	49.4	51.1
95°	123.1	60.6	73.9	83.5	81.5
97.5°	221.7	66.4	96.6	102.5	104.2
100°	335.7	75.9	108.0	123.1	127.0
102.5°	460.6	457.0	111.9	132.6	138.4
105°	576.3	633.2	115.7	136.4	144.1
107.5°	710.9	758.2	119.6	140.3	147.9
110°	840.0	879.5	331.8	142.3	149.7



TEST NUMBER: P912847

CATALOG NUMBER: DFN2DIP-TR4F0-070D070US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	961.3	995.2	963.1	145.8	151.7
115°	1090.0	1122.2	1169.7	292.0	155.6
117.5°	1201.9	1239.8	1272.1	1000.9	504.3
120°	1327.0	1355.4	1389.7	1412.4	1156.5
122.5°	1433.0	1463.4	1501.6	1512.8	1514.8
125°	1541.2	1565.9	1602.0	1615.3	1620.8
127.5°	1639.8	1666.3	1694.9	1713.8	1715.6
130°	1732.7	1763.1	1783.8	1804.8	1803.0
132.5°	1827.5	1852.3	1873.0	1890.1	1888.3
135°	1907.1	1937.5	1954.5	1973.6	1969.8
137.5°	1990.4	2013.3	2032.4	2051.3	2045.7
140°	2071.9	2087.2	2108.0	2125.1	2115.6
142.5°	2140.4	2153.7	2178.2	2193.3	2183.8
145°	2212.5	2210.5	2242.6	2255.9	2246.5
147.5°	2274.8	2269.2	2301.4	2310.8	2303.4
150°	2335.6	2322.4	2352.7	2363.9	2354.5
152.5°	2386.7	2371.6	2400.0	2411.4	2398.2
155°	2436.0	2419.1	2441.8	2453.1	2438.0
157.5°	2475.8	2460.8	2477.8	2491.1	2475.8
160°	2510.1	2498.6	2510.1	2521.3	2508.0
162.5°	2540.3	2529.0	2538.4	2551.7	2534.6
165°	2566.8	2555.6	2561.1	2574.4	2561.1
167.5°	2587.7	2576.2	2582.1	2595.4	2578.3
170°	2604.8	2593.4	2597.2	2610.5	2593.4
172.5°	2616.1	2604.8	2608.7	2621.9	2604.8
175°	2625.6	2612.2	2616.1	2629.3	2610.5
177.5°	2629.3	2616.1	2618.1	2631.4	2614.2
180°	2619.9	2619.9	2619.9	2619.9	2619.9

TEST NUMBER: P912847

CATALOG NUMBER: DFN2DIP-TR4F0-070D070US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.31	11.17	11.27	12.14	13.42	9.88	10.74	10.84	11.71	12.98
	3H	11.97	12.74	12.94	13.73	15.02	11.50	12.27	12.47	13.25	14.55
	4H	12.56	13.29	13.54	14.28	15.58	12.09	12.82	13.07	13.80	15.10
	6H	12.96	13.63	13.95	14.62	15.94	12.48	13.16	13.48	14.15	15.46
	8H	13.06	13.70	14.06	14.71	16.02	12.59	13.23	13.59	14.24	15.55
	12H	13.11	13.72	14.12	14.72	16.06	12.63	13.24	13.63	14.24	15.58
4H	2H	10.77	11.50	11.76	12.49	13.79	10.43	11.16	11.42	12.14	13.45
	3H	12.64	13.25	13.64	14.26	15.58	12.25	12.86	13.24	13.87	15.19
	4H	13.35	13.91	14.36	14.92	16.26	12.95	13.51	13.95	14.51	15.85
	6H	13.87	14.35	14.88	15.38	16.72	13.46	13.94	14.48	14.97	16.31
	8H	14.02	14.47	15.04	15.49	16.84	13.61	14.05	14.62	15.08	16.43
	12H	14.09	14.50	15.13	15.54	16.89	13.67	14.07	14.71	15.11	16.47
8H	4H	13.55	14.00	14.57	15.02	16.37	13.19	13.64	14.21	14.66	16.01
	6H	14.18	14.55	15.22	15.62	16.97	13.82	14.19	14.86	15.26	16.60
	8H	14.40	14.73	15.45	15.78	17.15	14.03	14.36	15.08	15.41	16.78
	12H	14.53	14.82	15.59	15.87	17.28	14.15	14.44	15.20	15.48	16.89
12H	4H	13.54	13.94	14.57	14.98	16.34	13.18	13.59	14.22	14.63	15.98
	6H	14.21	14.54	15.26	15.59	16.96	13.86	14.19	14.91	15.24	16.61
	8H	14.45	14.74	15.51	15.79	17.20	14.10	14.38	15.15	15.43	16.84

END OF REPORT