

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915463

Luminaire Tested: DFN2DIP-TR4F0-040D060US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915463
REPORT IS A COMBINATION OF REPORTS P901925 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D060US927-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7842.6 lumens
Efficiency: N/A
Efficacy: 102.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 76.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915463

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US927-FLLONL

Luminous Intensity Polar Plot

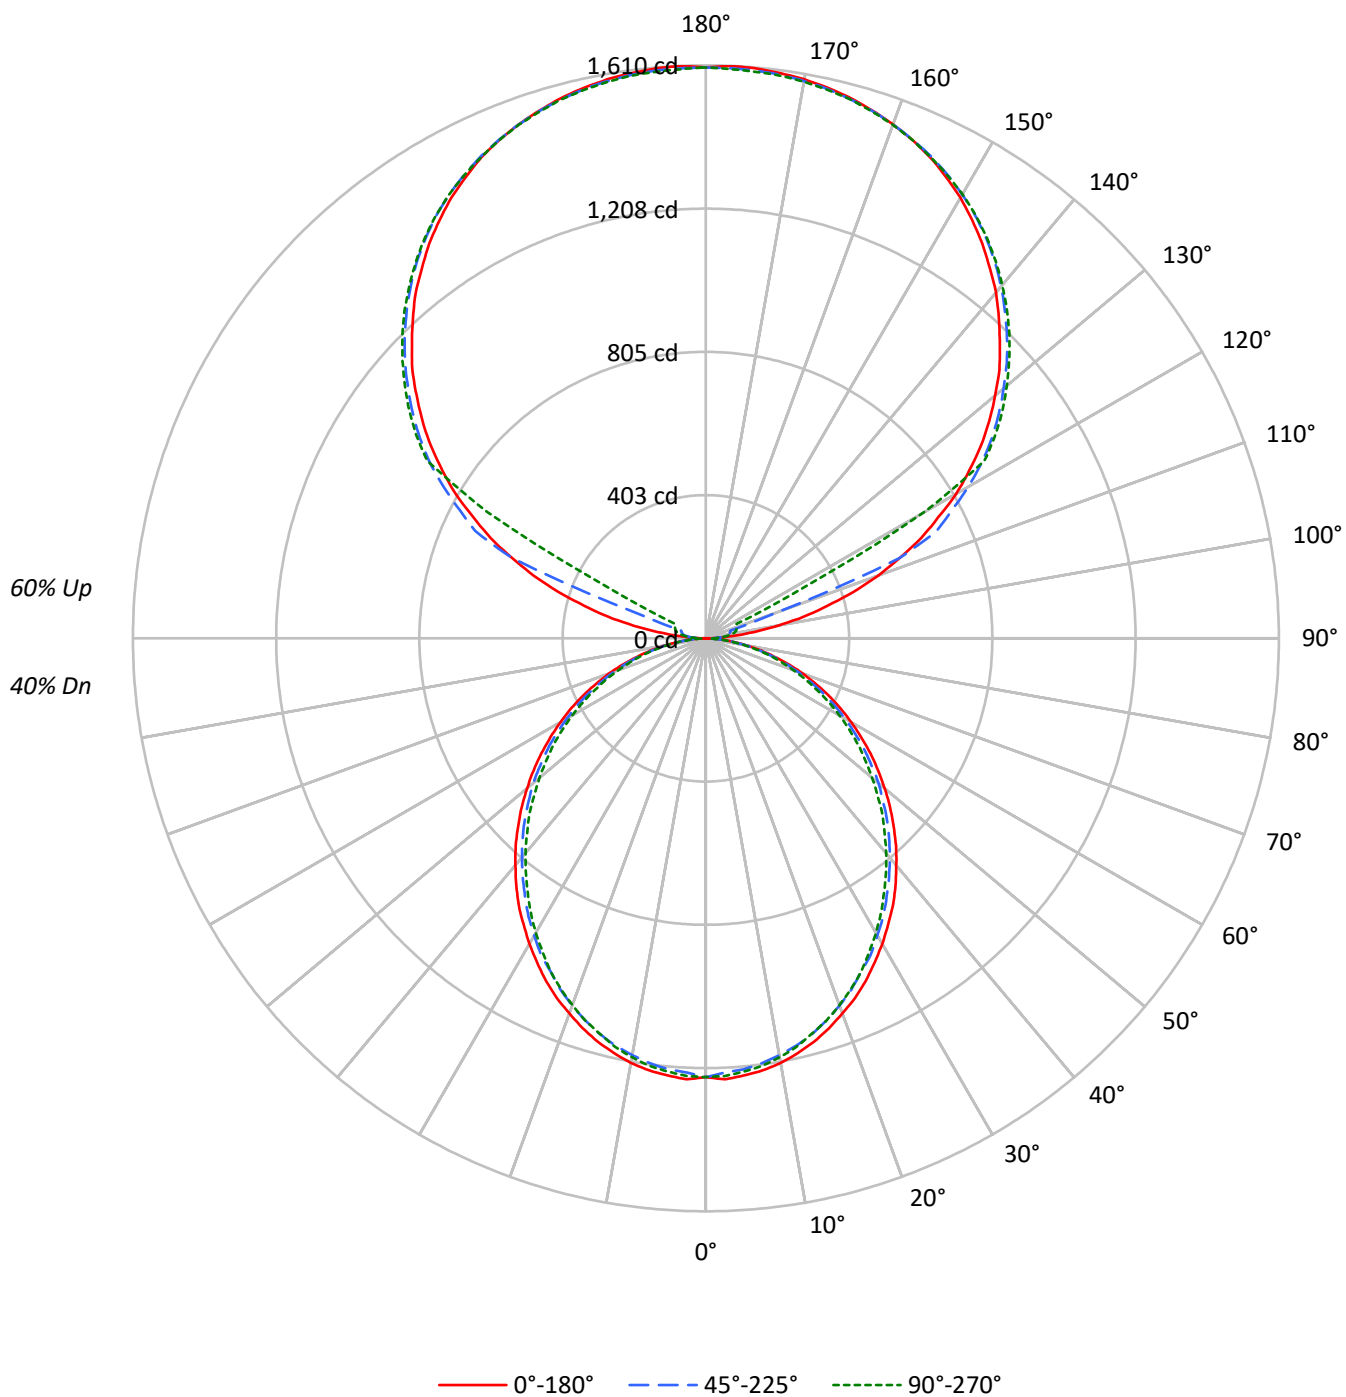

TEST NUMBER: P915463

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US927-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	980	980	980
5°	981	966	972
10°	973	953	959
15°	959	937	939
20°	939	915	918
25°	920	889	893
30°	896	865	862
35°	873	836	829
40°	845	807	798
45°	817	778	766
50°	787	748	729
55°	754	713	695
60°	718	671	656
65°	679	628	610
70°	628	575	561
75°	559	512	515
80°	475	431	428
85°	344	293	284

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 852 cd/sqm

TEST NUMBER: P915463

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.0	1.5
10°-20°	326.5	4.2
20°-30°	479.8	6.1
30°-40°	557.3	7.1
40°-50°	556.6	7.1
50°-60°	485.3	6.2
60°-70°	358.8	4.6
70°-80°	203.0	2.6
80°-90°	56.4	0.7
90°-100°	52.9	0.7
100°-110°	197.2	2.5
110°-120°	523.0	6.7
120°-130°	867.4	11.1
130°-140°	921.3	11.7
140°-150°	856.3	10.9
150°-160°	688.4	8.8
160°-170°	443.6	5.7
170°-180°	152.7	1.9
0°-30°	922.4	11.8
0°-40°	1479.7	18.9
0°-60°	2521.7	32.2
0°-90°	3139.8	40.0
90°-120°	773.0	9.9
90°-150°	3418.0	43.6
90°-180°	4703.0	60.0
0°-180°	7842.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1233	1233	1233	1233	1233	
5°	1233	1228	1215	1225	1222	117
15°	1174	1167	1151	1156	1150	331
25°	1062	1053	1033	1035	1033	489
35°	916	905	886	878	873	572
45°	746	738	720	707	702	576
55°	564	557	543	529	523	505
65°	381	373	362	351	345	376
75°	199	197	191	184	186	213
85°	49	48	46	43	42	54
90°	1	14	23	29	31	7
95°	75	37	45	51	50	89
105°	353	388	71	84	88	377
115°	667	687	716	179	95	657
125°	944	959	981	989	992	842
135°	1168	1186	1197	1208	1206	902
145°	1355	1353	1373	1381	1376	847
155°	1492	1481	1495	1502	1493	687
165°	1572	1565	1568	1576	1568	444
175°	1608	1599	1602	1610	1598	153
180°	1604	1604	1604	1604	1604	

TEST NUMBER: P915463

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1233.0	1233.0	1233.0	1233.0	1233.0
2.5°	1240.2	1234.2	1221.1	1233.0	1230.7
5°	1233.0	1228.3	1215.2	1224.6	1222.4
7.5°	1224.6	1217.6	1204.5	1214.1	1211.7
10°	1211.7	1203.4	1189.2	1198.6	1195.1
12.5°	1193.8	1186.8	1172.6	1178.5	1176.1
15°	1173.7	1166.6	1151.2	1156.0	1150.1
17.5°	1148.8	1141.8	1126.3	1132.2	1126.3
20°	1121.5	1114.4	1097.9	1101.4	1096.8
22.5°	1094.3	1083.6	1068.2	1068.2	1065.8
25°	1062.2	1052.8	1032.7	1035.0	1032.7
27.5°	1026.7	1018.3	1003.1	999.5	993.6
30°	991.2	981.7	963.9	960.4	955.6
32.5°	953.2	946.2	927.2	920.0	915.2
35°	916.5	904.7	885.7	878.5	872.6
37.5°	875.0	864.3	845.3	837.0	831.1
40°	832.3	822.8	803.7	793.2	788.5
42.5°	790.8	781.2	762.4	750.4	743.4
45°	745.8	737.5	719.6	706.7	701.9
47.5°	701.9	693.6	674.6	661.6	654.5
50°	655.6	649.7	633.1	616.5	610.5
52.5°	610.5	602.3	586.9	573.9	565.5
55°	564.4	557.2	543.0	528.8	522.9
57.5°	518.1	512.2	496.7	482.5	477.8
60°	471.8	467.1	450.6	437.5	434.0
62.5°	426.8	418.5	406.7	394.8	390.1
65°	380.6	373.4	361.6	350.9	345.1
67.5°	333.2	327.2	316.6	308.3	303.6
70°	289.3	284.6	273.9	265.5	260.9
72.5°	244.3	239.5	233.6	225.3	221.7
75°	199.2	196.9	190.8	183.8	186.2
77.5°	158.8	154.1	151.7	148.1	144.7
80°	118.6	117.3	114.9	111.5	109.1
82.5°	80.6	80.6	79.5	74.7	74.7
85°	48.6	47.5	46.3	42.6	41.5
87.5°	21.4	19.0	16.6	13.1	11.8
90°	1.1	13.9	23.1	29.1	31.3
92.5°	29.1	24.4	27.8	30.2	31.3
95°	75.4	37.1	45.2	51.2	49.9
97.5°	135.8	40.6	59.1	62.7	63.8
100°	205.5	46.4	66.1	75.4	77.7
102.5°	282.0	279.8	68.5	81.2	84.8
105°	352.8	387.7	70.8	83.5	88.2
107.5°	435.3	464.2	73.2	85.9	90.5
110°	514.3	538.5	203.2	87.1	91.7

TEST NUMBER: P915463

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.5	609.3	589.6	89.3	92.9
115°	667.4	687.1	716.2	178.8	95.2
117.5°	735.9	759.1	778.9	612.8	308.7
120°	812.5	829.9	850.9	864.7	708.1
122.5°	877.4	896.0	919.3	926.2	927.5
125°	943.6	958.8	980.8	989.0	992.4
127.5°	1004.0	1020.3	1037.8	1049.3	1050.4
130°	1060.9	1079.5	1092.2	1105.0	1103.9
132.5°	1119.0	1134.1	1146.8	1157.2	1156.1
135°	1167.8	1186.4	1196.7	1208.4	1206.0
137.5°	1218.7	1232.6	1244.4	1255.9	1252.5
140°	1268.6	1278.0	1290.7	1301.2	1295.4
142.5°	1310.5	1318.7	1333.7	1342.9	1337.1
145°	1354.6	1353.4	1373.1	1381.2	1375.5
147.5°	1392.8	1389.3	1409.1	1414.8	1410.3
150°	1430.0	1421.9	1440.5	1447.4	1441.6
152.5°	1461.3	1452.1	1469.4	1476.5	1468.3
155°	1491.5	1481.1	1495.1	1502.0	1492.7
157.5°	1515.9	1506.6	1517.1	1525.3	1515.9
160°	1536.8	1529.8	1536.8	1543.7	1535.6
162.5°	1555.3	1548.4	1554.2	1562.3	1551.9
165°	1571.6	1564.7	1568.1	1576.3	1568.1
167.5°	1584.4	1577.4	1581.0	1589.1	1578.6
170°	1594.9	1587.8	1590.2	1598.3	1587.8
172.5°	1601.8	1594.9	1597.2	1605.4	1594.9
175°	1607.6	1599.4	1601.8	1609.9	1598.3
177.5°	1609.9	1601.8	1603.0	1611.1	1600.7
180°	1604.1	1604.1	1604.1	1604.1	1604.1

TEST NUMBER: P915463

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.20	6.98	7.24	8.02	9.43	5.77	6.54	6.80	7.59	9.00
	3H	7.85	8.55	8.90	9.60	11.03	7.38	8.08	8.43	9.13	10.56
	4H	8.44	9.10	9.50	10.15	11.58	7.96	8.62	9.02	9.68	11.11
	6H	8.83	9.44	9.90	10.50	11.94	8.36	8.96	9.43	10.02	11.47
	8H	8.93	9.51	10.01	10.59	12.03	8.46	9.04	9.53	10.11	11.55
	12H	8.98	9.53	10.06	10.60	12.06	8.50	9.05	9.58	10.12	11.58
4H	2H	6.65	7.31	7.72	8.37	9.80	6.30	6.97	7.37	8.02	9.45
	3H	8.51	9.06	9.58	10.14	11.59	8.11	8.67	9.19	9.75	11.20
	4H	9.22	9.72	10.30	10.80	12.27	8.81	9.32	9.89	10.39	11.86
	6H	9.73	10.16	10.82	11.26	12.72	9.32	9.75	10.41	10.85	12.31
	8H	9.88	10.28	10.96	11.37	12.85	9.46	9.87	10.55	10.96	12.44
	12H	9.95	10.31	11.05	11.41	12.90	9.52	9.89	10.63	10.99	12.48
8H	4H	9.41	9.81	10.50	10.90	12.38	9.05	9.45	10.14	10.54	12.02
	6H	10.04	10.37	11.15	11.50	12.98	9.67	10.01	10.78	11.14	12.61
	8H	10.26	10.55	11.37	11.66	13.16	9.89	10.18	11.00	11.29	12.79
	12H	10.38	10.64	11.50	11.75	13.28	10.00	10.26	11.12	11.37	12.90
12H	4H	9.39	9.76	10.50	10.86	12.34	9.04	9.41	10.14	10.51	11.99
	6H	10.07	10.36	11.18	11.47	12.97	9.71	10.01	10.83	11.12	12.61
	8H	10.30	10.56	11.42	11.67	13.20	9.95	10.20	11.07	11.31	12.85

END OF REPORT