

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918231

Luminaire Tested: DFN2DIP-TR4F0-050D070US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918231
REPORT IS A COMBINATION OF REPORTS P901945 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D070US930-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9685.7 lumens
Efficiency: N/A
Efficacy: 102.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 94.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918231

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US930-FLLONL

Luminous Intensity Polar Plot

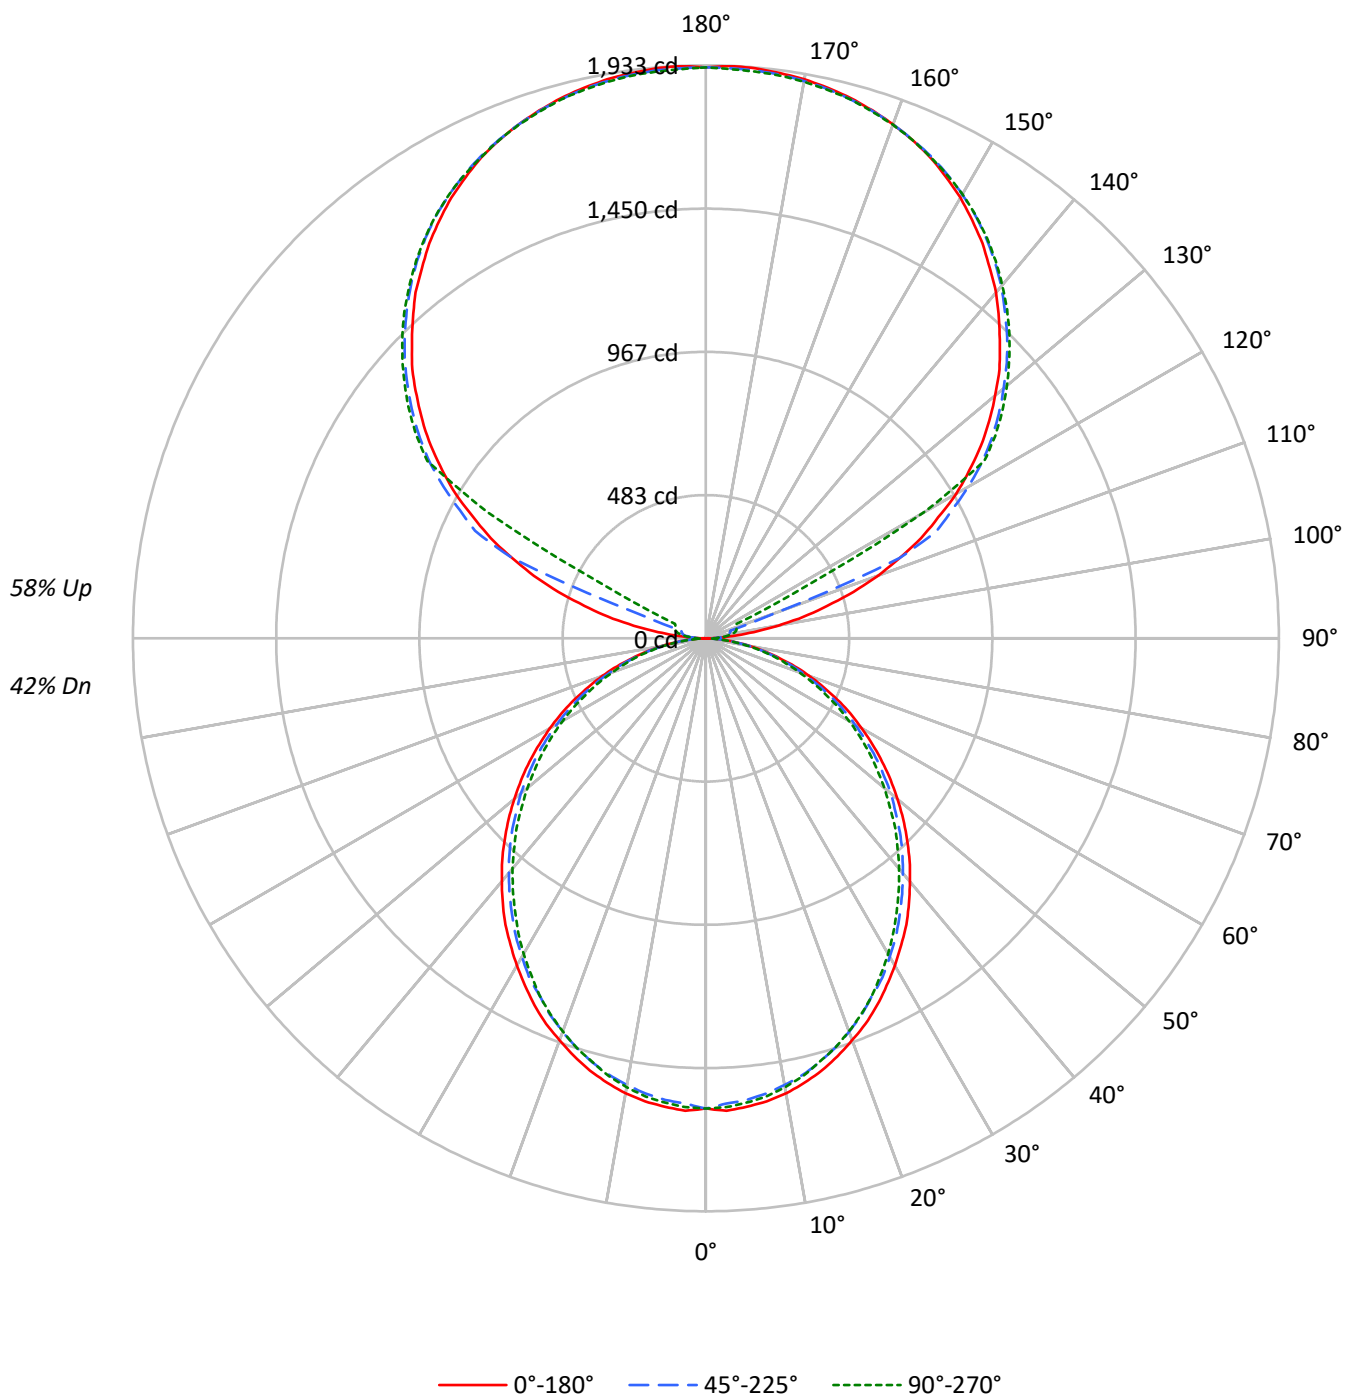

TEST NUMBER: P918231

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	88	84	87	84	80	78	69	67	65	55	54	52	43	42	41
2	87	80	74	69	79	73	68	64	60	57	53	49	46	44	38	36	34
3	80	70	63	57	72	64	58	53	53	49	45	43	40	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	35	32	30	27	25
5	67	55	47	41	61	51	44	39	42	37	33	34	30	27	27	24	22
6	62	50	42	36	56	46	39	33	38	33	29	31	27	24	24	22	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	41	33	28	48	37	31	26	31	26	22	26	22	19	20	18	15
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1260	1260	1260
5°	1262	1242	1251
10°	1252	1226	1234
15°	1233	1206	1207
20°	1209	1178	1180
25°	1184	1144	1149
30°	1153	1113	1109
35°	1124	1076	1067
40°	1087	1039	1027
45°	1051	1002	986
50°	1012	962	938
55°	971	917	894
60°	924	863	844
65°	873	808	785
70°	808	740	722
75°	719	659	663
80°	611	555	551
85°	442	377	365

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1051 cd/sqm

TEST NUMBER: P918231

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	149.3	1.5
10°-20°	420.0	4.3
20°-30°	617.3	6.4
30°-40°	717.0	7.4
40°-50°	716.1	7.4
50°-60°	624.4	6.4
60°-70°	461.6	4.8
70°-80°	261.1	2.7
80°-90°	72.3	0.7
90°-100°	63.5	0.7
100°-110°	236.8	2.4
110°-120°	627.9	6.5
120°-130°	1041.5	10.8
130°-140°	1106.3	11.4
140°-150°	1028.1	10.6
150°-160°	826.6	8.5
160°-170°	532.6	5.5
170°-180°	183.3	1.9
0°-30°	1186.6	12.3
0°-40°	1903.6	19.7
0°-60°	3244.1	33.5
0°-90°	4039.1	41.7
90°-120°	928.2	9.6
90°-150°	4104.1	42.4
90°-180°	5647.0	58.3
0°-180°	9685.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1586	1586	1586	1586	1586	
5°	1586	1580	1563	1576	1573	151
15°	1510	1501	1481	1487	1480	425
25°	1367	1354	1328	1332	1328	629
35°	1179	1164	1139	1130	1123	736
45°	959	949	926	909	903	740
55°	726	717	698	680	673	649
65°	490	480	465	452	444	484
75°	256	253	246	236	240	273
85°	62	61	60	55	53	70
90°	1	17	28	35	38	9
95°	90	44	54	61	60	107
105°	424	466	85	100	106	453
115°	801	825	860	215	114	789
125°	1133	1151	1178	1188	1192	1010
135°	1402	1424	1437	1451	1448	1083
145°	1626	1625	1649	1658	1652	1017
155°	1791	1778	1795	1803	1792	825
165°	1887	1879	1883	1893	1883	533
175°	1930	1920	1923	1933	1919	184
180°	1926	1926	1926	1926	1926	

TEST NUMBER: P918231

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1586.2	1586.2	1586.2	1586.2	1586.2
2.5°	1595.4	1587.8	1571.0	1586.2	1583.3
5°	1586.2	1580.2	1563.3	1575.5	1572.6
7.5°	1575.5	1566.4	1549.6	1561.9	1558.9
10°	1558.9	1548.2	1529.9	1542.0	1537.5
12.5°	1535.9	1526.8	1508.5	1516.1	1513.0
15°	1509.9	1500.9	1481.0	1487.2	1479.5
17.5°	1477.9	1468.8	1448.9	1456.5	1448.9
20°	1442.8	1433.8	1412.4	1416.9	1411.0
22.5°	1407.9	1394.1	1374.2	1374.2	1371.1
25°	1366.6	1354.5	1328.5	1331.5	1328.5
27.5°	1320.8	1310.1	1290.4	1285.8	1278.2
30°	1275.1	1262.9	1240.1	1235.5	1229.4
32.5°	1226.3	1217.2	1192.8	1183.6	1177.5
35°	1179.0	1163.8	1139.4	1130.2	1122.6
37.5°	1125.6	1111.9	1087.4	1076.8	1069.2
40°	1070.8	1058.5	1034.0	1020.4	1014.3
42.5°	1017.4	1005.1	980.8	965.4	956.3
45°	959.4	948.8	925.8	909.1	902.9
47.5°	902.9	892.3	867.9	851.0	842.0
50°	843.4	835.8	814.5	793.1	785.5
52.5°	785.5	774.8	755.0	738.3	727.6
55°	726.1	716.9	698.5	680.3	672.7
57.5°	666.5	658.9	639.0	620.8	614.6
60°	607.0	601.0	579.7	562.8	558.3
62.5°	549.1	538.4	523.2	507.9	501.8
65°	489.7	480.5	465.2	451.5	443.8
67.5°	428.7	420.9	407.3	396.6	390.4
70°	372.2	366.1	352.3	341.6	335.7
72.5°	314.3	308.1	300.5	289.8	285.3
75°	256.2	253.2	245.5	236.4	239.5
77.5°	204.4	198.2	195.2	190.6	186.1
80°	152.6	151.0	147.9	143.4	140.3
82.5°	103.7	103.7	102.2	96.1	96.1
85°	62.5	61.0	59.5	54.9	53.4
87.5°	27.5	24.5	21.4	16.8	15.2
90°	1.3	16.7	27.8	34.9	37.6
92.5°	34.9	29.3	33.4	36.3	37.6
95°	90.5	44.5	54.3	61.4	59.9
97.5°	163.0	48.8	71.0	75.3	76.6
100°	246.8	55.8	79.4	90.5	93.4
102.5°	338.6	336.0	82.3	97.5	101.7
105°	423.7	465.5	85.0	100.3	105.9
107.5°	522.6	557.4	87.9	103.1	108.8
110°	617.5	646.6	243.9	104.6	110.1

TEST NUMBER: P918231

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	706.7	731.6	708.0	107.2	111.5
115°	801.4	825.0	859.9	214.7	114.4
117.5°	883.6	911.4	935.2	735.8	370.7
120°	975.6	996.5	1021.7	1038.4	850.2
122.5°	1053.5	1075.9	1103.9	1112.1	1113.6
125°	1133.0	1151.2	1177.7	1187.5	1191.6
127.5°	1205.5	1225.0	1246.0	1260.0	1261.3
130°	1273.8	1296.2	1311.4	1326.8	1325.5
132.5°	1343.5	1361.7	1377.0	1389.5	1388.2
135°	1402.1	1424.4	1436.9	1450.9	1448.1
137.5°	1463.3	1480.1	1494.1	1508.1	1503.9
140°	1523.2	1534.5	1549.7	1562.3	1555.3
142.5°	1573.5	1583.3	1601.3	1612.4	1605.5
145°	1626.5	1625.1	1648.7	1658.5	1651.5
147.5°	1672.3	1668.3	1691.9	1698.8	1693.4
150°	1717.0	1707.3	1729.7	1737.9	1731.0
152.5°	1754.6	1743.5	1764.4	1772.8	1763.1
155°	1790.9	1778.4	1795.1	1803.4	1792.4
157.5°	1820.2	1809.1	1821.6	1831.4	1820.2
160°	1845.3	1836.9	1845.3	1853.6	1843.8
162.5°	1867.5	1859.2	1866.1	1875.9	1863.4
165°	1887.0	1878.8	1882.8	1892.6	1882.8
167.5°	1902.4	1893.9	1898.3	1908.0	1895.5
170°	1915.0	1906.6	1909.3	1919.1	1906.6
172.5°	1923.3	1915.0	1917.8	1927.5	1915.0
175°	1930.2	1920.4	1923.3	1933.0	1919.1
177.5°	1933.0	1923.3	1924.8	1934.5	1921.9
180°	1926.1	1926.1	1926.1	1926.1	1926.1

TEST NUMBER: P918231

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.25	8.04	8.28	9.08	10.46	6.82	7.61	7.85	8.64	10.03
	3H	8.91	9.62	9.94	10.66	12.06	8.43	9.14	9.47	10.18	11.59
	4H	9.49	10.16	10.54	11.21	12.62	9.02	9.69	10.06	10.73	12.15
	6H	9.89	10.51	10.94	11.55	12.98	9.41	10.03	10.47	11.08	12.50
	8H	9.99	10.58	11.05	11.64	13.06	9.51	10.10	10.58	11.17	12.59
	12H	10.03	10.59	11.10	11.65	13.10	9.55	10.11	10.62	11.17	12.62
4H	2H	7.70	8.38	8.76	9.42	10.83	7.36	8.03	8.41	9.08	10.49
	3H	9.56	10.12	10.63	11.20	12.62	9.17	9.73	10.23	10.80	12.23
	4H	10.27	10.79	11.34	11.85	13.30	9.87	10.38	10.94	11.45	12.89
	6H	10.79	11.23	11.86	12.31	13.76	10.38	10.82	11.45	11.91	13.35
	8H	10.93	11.35	12.01	12.43	13.88	10.52	10.93	11.60	12.01	13.47
	12H	11.00	11.38	12.10	12.47	13.93	10.58	10.96	11.68	12.05	13.51
8H	4H	10.47	10.88	11.54	11.96	13.41	10.11	10.52	11.18	11.60	13.05
	6H	11.09	11.44	12.19	12.56	14.01	10.73	11.07	11.83	12.19	13.65
	8H	11.31	11.61	12.42	12.72	14.19	10.95	11.24	12.05	12.35	13.82
	12H	11.44	11.71	12.55	12.80	14.32	11.06	11.32	12.17	12.42	13.93
12H	4H	10.45	10.82	11.54	11.91	13.38	10.10	10.47	11.19	11.56	13.02
	6H	11.12	11.42	12.23	12.53	14.00	10.77	11.07	11.88	12.17	13.65
	8H	11.36	11.63	12.47	12.72	14.24	11.01	11.27	12.12	12.37	13.88

END OF REPORT