

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921021

Luminaire Tested: DFN2DIP-TR4F0-070D040US935-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921021
REPORT IS A COMBINATION OF REPORTS P901896 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D040US935-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8532.4 lumens
Efficiency: N/A
Efficacy: 89.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 95.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921021

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-RLLONL

Luminous Intensity Polar Plot

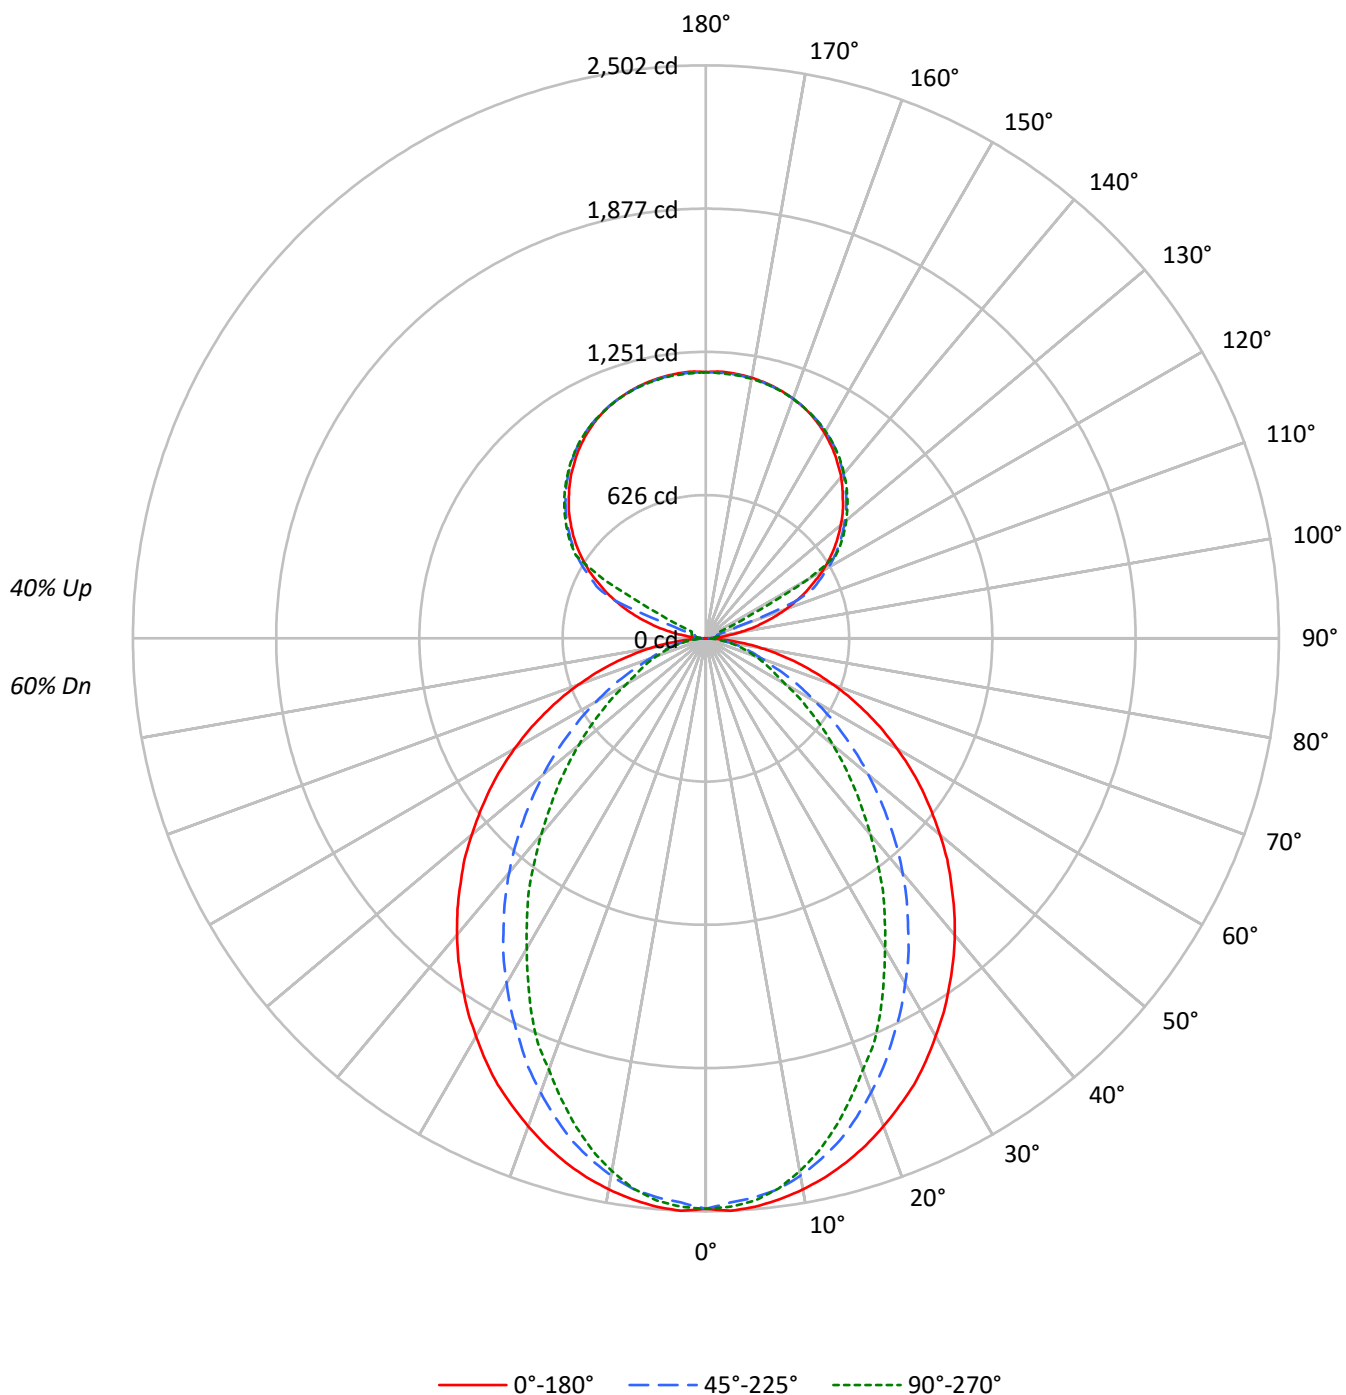

TEST NUMBER: P921021

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	101	96	93	89	94	90	87	84	79	77	74	68	67	65	59	57	56
2	92	85	79	74	86	80	74	70	70	66	62	61	58	55	52	50	48
3	84	75	68	62	79	71	64	59	62	57	53	54	51	47	47	44	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	42	39	37
5	71	60	52	46	67	57	49	44	50	44	40	44	40	36	38	35	32
6	66	54	46	40	62	51	44	39	45	40	35	40	35	32	35	32	29
7	61	49	41	36	57	46	39	34	41	36	31	37	32	29	32	29	26
8	57	45	37	32	53	42	35	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	25	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1979	1979	1979
5°	1982	1947	1960
10°	1962	1909	1896
15°	1935	1846	1797
20°	1900	1759	1676
25°	1863	1662	1560
30°	1814	1562	1411
35°	1766	1454	1281
40°	1717	1343	1132
45°	1660	1219	997
50°	1601	1095	864
55°	1540	962	738
60°	1469	822	607
65°	1387	681	546
70°	1288	549	494
75°	1163	484	450
80°	983	406	390
85°	685	271	293

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1660 cd/sqm

TEST NUMBER: P921021

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	233.5	2.7
10°-20°	640.9	7.5
20°-30°	899.8	10.5
30°-40°	980.8	11.5
40°-50°	901.5	10.6
50°-60°	708.0	8.3
60°-70°	460.8	5.4
70°-80°	237.2	2.8
80°-90°	62.6	0.7
90°-100°	38.3	0.4
100°-110°	142.9	1.7
110°-120°	378.9	4.4
120°-130°	628.5	7.4
130°-140°	667.6	7.8
140°-150°	620.4	7.3
150°-160°	498.8	5.8
160°-170°	321.4	3.8
170°-180°	110.6	1.3
0°-30°	1774.1	20.8
0°-40°	2754.9	32.3
0°-60°	4364.3	51.2
0°-90°	5124.9	60.1
90°-120°	560.1	6.6
90°-150°	2476.6	29.0
90°-180°	3407.0	39.9
0°-180°	8532.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2491	2491	2491	2491	2491	
5°	2491	2480	2450	2471	2464	236
15°	2369	2344	2268	2225	2202	668
25°	2151	2078	1930	1837	1803	989
35°	1853	1738	1540	1398	1348	1160
45°	1515	1364	1127	967	913	1170
55°	1152	976	732	597	555	1029
65°	778	595	392	316	309	771
75°	415	257	180	164	162	439
85°	97	50	43	43	43	111
90°	1	10	17	21	23	8
95°	55	27	33	37	36	65
105°	256	281	51	60	64	273
115°	484	498	519	130	69	476
125°	684	695	711	717	719	610
135°	846	860	867	876	874	654
145°	982	981	995	1001	997	614
155°	1081	1073	1083	1088	1082	498
165°	1139	1134	1136	1142	1136	322
175°	1165	1159	1161	1166	1158	111
180°	1162	1162	1162	1162	1162	

TEST NUMBER: P921021

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2491.0	2491.0	2491.0	2491.0	2491.0
2.5°	2502.1	2491.0	2466.1	2488.8	2484.2
5°	2491.0	2479.7	2450.3	2470.6	2463.9
7.5°	2470.6	2457.2	2425.7	2434.5	2423.3
10°	2443.6	2427.8	2382.8	2375.9	2362.5
12.5°	2409.8	2389.5	2328.6	2315.1	2290.3
15°	2369.2	2344.3	2267.8	2225.0	2202.5
17.5°	2321.9	2285.8	2191.1	2141.5	2105.4
20°	2267.8	2222.6	2110.0	2053.7	2004.0
22.5°	2209.2	2157.3	2026.4	1949.9	1916.2
25°	2150.6	2078.4	1929.6	1837.3	1803.4
27.5°	2080.8	2004.0	1839.4	1733.5	1681.6
30°	2006.4	1920.5	1740.2	1625.4	1564.4
32.5°	1934.1	1830.4	1645.7	1510.4	1453.9
35°	1853.0	1738.0	1539.8	1397.7	1348.0
37.5°	1774.2	1650.0	1440.5	1284.8	1228.6
40°	1690.7	1555.6	1336.7	1176.7	1118.1
42.5°	1605.1	1460.9	1233.1	1066.2	1010.0
45°	1514.9	1363.7	1127.2	967.0	912.9
47.5°	1429.3	1269.3	1025.8	865.6	816.1
50°	1334.5	1174.6	926.5	770.9	723.8
52.5°	1242.0	1072.9	831.8	683.0	640.2
55°	1151.8	976.0	732.5	597.4	554.7
57.5°	1059.5	879.2	644.8	518.5	482.4
60°	964.8	784.5	552.2	437.5	401.3
62.5°	872.4	692.2	473.3	365.2	347.2
65°	777.7	595.0	392.3	315.7	308.8
67.5°	687.6	504.9	315.7	277.2	270.5
70°	592.9	417.1	261.4	238.9	229.8
72.5°	502.7	335.8	218.6	200.7	196.1
75°	414.7	256.8	180.3	164.5	162.4
77.5°	326.9	182.4	142.1	132.9	128.5
80°	245.6	130.8	108.1	99.3	99.3
82.5°	171.3	88.0	74.4	69.8	69.8
85°	96.9	49.5	42.8	42.8	42.8
87.5°	36.1	17.9	17.9	15.8	15.8
90°	0.8	10.1	16.8	21.1	22.6
92.5°	21.1	17.7	20.1	21.9	22.6
95°	54.6	26.9	32.7	37.0	36.2
97.5°	98.4	29.4	42.9	45.5	46.2
100°	148.9	33.7	48.0	54.6	56.3
102.5°	204.3	202.8	49.6	58.8	61.4
105°	255.6	280.9	51.3	60.5	63.9
107.5°	315.4	336.4	53.0	62.3	65.6
110°	372.6	390.2	147.2	63.1	66.4



TEST NUMBER: P921021

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	426.5	441.5	427.2	64.7	67.3
115°	483.5	497.8	518.9	129.5	69.1
117.5°	533.2	550.0	564.4	444.0	223.7
120°	588.8	601.3	616.5	626.6	513.1
122.5°	635.8	649.3	666.2	671.1	672.0
125°	683.7	694.7	710.7	716.6	719.1
127.5°	727.5	739.3	751.9	760.3	761.1
130°	768.7	782.2	791.3	800.6	799.9
132.5°	810.7	821.7	830.9	838.5	837.8
135°	846.1	859.6	867.1	875.5	873.9
137.5°	883.0	893.1	901.6	910.0	907.5
140°	919.2	926.0	935.2	942.8	938.6
142.5°	949.6	955.4	966.4	973.0	968.9
145°	981.5	980.7	994.9	1000.8	996.6
147.5°	1009.2	1006.7	1021.0	1025.2	1021.9
150°	1036.1	1030.3	1043.8	1048.8	1044.6
152.5°	1058.9	1052.1	1064.7	1069.8	1063.9
155°	1080.7	1073.2	1083.3	1088.3	1081.6
157.5°	1098.4	1091.7	1099.3	1105.2	1098.4
160°	1113.5	1108.4	1113.5	1118.5	1112.7
162.5°	1127.0	1122.0	1126.2	1132.0	1124.5
165°	1138.8	1133.8	1136.3	1142.1	1136.3
167.5°	1148.1	1142.9	1145.6	1151.4	1143.8
170°	1155.6	1150.6	1152.2	1158.1	1150.6
172.5°	1160.6	1155.6	1157.4	1163.2	1155.6
175°	1164.8	1158.9	1160.6	1166.5	1158.1
177.5°	1166.5	1160.6	1161.5	1167.4	1159.9
180°	1162.3	1162.3	1162.3	1162.3	1162.3

TEST NUMBER: P921021

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.40	11.32	11.28	12.21	13.34	6.38	7.30	7.25	8.19	9.31
	3H	12.09	12.91	12.97	13.81	14.96	7.57	8.40	8.46	9.29	10.44
	4H	12.70	13.48	13.60	14.38	15.54	8.03	8.81	8.93	9.71	10.87
	6H	13.13	13.84	14.04	14.75	15.92	8.36	9.07	9.27	9.98	11.15
	8H	13.26	13.94	14.18	14.86	16.03	8.45	9.13	9.37	10.06	11.23
	12H	13.32	13.97	14.25	14.89	16.08	8.50	9.14	9.42	10.06	11.26
4H	2H	10.43	11.21	11.34	12.11	13.27	6.98	7.76	7.89	8.66	9.82
	3H	12.27	12.92	13.19	13.85	15.02	8.34	8.99	9.26	9.92	11.10
	4H	12.97	13.55	13.89	14.48	15.68	8.90	9.48	9.82	10.41	11.61
	6H	13.49	13.99	14.43	14.95	16.15	9.32	9.83	10.26	10.78	11.98
	8H	13.66	14.13	14.61	15.08	16.30	9.45	9.92	10.40	10.87	12.09
	12H	13.76	14.19	14.72	15.15	16.37	9.52	9.95	10.48	10.91	12.13
8H	4H	12.94	13.41	13.88	14.36	15.57	9.18	9.65	10.13	10.60	11.82
	6H	13.51	13.90	14.48	14.89	16.10	9.70	10.09	10.67	11.09	12.30
	8H	13.73	14.07	14.71	15.05	16.28	9.90	10.24	10.88	11.22	12.45
	12H	13.87	14.17	14.85	15.15	16.42	10.02	10.32	11.00	11.30	12.58
12H	4H	12.90	13.32	13.86	14.29	15.51	9.19	9.62	10.15	10.58	11.80
	6H	13.49	13.83	14.46	14.81	16.04	9.75	10.10	10.73	11.08	12.31
	8H	13.71	14.01	14.69	14.99	16.27	9.97	10.27	10.95	11.25	12.52

END OF REPORT