

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921160

Luminaire Tested: DFN2DIP-TR4F0-100D120US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921160
REPORT IS A COMBINATION OF REPORTS P900526 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D120US935-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16462.3 lumens
Efficiency: N/A
Efficacy: 85.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 192.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921160

CATALOG NUMBER: DFN2DIP-TR4F0-100D120US935-RLLFLL

Luminous Intensity Polar Plot

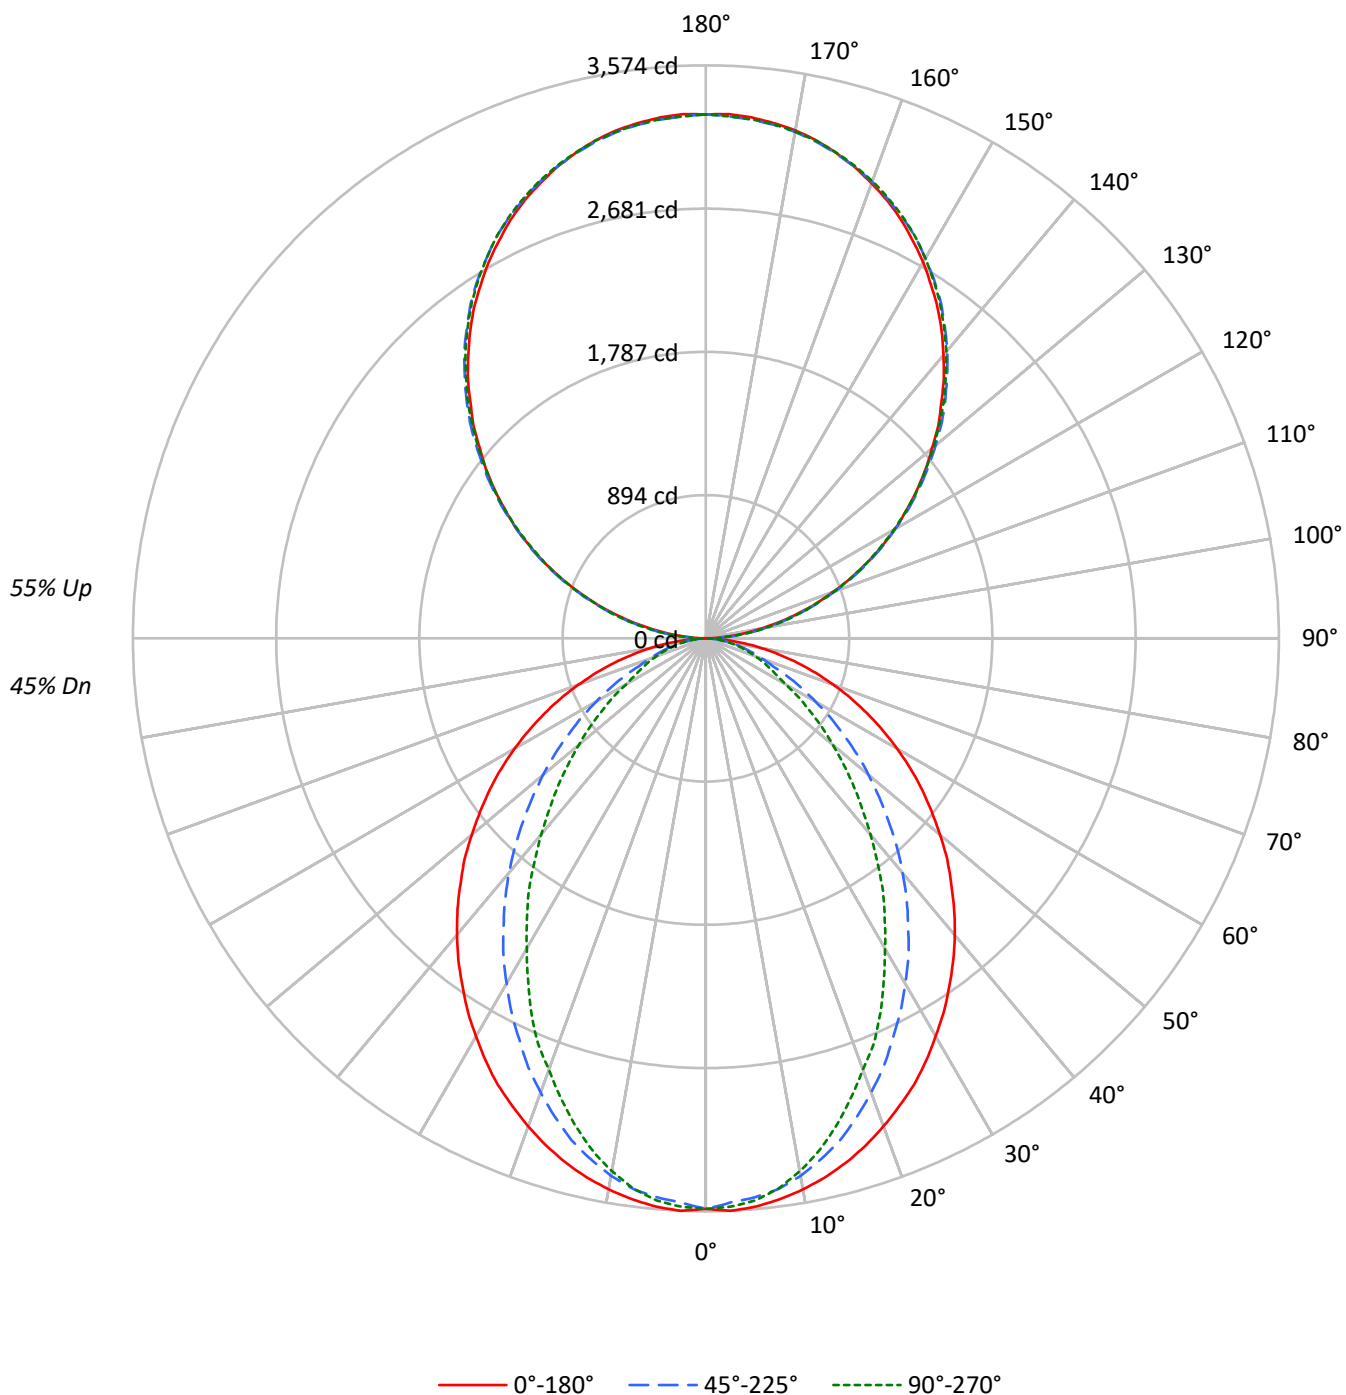

TEST NUMBER: P921160

CATALOG NUMBER: DFN2DIP-TR4F0-100D120US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	93	89	86	89	85	82	79	71	69	67	58	56	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	51	49	47	41	39	38
3	81	72	65	59	74	66	60	55	56	51	47	46	43	40	37	34	33
4	74	64	56	51	68	59	52	47	50	45	41	41	37	35	33	30	28
5	68	57	49	44	63	53	46	41	45	39	35	37	33	30	30	27	25
6	63	51	44	38	58	48	41	36	40	35	31	34	30	27	27	24	22
7	58	47	39	33	54	43	36	31	37	31	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	31	27	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	36	29	24	43	33	27	23	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2827	2827	2827
5°	2832	2782	2800
10°	2803	2727	2709
15°	2765	2637	2568
20°	2714	2513	2395
25°	2662	2374	2228
30°	2592	2231	2016
35°	2523	2077	1830
40°	2453	1918	1617
45°	2371	1742	1424
50°	2287	1564	1235
55°	2200	1374	1053
60°	2098	1175	867
65°	1981	973	780
70°	1840	784	706
75°	1662	691	642
80°	1404	580	557
85°	979	387	418

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2547 cd/sqm

TEST NUMBER: P921160

CATALOG NUMBER: DFN2DIP-TR4F0-100D120US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	333.5	2.0
10°-20°	915.5	5.6
20°-30°	1285.4	7.8
30°-40°	1401.2	8.5
40°-50°	1287.8	7.8
50°-60°	1011.4	6.1
60°-70°	658.3	4.0
70°-80°	338.9	2.1
80°-90°	95.8	0.6
90°-100°	202.2	1.2
100°-110°	642.4	3.9
110°-120°	1099.4	6.7
120°-130°	1445.9	8.8
130°-140°	1623.0	9.9
140°-150°	1591.6	9.7
150°-160°	1335.1	8.1
160°-170°	885.4	5.4
170°-180°	309.5	1.9
0°-30°	2534.4	15.4
0°-40°	3935.6	23.9
0°-60°	6234.8	37.9
0°-90°	7327.8	44.5
90°-120°	1944.1	11.8
90°-150°	6604.6	40.1
90°-180°	9134.0	55.5
0°-180°	16462.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3558	3558	3558	3558	3558	
5°	3558	3542	3500	3530	3520	337
15°	3385	3349	3240	3178	3146	954
25°	3072	2969	2757	2625	2576	1413
35°	2647	2483	2200	1997	1926	1657
45°	2164	1948	1610	1381	1304	1671
55°	1646	1394	1046	854	792	1470
65°	1111	850	560	451	441	1102
75°	592	367	258	235	232	627
85°	138	71	61	61	61	159
90°	3	36	96	91	94	16
95°	144	171	176	176	171	160
105°	593	601	607	612	612	626
115°	1103	1119	1114	1111	1103	1091
125°	1605	1629	1622	1613	1610	1434
135°	2076	2106	2112	2109	2101	1604
145°	2520	2540	2555	2558	2548	1574
155°	2881	2889	2898	2912	2903	1326
165°	3135	3132	3132	3151	3138	884
175°	3262	3254	3248	3268	3251	310
180°	3268	3268	3268	3268	3268	

TEST NUMBER: P921160

CATALOG NUMBER: DFN2DIP-TR4F0-100D120US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3558.5	3558.5	3558.5	3558.5	3558.5
2.5°	3574.5	3558.5	3522.9	3555.4	3548.9
5°	3558.5	3542.4	3500.4	3529.5	3519.8
7.5°	3529.5	3510.3	3465.2	3477.8	3461.8
10°	3490.8	3468.3	3404.0	3394.1	3375.0
12.5°	3442.7	3413.6	3326.5	3307.4	3271.8
15°	3384.6	3349.0	3239.7	3178.5	3146.4
17.5°	3316.9	3265.3	3130.1	3059.3	3007.7
20°	3239.7	3175.1	3014.2	2933.9	2862.8
22.5°	3156.0	3081.9	2894.9	2785.7	2737.5
25°	3072.3	2969.2	2756.6	2624.7	2576.2
27.5°	2972.5	2862.8	2627.8	2476.4	2402.3
30°	2866.3	2743.6	2486.0	2322.0	2234.9
32.5°	2763.1	2614.8	2351.0	2157.7	2077.0
35°	2647.2	2482.9	2199.7	1996.7	1925.6
37.5°	2534.5	2357.2	2057.9	1835.5	1755.1
40°	2415.3	2222.2	1909.6	1681.0	1597.3
42.5°	2292.9	2086.9	1761.7	1523.2	1442.9
45°	2164.1	1948.2	1610.3	1381.4	1304.2
47.5°	2041.9	1813.3	1465.4	1236.5	1165.8
50°	1906.5	1677.9	1323.6	1101.2	1033.9
52.5°	1774.3	1532.7	1188.3	975.8	914.6
55°	1645.5	1394.4	1046.5	853.5	792.3
57.5°	1513.6	1255.9	921.2	740.7	689.1
60°	1378.3	1120.7	788.9	624.9	573.3
62.5°	1246.4	988.8	676.1	521.8	496.1
65°	1111.1	850.1	560.3	451.0	441.1
67.5°	982.3	721.3	451.0	396.0	386.4
70°	847.0	595.9	373.4	341.3	328.4
72.5°	718.2	479.7	312.3	286.6	280.2
75°	592.5	367.0	257.6	235.1	232.0
77.5°	467.1	260.7	202.9	189.9	183.5
80°	350.9	186.9	154.5	141.8	141.8
82.5°	244.6	125.7	106.2	99.8	99.8
85°	138.4	70.7	61.1	61.1	61.1
87.5°	51.6	25.7	25.7	22.6	22.6
90°	2.9	35.5	96.5	90.7	93.6
92.5°	61.0	82.7	85.7	88.7	88.7
95°	143.8	171.4	176.3	176.3	171.4
97.5°	239.4	265.0	275.9	275.9	275.9
100°	349.7	372.4	380.2	380.2	377.3
102.5°	466.0	482.7	493.5	496.5	493.5
105°	593.1	600.9	606.8	611.7	611.7
107.5°	719.1	731.0	731.0	732.9	719.1
110°	841.3	857.0	857.0	857.0	849.2

TEST NUMBER: P921160

CATALOG NUMBER: DFN2DIP-TR4F0-100D120US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	973.3	990.1	987.0	979.2	973.3
115°	1103.3	1119.1	1114.1	1111.2	1103.3
117.5°	1232.3	1254.0	1240.3	1232.3	1224.5
120°	1362.4	1384.1	1362.4	1362.4	1353.6
122.5°	1480.7	1508.2	1494.4	1486.5	1480.7
125°	1604.7	1629.4	1621.5	1612.6	1609.6
127.5°	1726.0	1756.4	1745.6	1733.8	1726.0
130°	1839.2	1874.7	1869.7	1863.8	1853.0
132.5°	1966.3	1993.9	1995.8	1982.0	1974.2
135°	2075.6	2106.2	2112.1	2109.1	2101.3
137.5°	2197.8	2222.4	2227.3	2225.3	2213.5
140°	2305.1	2329.8	2343.6	2343.6	2332.7
142.5°	2415.5	2440.2	2448.0	2450.9	2440.2
145°	2519.9	2539.6	2555.4	2558.4	2547.5
147.5°	2613.5	2638.1	2650.0	2654.9	2644.0
150°	2710.1	2726.8	2737.6	2746.5	2737.6
152.5°	2795.7	2812.4	2826.3	2837.2	2826.3
155°	2881.4	2889.3	2898.2	2912.0	2903.1
157.5°	2955.4	2961.2	2966.1	2985.9	2972.1
160°	3021.3	3027.3	3030.2	3047.0	3035.1
162.5°	3082.4	3082.4	3085.4	3104.1	3090.3
165°	3134.6	3131.7	3131.7	3151.3	3137.6
167.5°	3181.9	3173.0	3173.0	3192.8	3179.0
170°	3217.4	3209.5	3206.5	3226.2	3209.5
172.5°	3242.0	3234.1	3231.2	3250.9	3234.1
175°	3261.7	3253.8	3247.9	3267.6	3250.9
177.5°	3272.6	3264.6	3258.7	3275.5	3258.7
180°	3267.6	3267.6	3267.6	3267.6	3267.6

TEST NUMBER: P921160

CATALOG NUMBER: DFN2DIP-TR4F0-100D120US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.22	11.00	11.22	12.02	13.37	6.19	6.98	7.20	7.99	9.34
	3H	11.89	12.59	12.91	13.62	14.99	7.38	8.08	8.39	9.10	10.47
	4H	12.50	13.16	13.53	14.19	15.57	7.82	8.49	8.86	9.52	10.90
	6H	12.92	13.53	13.96	14.56	15.95	8.14	8.76	9.19	9.79	11.18
	8H	13.04	13.62	14.09	14.67	16.06	8.23	8.82	9.28	9.86	11.25
	12H	13.10	13.65	14.15	14.69	16.10	8.28	8.83	9.33	9.87	11.28
4H	2H	10.23	10.89	11.27	11.92	13.30	6.78	7.44	7.82	8.47	9.85
	3H	12.05	12.61	13.10	13.66	15.05	8.13	8.68	9.17	9.73	11.13
	4H	12.74	13.25	13.80	14.30	15.71	8.67	9.18	9.73	10.23	11.64
	6H	13.26	13.69	14.32	14.76	16.17	9.09	9.53	10.15	10.60	12.00
	8H	13.43	13.84	14.49	14.90	16.32	9.22	9.63	10.28	10.69	12.11
	12H	13.52	13.89	14.60	14.97	16.40	9.28	9.65	10.36	10.73	12.16
8H	4H	12.71	13.11	13.77	14.18	15.60	8.95	9.36	10.01	10.42	11.84
	6H	13.27	13.61	14.36	14.71	16.13	9.47	9.80	10.55	10.91	12.33
	8H	13.49	13.78	14.58	14.87	16.31	9.66	9.95	10.75	11.04	12.48
	12H	13.63	13.88	14.72	14.97	16.45	9.78	10.04	10.87	11.12	12.60
12H	4H	12.66	13.03	13.74	14.10	15.53	8.95	9.32	10.03	10.40	11.82
	6H	13.25	13.54	14.34	14.63	16.07	9.52	9.81	10.61	10.90	12.34
	8H	13.47	13.73	14.56	14.81	16.29	9.73	9.99	10.82	11.07	12.55

END OF REPORT