

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923647

Luminaire Tested: DFN2DIP-TR4F0-040D060US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923647
REPORT IS A COMBINATION OF REPORTS P901925 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D060US940-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8827.9 lumens
Efficiency: N/A
Efficacy: 115.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 76.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923647

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US940-FLLONL

Luminous Intensity Polar Plot

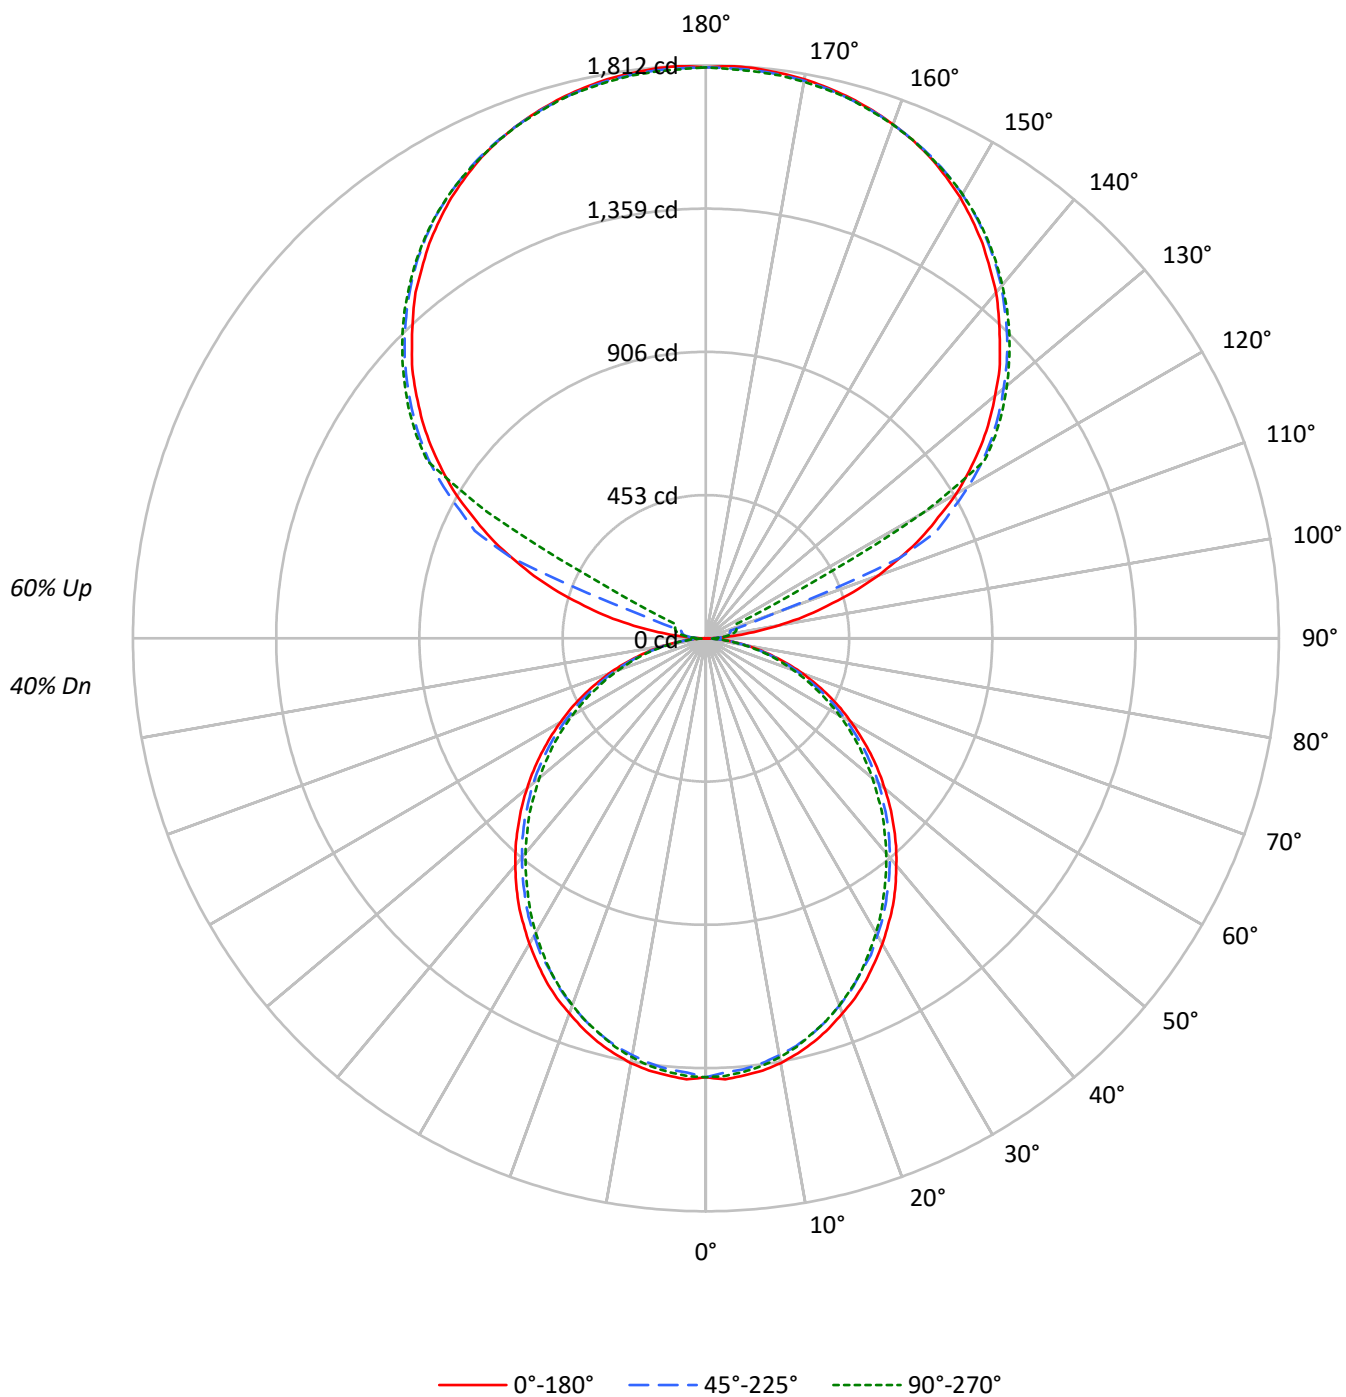

TEST NUMBER: P923647

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47			40
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40			34
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33			28
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28			24
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24			21
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21			18
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19			16
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17			14
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15			12
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13			11
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12			10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1103	1103	1103
5°	1104	1087	1095
10°	1095	1073	1080
15°	1079	1055	1056
20°	1058	1030	1033
25°	1036	1001	1005
30°	1009	974	970
35°	983	941	933
40°	951	909	898
45°	920	876	862
50°	885	842	821
55°	849	803	783
60°	808	755	739
65°	764	707	687
70°	707	648	631
75°	629	576	580
80°	534	486	482
85°	387	330	319

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 958 cd/sqm

TEST NUMBER: P923647

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	130.6	1.5
10°-20°	367.5	4.2
20°-30°	540.1	6.1
30°-40°	627.3	7.1
40°-50°	626.6	7.1
50°-60°	546.3	6.2
60°-70°	403.9	4.6
70°-80°	228.5	2.6
80°-90°	63.5	0.7
90°-100°	59.5	0.7
100°-110°	222.0	2.5
110°-120°	588.7	6.7
120°-130°	976.3	11.1
130°-140°	1037.1	11.7
140°-150°	963.9	10.9
150°-160°	774.9	8.8
160°-170°	499.3	5.7
170°-180°	171.9	1.9
0°-30°	1038.3	11.8
0°-40°	1665.6	18.9
0°-60°	2838.5	32.2
0°-90°	3534.4	40.0
90°-120°	870.2	9.9
90°-150°	3847.4	43.6
90°-180°	5294.0	60.0
0°-180°	8827.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1388	1388	1388	1388	1388	
5°	1388	1383	1368	1378	1376	132
15°	1321	1313	1296	1301	1295	372
25°	1196	1185	1162	1165	1162	550
35°	1032	1018	997	989	982	644
45°	840	830	810	796	790	648
55°	635	627	611	595	589	568
65°	428	420	407	395	388	424
75°	224	222	215	207	210	239
85°	55	53	52	48	47	61
90°	1	16	26	33	35	8
95°	85	42	51	58	56	101
105°	397	436	80	94	99	424
115°	751	774	806	201	107	740
125°	1062	1079	1104	1113	1117	947
135°	1314	1335	1347	1360	1358	1015
145°	1525	1523	1546	1555	1548	954
155°	1679	1667	1683	1691	1680	774
165°	1769	1761	1765	1774	1765	500
175°	1810	1800	1803	1812	1799	172
180°	1806	1806	1806	1806	1806	

TEST NUMBER: P923647

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1387.9	1387.9	1387.9	1387.9	1387.9
2.5°	1396.0	1389.3	1374.6	1387.9	1385.4
5°	1387.9	1382.6	1367.9	1378.5	1376.0
7.5°	1378.5	1370.6	1355.8	1366.6	1364.0
10°	1364.0	1354.6	1338.6	1349.2	1345.2
12.5°	1343.8	1335.9	1319.9	1326.6	1323.8
15°	1321.2	1313.2	1295.8	1301.2	1294.6
17.5°	1293.2	1285.2	1267.8	1274.4	1267.8
20°	1262.4	1254.5	1235.8	1239.7	1234.6
22.5°	1231.8	1219.8	1202.4	1202.4	1199.7
25°	1195.7	1185.1	1162.4	1165.0	1162.4
27.5°	1155.7	1146.3	1129.1	1125.1	1118.5
30°	1115.7	1105.0	1085.0	1081.0	1075.7
32.5°	1073.0	1065.1	1043.7	1035.6	1030.2
35°	1031.6	1018.3	996.9	988.9	982.2
37.5°	984.9	972.9	951.5	942.2	935.5
40°	936.9	926.1	904.7	892.9	887.5
42.5°	890.2	879.4	858.2	844.7	836.8
45°	839.5	830.2	810.0	795.5	790.1
47.5°	790.1	780.7	759.4	744.7	736.7
50°	738.0	731.3	712.7	693.9	687.2
52.5°	687.2	678.0	660.7	646.0	636.6
55°	635.3	627.2	611.3	595.2	588.6
57.5°	583.2	576.6	559.1	543.1	537.8
60°	531.1	525.8	507.2	492.5	488.5
62.5°	480.5	471.1	457.8	444.4	439.1
65°	428.5	420.4	407.1	395.0	388.4
67.5°	375.1	368.3	356.4	347.1	341.7
70°	325.7	320.3	308.3	298.9	293.6
72.5°	275.0	269.6	263.0	253.6	249.6
75°	224.2	221.6	214.8	206.9	209.6
77.5°	178.8	173.4	170.8	166.7	162.8
80°	133.5	132.1	129.4	125.5	122.8
82.5°	90.8	90.8	89.5	84.1	84.1
85°	54.7	53.4	52.1	48.0	46.7
87.5°	24.1	21.4	18.7	14.7	13.3
90°	1.2	15.7	26.0	32.7	35.2
92.5°	32.7	27.5	31.3	34.0	35.2
95°	84.9	41.7	50.9	57.6	56.2
97.5°	152.8	45.7	66.5	70.6	71.9
100°	231.3	52.3	74.5	84.9	87.5
102.5°	317.4	315.0	77.1	91.4	95.4
105°	397.2	436.4	79.7	94.0	99.3
107.5°	490.0	522.5	82.4	96.7	101.9
110°	578.9	606.2	228.7	98.1	103.2

TEST NUMBER: P923647

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	662.5	685.9	663.7	100.5	104.6
115°	751.3	773.5	806.2	201.3	107.2
117.5°	828.3	854.4	876.7	689.8	347.5
120°	914.6	934.2	957.8	973.4	797.0
122.5°	987.7	1008.6	1034.8	1042.6	1044.0
125°	1062.2	1079.2	1104.0	1113.2	1117.0
127.5°	1130.2	1148.4	1168.1	1181.2	1182.4
130°	1194.2	1215.1	1229.4	1243.8	1242.6
132.5°	1259.5	1276.6	1290.8	1302.6	1301.4
135°	1314.5	1335.4	1347.0	1360.2	1357.5
137.5°	1371.8	1387.5	1400.7	1413.7	1409.9
140°	1428.0	1438.6	1452.9	1464.6	1458.1
142.5°	1475.2	1484.3	1501.3	1511.6	1505.1
145°	1524.8	1523.4	1545.6	1554.8	1548.3
147.5°	1567.8	1563.9	1586.1	1592.6	1587.5
150°	1609.7	1600.5	1621.5	1629.2	1622.7
152.5°	1644.9	1634.5	1654.0	1662.0	1652.8
155°	1678.9	1667.2	1682.9	1690.7	1680.2
157.5°	1706.4	1695.9	1707.7	1716.9	1706.4
160°	1729.9	1722.0	1729.9	1737.7	1728.6
162.5°	1750.7	1742.9	1749.4	1758.6	1746.9
165°	1769.1	1761.3	1765.1	1774.3	1765.1
167.5°	1783.4	1775.6	1779.6	1788.8	1776.9
170°	1795.3	1787.3	1790.0	1799.1	1787.3
172.5°	1803.0	1795.3	1797.9	1807.1	1795.3
175°	1809.5	1800.4	1803.0	1812.1	1799.1
177.5°	1812.1	1803.0	1804.4	1813.6	1801.8
180°	1805.6	1805.6	1805.6	1805.6	1805.6

TEST NUMBER: P923647

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.61	7.39	7.65	8.43	9.84	6.18	6.96	7.22	8.00	9.41
	3H	8.26	8.96	9.31	10.01	11.44	7.79	8.49	8.84	9.54	10.97
	4H	8.85	9.51	9.91	10.56	12.00	8.37	9.03	9.43	10.09	11.52
	6H	9.24	9.85	10.31	10.91	12.35	8.77	9.38	9.84	10.43	11.88
	8H	9.34	9.92	10.42	11.00	12.44	8.87	9.45	9.94	10.52	11.96
	12H	9.39	9.94	10.47	11.01	12.47	8.91	9.46	9.99	10.53	11.99
4H	2H	7.06	7.72	8.13	8.78	10.21	6.72	7.38	7.78	8.43	9.87
	3H	8.92	9.47	9.99	10.55	12.00	8.53	9.08	9.60	10.16	11.61
	4H	9.63	10.14	10.71	11.21	12.68	9.22	9.73	10.30	10.80	12.27
	6H	10.14	10.57	11.23	11.67	13.13	9.73	10.17	10.82	11.26	12.72
	8H	10.29	10.69	11.38	11.78	13.26	9.88	10.28	10.96	11.37	12.85
	12H	10.36	10.72	11.46	11.83	13.31	9.93	10.30	11.04	11.40	12.89
8H	4H	9.82	10.23	10.91	11.31	12.79	9.46	9.87	10.55	10.95	12.43
	6H	10.45	10.78	11.56	11.91	13.39	10.08	10.42	11.20	11.55	13.03
	8H	10.67	10.96	11.79	12.07	13.57	10.30	10.59	11.42	11.71	13.20
	12H	10.80	11.05	11.92	12.16	13.69	10.41	10.67	11.53	11.78	13.31
12H	4H	9.80	10.17	10.91	11.27	12.75	9.45	9.82	10.56	10.92	12.40
	6H	10.48	10.77	11.59	11.88	13.38	10.12	10.42	11.24	11.53	13.03
	8H	10.71	10.97	11.84	12.08	13.61	10.36	10.62	11.48	11.72	13.26

END OF REPORT