

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921347

Luminaire Tested: DFN2DIP-4P3F0-050D060US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921347
REPORT IS A COMBINATION OF REPORTS P900595 AND P897473
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-4P3F0-050D060US940-FLLONL
Description: 3 foot, 90deg - 4way Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9710.7 lumens
Efficiency: N/A
Efficacy: 101.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.07' x L: 3.07' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 96
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921347

CATALOG NUMBER: DFN2DIP-4P3F0-050D060US940-FLLONL

Luminous Intensity Polar Plot

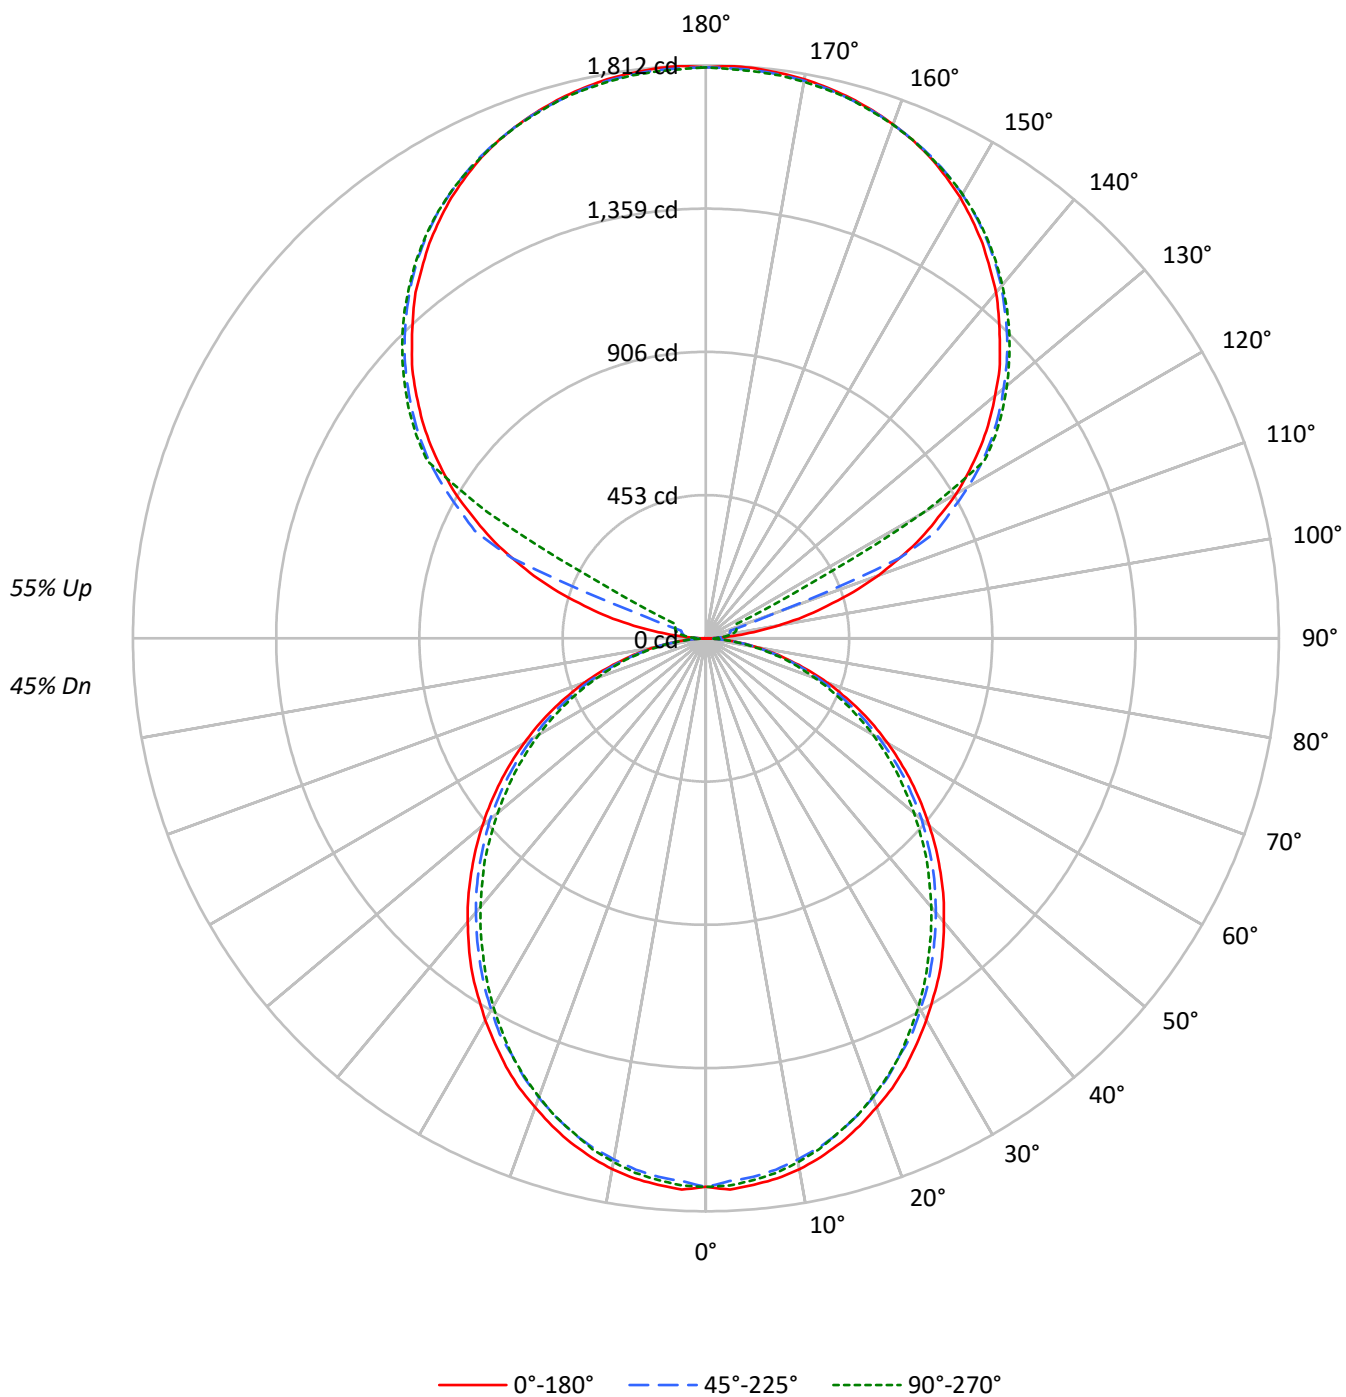

TEST NUMBER: P921347

CATALOG NUMBER: DFN2DIP-4P3F0-050D060US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	92	89	85	89	85	82	79	71	68	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	33	31
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	43	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	32	28	25	26	23	21
7	57	45	37	32	53	42	35	30	35	30	26	30	25	22	24	21	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1977	1977	1977
5°	1979	1948	1962
10°	1962	1921	1935
15°	1931	1888	1893
20°	1891	1843	1850
25°	1851	1789	1800
30°	1801	1739	1737
35°	1754	1680	1670
40°	1696	1620	1607
45°	1638	1560	1541
50°	1574	1497	1466
55°	1508	1424	1397
60°	1432	1338	1317
65°	1350	1249	1224
70°	1245	1140	1123
75°	1100	1009	1029
80°	925	842	850
85°	651	558	557

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1638 cd/sqm

TEST NUMBER: P921347

CATALOG NUMBER: DFN2DIP-4P3F0-050D060US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	163.3	1.7
10°-20°	459.4	4.7
20°-30°	675.2	7.0
30°-40°	784.2	8.1
40°-50°	783.2	8.1
50°-60°	682.9	7.0
60°-70°	504.8	5.2
70°-80°	285.6	2.9
80°-90°	78.6	0.8
90°-100°	59.5	0.6
100°-110°	222.0	2.3
110°-120°	588.7	6.1
120°-130°	976.3	10.1
130°-140°	1037.1	10.7
140°-150°	963.9	9.9
150°-160°	774.9	8.0
160°-170°	499.3	5.1
170°-180°	171.9	1.8
0°-30°	1297.9	13.4
0°-40°	2082.0	21.4
0°-60°	3548.1	36.5
0°-90°	4417.2	45.5
90°-120°	870.2	9.0
90°-150°	3847.4	39.6
90°-180°	5294.0	54.5
0°-180°	9710.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1735	1735	1735	1735	1735	
5°	1735	1728	1710	1723	1720	165
15°	1651	1642	1620	1627	1618	465
25°	1495	1481	1453	1456	1453	688
35°	1290	1273	1246	1236	1228	805
45°	1049	1038	1012	994	988	810
55°	794	784	764	744	736	710
65°	536	526	509	494	485	530
75°	280	277	268	259	262	299
85°	68	67	65	60	58	76
90°	1	16	26	33	35	9
95°	85	42	51	58	56	101
105°	397	436	80	94	99	424
115°	751	774	806	201	107	740
125°	1062	1079	1104	1113	1117	947
135°	1314	1335	1347	1360	1358	1015
145°	1525	1523	1546	1555	1548	954
155°	1679	1667	1683	1691	1680	774
165°	1769	1761	1765	1774	1765	500
175°	1810	1800	1803	1812	1799	172
180°	1806	1806	1806	1806	1806	

TEST NUMBER: P921347

CATALOG NUMBER: DFN2DIP-4P3F0-050D060US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1734.8	1734.8	1734.8	1734.8	1734.8
2.5°	1744.9	1736.6	1718.2	1734.8	1731.7
5°	1734.8	1728.3	1709.9	1723.1	1720.0
7.5°	1723.1	1713.2	1694.9	1708.3	1705.0
10°	1705.0	1693.3	1673.3	1686.5	1681.6
12.5°	1679.8	1669.9	1649.9	1658.2	1654.8
15°	1651.4	1641.5	1619.8	1626.6	1618.2
17.5°	1616.4	1606.5	1584.7	1593.0	1584.7
20°	1578.1	1568.2	1544.8	1549.7	1543.2
22.5°	1539.8	1524.7	1503.0	1503.0	1499.6
25°	1494.7	1481.4	1453.0	1456.3	1453.0
27.5°	1444.6	1432.9	1411.3	1406.3	1398.0
30°	1394.6	1381.3	1356.3	1351.3	1344.6
32.5°	1341.2	1331.3	1304.6	1294.5	1287.8
35°	1289.5	1272.9	1246.2	1236.1	1227.8
37.5°	1231.1	1216.1	1189.4	1177.7	1169.4
40°	1171.2	1157.7	1131.0	1116.1	1109.4
42.5°	1112.8	1099.3	1072.7	1055.9	1046.0
45°	1049.4	1037.7	1012.5	994.3	987.6
47.5°	987.6	975.9	949.2	930.8	920.9
50°	922.5	914.2	890.8	867.5	859.1
52.5°	859.1	847.4	825.8	807.4	795.8
55°	794.2	784.1	764.0	744.0	735.8
57.5°	729.0	720.7	698.9	678.9	672.2
60°	663.9	657.4	634.0	615.5	610.6
62.5°	600.6	588.9	572.2	555.5	548.8
65°	535.6	525.5	508.8	493.8	485.4
67.5°	468.9	460.4	445.5	433.8	427.0
70°	407.1	400.4	385.3	373.6	367.1
72.5°	343.8	337.0	328.7	317.0	312.0
75°	280.2	277.0	268.5	258.6	262.0
77.5°	223.6	216.8	213.5	208.5	203.6
80°	166.9	165.1	161.8	156.9	153.5
82.5°	113.4	113.4	111.8	105.1	105.1
85°	68.3	66.7	65.1	60.0	58.4
87.5°	30.1	26.8	23.4	18.4	16.7
90°	1.2	15.7	26.0	32.7	35.2
92.5°	32.7	27.5	31.3	34.0	35.2
95°	84.9	41.7	50.9	57.6	56.2
97.5°	152.8	45.7	66.5	70.6	71.9
100°	231.3	52.3	74.5	84.9	87.5
102.5°	317.4	315.0	77.1	91.4	95.4
105°	397.2	436.4	79.7	94.0	99.3
107.5°	490.0	522.5	82.4	96.7	101.9
110°	578.9	606.2	228.7	98.1	103.2

TEST NUMBER: P921347

CATALOG NUMBER: DFN2DIP-4P3F0-050D060US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	662.5	685.9	663.7	100.5	104.6
115°	751.3	773.5	806.2	201.3	107.2
117.5°	828.3	854.4	876.7	689.8	347.5
120°	914.6	934.2	957.8	973.4	797.0
122.5°	987.7	1008.6	1034.8	1042.6	1044.0
125°	1062.2	1079.2	1104.0	1113.2	1117.0
127.5°	1130.2	1148.4	1168.1	1181.2	1182.4
130°	1194.2	1215.1	1229.4	1243.8	1242.6
132.5°	1259.5	1276.6	1290.8	1302.6	1301.4
135°	1314.5	1335.4	1347.0	1360.2	1357.5
137.5°	1371.8	1387.5	1400.7	1413.7	1409.9
140°	1428.0	1438.6	1452.9	1464.6	1458.1
142.5°	1475.2	1484.3	1501.3	1511.6	1505.1
145°	1524.8	1523.4	1545.6	1554.8	1548.3
147.5°	1567.8	1563.9	1586.1	1592.6	1587.5
150°	1609.7	1600.5	1621.5	1629.2	1622.7
152.5°	1644.9	1634.5	1654.0	1662.0	1652.8
155°	1678.9	1667.2	1682.9	1690.7	1680.2
157.5°	1706.4	1695.9	1707.7	1716.9	1706.4
160°	1729.9	1722.0	1729.9	1737.7	1728.6
162.5°	1750.7	1742.9	1749.4	1758.6	1746.9
165°	1769.1	1761.3	1765.1	1774.3	1765.1
167.5°	1783.4	1775.6	1779.6	1788.8	1776.9
170°	1795.3	1787.3	1790.0	1799.1	1787.3
172.5°	1803.0	1795.3	1797.9	1807.1	1795.3
175°	1809.5	1800.4	1803.0	1812.1	1799.1
177.5°	1812.1	1803.0	1804.4	1813.6	1801.8
180°	1805.6	1805.6	1805.6	1805.6	1805.6

TEST NUMBER: P921347

CATALOG NUMBER: DFN2DIP-4P3F0-050D060US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.17	10.00	10.17	11.00	12.34	8.73	9.55	9.72	10.56	11.89
	3H	10.83	11.56	11.83	12.58	13.94	10.34	11.07	11.34	12.09	13.44
	4H	11.41	12.11	12.43	13.13	14.49	10.92	11.61	11.93	12.63	14.00
	6H	11.81	12.45	12.83	13.47	14.85	11.30	11.95	12.33	12.97	14.35
	8H	11.91	12.52	12.94	13.56	14.93	11.40	12.02	12.44	13.06	14.43
	12H	11.95	12.53	12.99	13.57	14.96	11.44	12.02	12.48	13.06	14.45
4H	2H	9.63	10.33	10.65	11.34	12.71	9.27	9.97	10.30	10.99	12.35
	3H	11.48	12.07	12.52	13.11	14.49	11.08	11.66	12.11	12.71	14.08
	4H	12.19	12.73	13.23	13.77	15.16	11.77	12.30	12.81	13.34	14.74
	6H	12.70	13.16	13.75	14.22	15.62	12.27	12.73	13.32	13.79	15.18
	8H	12.85	13.28	13.90	14.33	15.74	12.41	12.84	13.46	13.89	15.30
	12H	12.92	13.30	13.99	14.37	15.79	12.47	12.86	13.54	13.92	15.34
8H	4H	12.38	12.81	13.43	13.87	15.28	12.01	12.43	13.06	13.49	14.90
	6H	13.01	13.36	14.08	14.46	15.86	12.62	12.98	13.70	14.07	15.48
	8H	13.22	13.53	14.30	14.61	16.04	12.83	13.14	13.91	14.22	15.65
	12H	13.35	13.62	14.44	14.70	16.17	12.94	13.21	14.02	14.29	15.76
12H	4H	12.37	12.75	13.43	13.82	15.24	12.00	12.38	13.07	13.45	14.87
	6H	13.03	13.35	14.12	14.43	15.85	12.66	12.97	13.74	14.05	15.48
	8H	13.27	13.54	14.36	14.62	16.09	12.89	13.16	13.98	14.24	15.71