

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908015

Luminaire Tested: DFN2DIP-HX3F0-040D070US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908015
REPORT IS A COMBINATION OF REPORTS P900779 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-040D070US840-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10997.4 lumens
Efficiency: N/A
Efficacy: 125.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 87.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908015

CATALOG NUMBER: DFN2DIP-HX3F0-040D070US840-FLLONL

Luminous Intensity Polar Plot

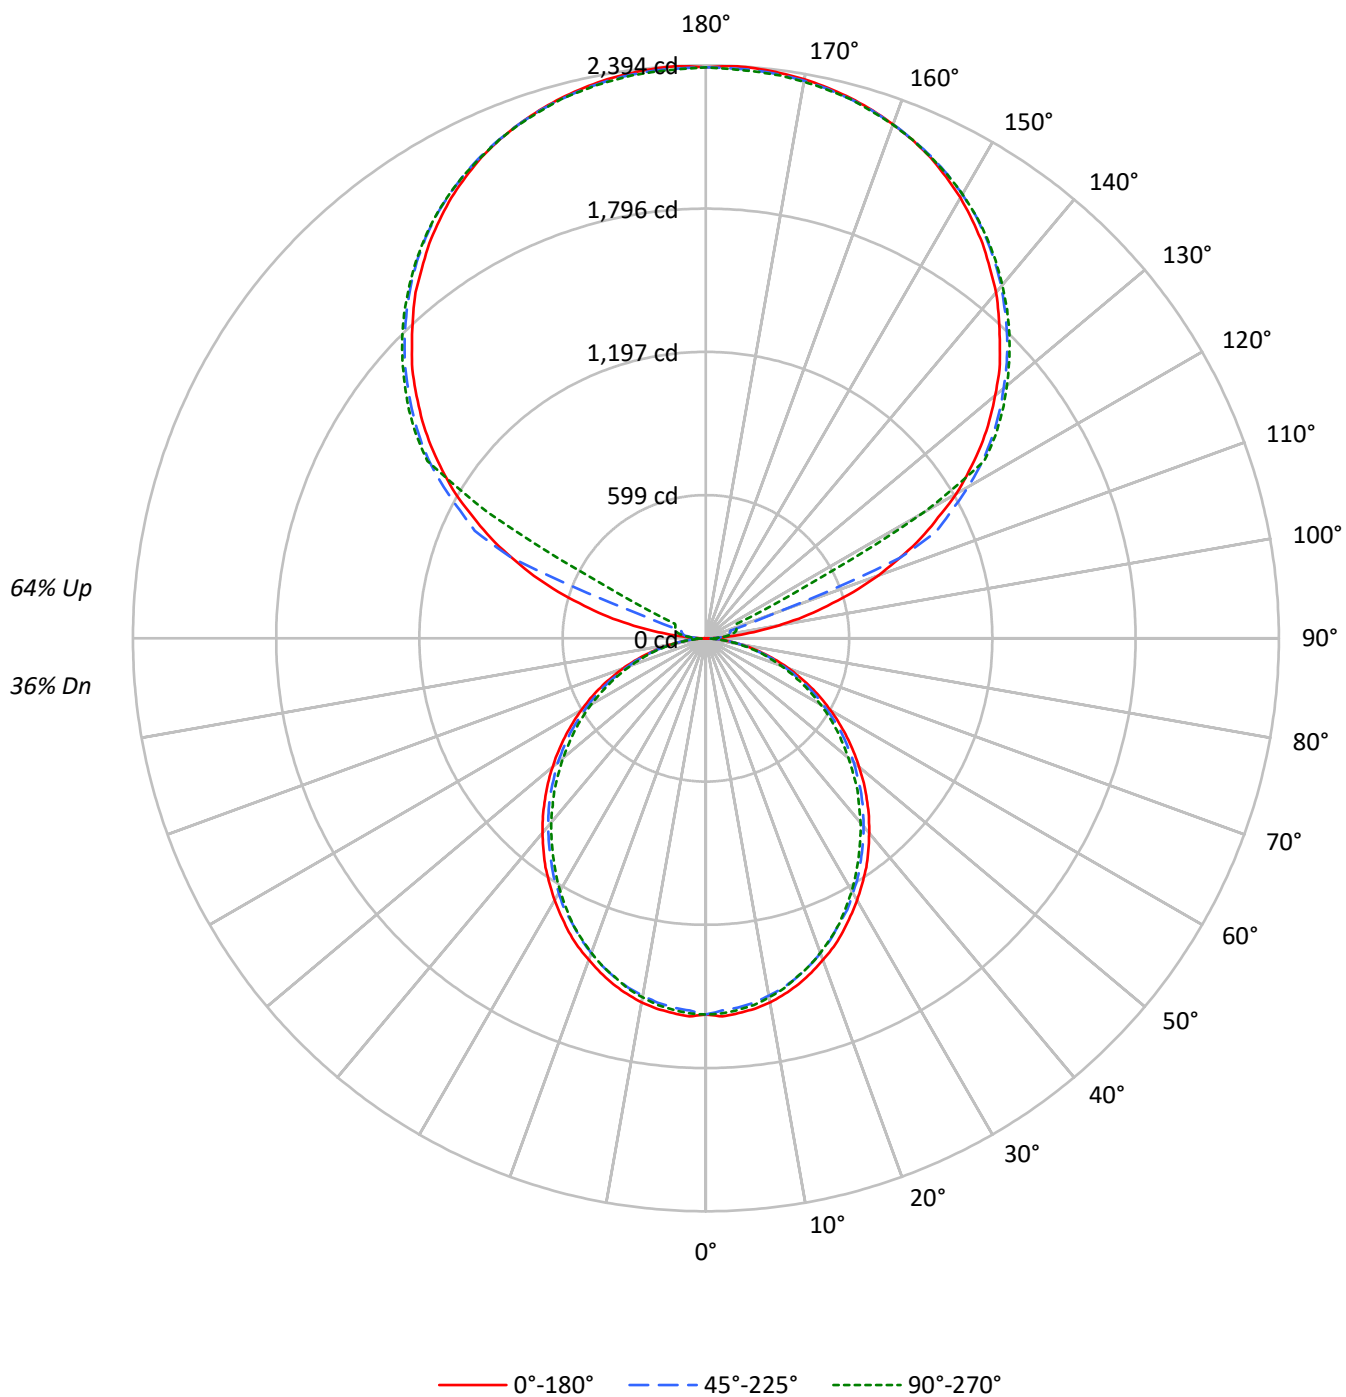

TEST NUMBER: P908015

CATALOG NUMBER: DFN2DIP-HX3F0-040D070US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	90	87	83	86	82	79	76	66	64	62	52	50	49	39	38	37
2	86	79	73	68	78	72	67	62	58	54	51	46	43	41	34	32	31
3	79	69	62	57	71	63	57	52	51	47	43	40	37	35	30	28	26
4	72	61	54	48	65	56	49	44	45	41	37	36	32	30	27	25	23
5	66	55	47	41	59	50	43	38	41	35	32	32	28	26	24	22	20
6	61	49	41	35	55	45	38	33	37	31	27	29	25	22	22	19	17
7	56	44	36	31	51	40	33	29	33	28	24	26	23	20	20	17	15
8	52	40	32	27	47	37	30	25	30	25	21	24	20	18	18	16	14
9	48	36	29	24	44	33	27	22	28	23	19	22	18	16	17	14	12
10	45	33	26	21	41	31	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1821	1821	1821
5°	1823	1794	1806
10°	1807	1769	1781
15°	1780	1738	1742
20°	1743	1697	1702
25°	1706	1647	1655
30°	1661	1601	1597
35°	1618	1546	1535
40°	1564	1491	1476
45°	1511	1436	1416
50°	1453	1378	1346
55°	1392	1311	1282
60°	1324	1232	1208
65°	1248	1149	1121
70°	1152	1048	1027
75°	1020	928	939
80°	860	773	773
85°	610	512	501

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1531 cd/sqm

TEST NUMBER: P908015

CATALOG NUMBER: DFN2DIP-HX3F0-040D070US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.3
10°-20°	416.2	3.8
20°-30°	611.7	5.6
30°-40°	710.5	6.5
40°-50°	709.6	6.5
50°-60°	618.7	5.6
60°-70°	457.4	4.2
70°-80°	258.8	2.4
80°-90°	72.5	0.7
90°-100°	78.7	0.7
100°-110°	293.3	2.7
110°-120°	777.8	7.1
120°-130°	1290.0	11.7
130°-140°	1370.3	12.5
140°-150°	1273.5	11.6
150°-160°	1023.9	9.3
160°-170°	659.7	6.0
170°-180°	227.1	2.1
0°-30°	1175.9	10.7
0°-40°	1886.3	17.2
0°-60°	3214.6	29.2
0°-90°	4003.2	36.4
90°-120°	1149.7	10.5
90°-150°	5083.5	46.2
90°-180°	6994.0	63.6
0°-180°	10997.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	2	21	34	43	47	10
95°	112	55	67	76	74	133
105°	525	577	105	124	131	561
115°	993	1022	1065	266	142	977
125°	1403	1426	1459	1471	1476	1252
135°	1737	1764	1780	1797	1794	1342
145°	2015	2013	2042	2054	2046	1260
155°	2218	2203	2224	2234	2220	1022
165°	2337	2327	2332	2344	2332	660
175°	2391	2379	2382	2394	2377	228
180°	2386	2386	2386	2386	2386	

TEST NUMBER: P908015

CATALOG NUMBER: DFN2DIP-HX3F0-040D070US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	1.6	20.7	34.4	43.2	46.6
92.5°	43.2	36.3	41.4	44.9	46.6
95°	112.1	55.1	67.3	76.0	74.2
97.5°	201.9	60.5	88.0	93.3	94.9
100°	305.7	69.1	98.4	112.1	115.6
102.5°	419.4	416.2	101.9	120.8	126.0
105°	524.8	576.6	105.3	124.2	131.2
107.5°	647.3	690.4	108.9	127.7	134.7
110°	764.9	800.9	302.2	129.6	136.3

TEST NUMBER: P908015

CATALOG NUMBER: DFN2DIP-HX3F0-040D070US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	875.4	906.3	877.0	132.8	138.1
115°	992.6	1021.9	1065.1	265.9	141.7
117.5°	1094.5	1128.9	1158.4	911.4	459.2
120°	1208.4	1234.3	1265.5	1286.2	1053.1
122.5°	1304.9	1332.6	1367.4	1377.6	1379.4
125°	1403.4	1425.9	1458.8	1470.9	1475.9
127.5°	1493.2	1517.3	1543.4	1560.6	1562.3
130°	1577.8	1605.5	1624.4	1643.5	1641.8
132.5°	1664.2	1686.7	1705.6	1721.1	1719.5
135°	1736.7	1764.3	1779.8	1797.2	1793.7
137.5°	1812.5	1833.3	1850.7	1867.9	1862.8
140°	1886.7	1900.7	1919.6	1935.1	1926.5
142.5°	1949.0	1961.2	1983.5	1997.2	1988.6
145°	2014.7	2012.9	2042.2	2054.3	2045.7
147.5°	2071.4	2066.4	2095.7	2104.3	2097.5
150°	2126.8	2114.8	2142.4	2152.6	2144.0
152.5°	2173.3	2159.6	2185.5	2195.9	2183.8
155°	2218.3	2202.8	2223.5	2233.8	2220.1
157.5°	2254.5	2240.8	2256.3	2268.5	2254.5
160°	2285.7	2275.2	2285.7	2295.9	2283.8
162.5°	2313.2	2302.9	2311.5	2323.6	2308.0
165°	2337.3	2327.1	2332.2	2344.3	2332.2
167.5°	2356.4	2345.9	2351.3	2363.4	2347.8
170°	2372.0	2361.6	2365.0	2377.1	2361.6
172.5°	2382.3	2372.0	2375.5	2387.5	2372.0
175°	2390.9	2378.7	2382.3	2394.3	2377.1
177.5°	2394.3	2382.3	2384.1	2396.2	2380.6
180°	2385.7	2385.7	2385.7	2385.7	2385.7

TEST NUMBER: P908015

CATALOG NUMBER: DFN2DIP-HX3F0-040D070US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.90	8.66	8.97	9.72	11.18	7.47	8.23	8.54	9.29	10.75
	3H	9.55	10.22	10.62	11.30	12.77	9.08	9.75	10.15	10.83	12.30
	4H	10.13	10.76	11.21	11.84	13.32	9.66	10.29	10.74	11.37	12.85
	6H	10.51	11.10	11.61	12.18	13.67	10.04	10.63	11.14	11.71	13.20
	8H	10.61	11.17	11.71	12.27	13.75	10.14	10.70	11.24	11.80	13.28
	12H	10.65	11.18	11.76	12.28	13.78	10.18	10.71	11.28	11.80	13.31
4H	2H	8.35	8.99	9.44	10.07	11.54	8.01	8.64	9.10	9.72	11.20
	3H	10.20	10.73	11.30	11.83	13.32	9.81	10.34	10.91	11.44	12.93
	4H	10.90	11.39	12.00	12.48	14.00	10.50	10.99	11.60	12.08	13.59
	6H	11.40	11.82	12.51	12.94	14.44	11.00	11.42	12.11	12.53	14.04
	8H	11.54	11.94	12.66	13.05	14.57	11.14	11.53	12.25	12.64	14.16
	12H	11.61	11.96	12.74	13.09	14.61	11.19	11.55	12.32	12.67	14.19
8H	4H	11.08	11.48	12.20	12.59	14.11	10.73	11.12	11.84	12.23	13.75
	6H	11.70	12.03	12.84	13.18	14.69	11.34	11.67	12.48	12.82	14.34
	8H	11.92	12.20	13.06	13.33	14.87	11.55	11.83	12.69	12.97	14.50
	12H	12.04	12.29	13.18	13.42	14.99	11.66	11.91	12.80	13.04	14.61
12H	4H	11.06	11.42	12.19	12.54	14.07	10.71	11.07	11.84	12.19	13.72
	6H	11.73	12.01	12.87	13.15	14.68	11.38	11.66	12.52	12.80	14.33
	8H	11.96	12.21	13.10	13.34	14.91	11.61	11.86	12.75	12.98	14.56

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

8 of 8