

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928992

Luminaire Tested: DFN2DIP-HX4F0-080D120US935-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928992
REPORT IS A COMBINATION OF REPORTS P900971 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-080D120US935-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17047.8 lumens
Efficiency: N/A
Efficacy: 98.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 172.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928992

CATALOG NUMBER: DFN2DIP-HX4F0-080D120US935-FLLONL

Luminous Intensity Polar Plot

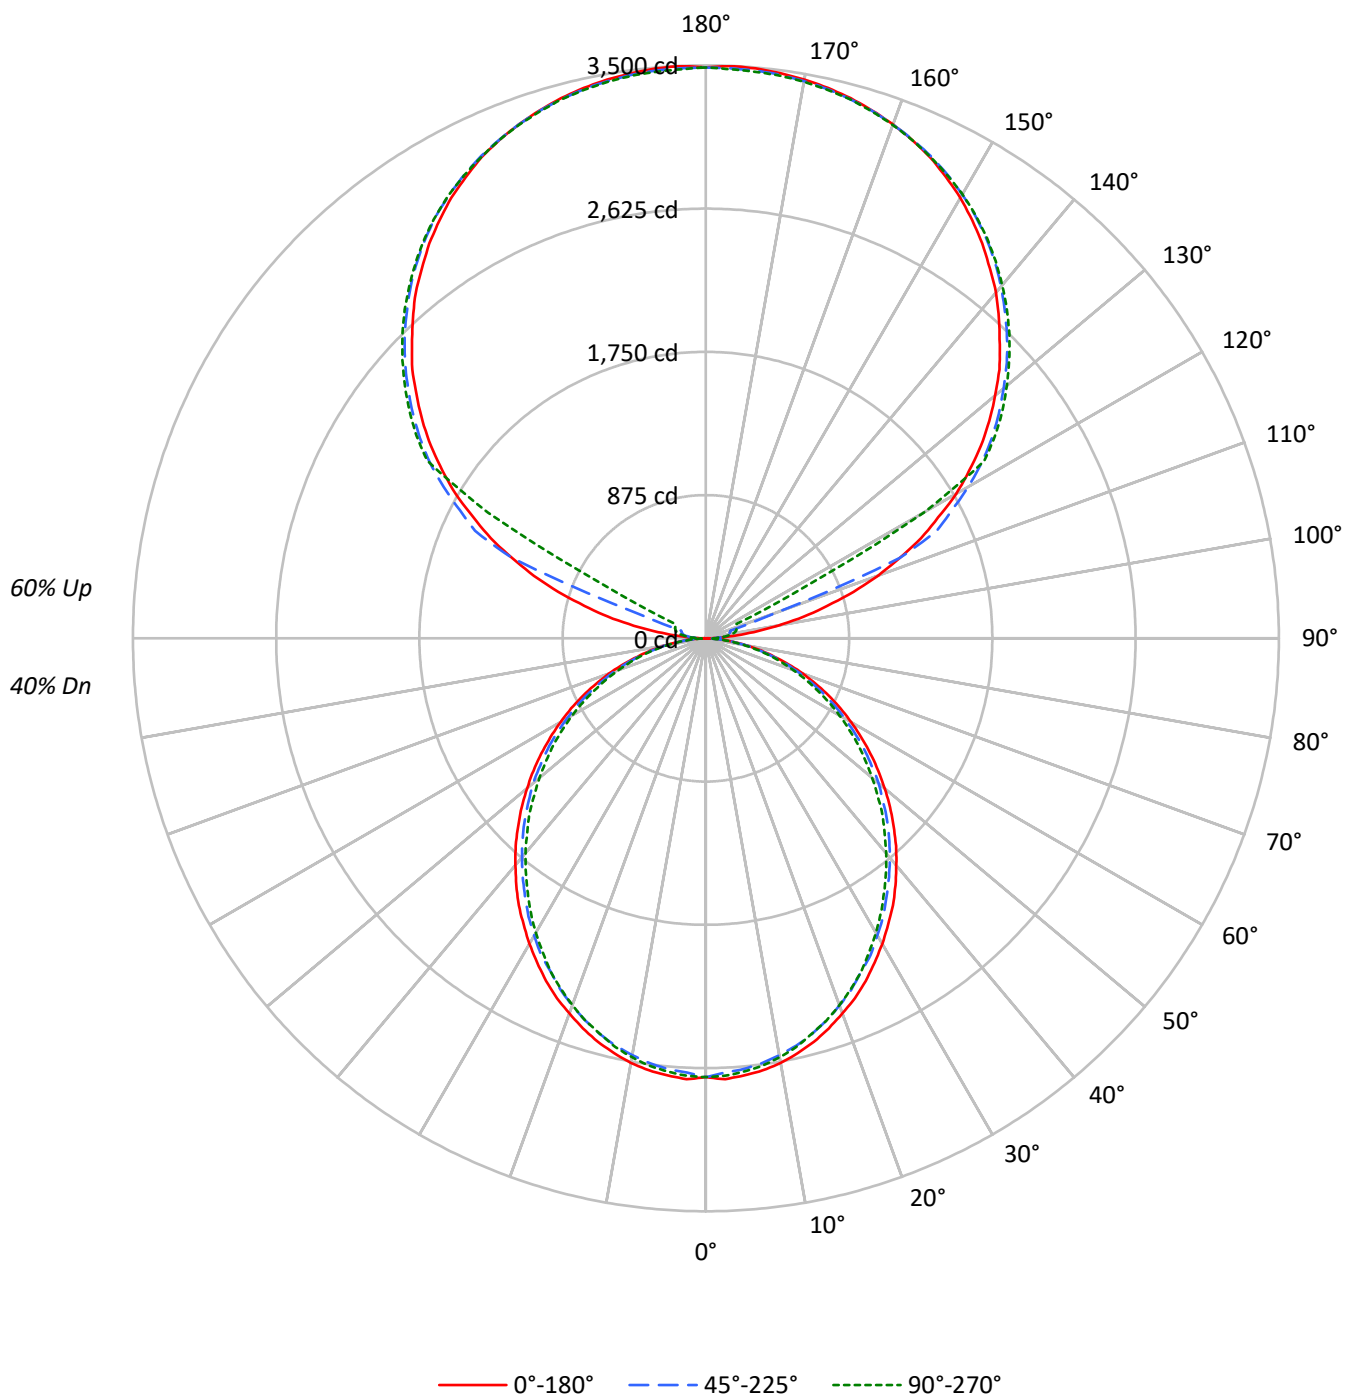

TEST NUMBER: P928992

CATALOG NUMBER: DFN2DIP-HX4F0-080D120US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1993	1993	1993
5°	1996	1965	1978
10°	1980	1939	1952
15°	1951	1907	1910
20°	1912	1863	1867
25°	1873	1810	1818
30°	1824	1761	1755
35°	1778	1703	1688
40°	1721	1645	1625
45°	1664	1586	1560
50°	1602	1524	1485
55°	1537	1453	1416
60°	1463	1368	1337
65°	1383	1281	1244
70°	1281	1174	1144
75°	1139	1046	1052
80°	970	883	875
85°	704	602	582

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1790 cd/sqm

TEST NUMBER: P928992

CATALOG NUMBER: DFN2DIP-HX4F0-080D120US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	1.5
10°-20°	709.8	4.2
20°-30°	1043.1	6.1
30°-40°	1211.4	7.1
40°-50°	1210.0	7.1
50°-60°	1055.0	6.2
60°-70°	779.9	4.6
70°-80°	441.2	2.6
80°-90°	122.6	0.7
90°-100°	115.0	0.7
100°-110°	428.6	2.5
110°-120°	1136.8	6.7
120°-130°	1885.4	11.1
130°-140°	2002.8	11.7
140°-150°	1861.3	10.9
150°-160°	1496.5	8.8
160°-170°	964.3	5.7
170°-180°	331.9	1.9
0°-30°	2005.1	11.8
0°-40°	3216.5	18.9
0°-60°	5481.5	32.2
0°-90°	6825.2	40.0
90°-120°	1680.4	9.9
90°-150°	7429.9	43.6
90°-180°	10223.0	60.0
0°-180°	17047.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	2	30	50	63	68	16
95°	164	81	98	111	108	194
105°	767	843	154	182	192	820
115°	1451	1494	1557	389	207	1428
125°	2051	2084	2132	2150	2157	1829
135°	2538	2579	2601	2627	2622	1961
145°	2945	2942	2985	3002	2990	1842
155°	3242	3220	3250	3265	3245	1494
165°	3416	3401	3409	3426	3409	965
175°	3494	3477	3482	3500	3474	333
180°	3487	3487	3487	3487	3487	

TEST NUMBER: P928992

CATALOG NUMBER: DFN2DIP-HX4F0-080D120US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.3	2461.2	2448.3
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.7	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.6
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.3	1631.3	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.2	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.5
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	2.4	30.2	50.4	63.2	68.0
92.5°	63.2	53.0	60.5	65.6	68.0
95°	163.8	80.6	98.2	111.2	108.5
97.5°	295.2	88.4	128.5	136.3	138.7
100°	446.7	101.0	143.8	163.8	169.0
102.5°	613.0	608.2	148.9	176.5	184.3
105°	767.0	842.8	154.0	181.6	191.7
107.5°	946.2	1009.1	159.1	186.7	196.8
110°	1117.8	1170.6	441.6	189.3	199.2

TEST NUMBER: P928992

CATALOG NUMBER: DFN2DIP-HX4F0-080D120US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1279.4	1324.6	1281.8	194.2	201.9
115°	1450.7	1493.6	1556.8	388.6	207.1
117.5°	1599.7	1650.0	1693.2	1332.1	671.1
120°	1766.3	1804.0	1849.5	1879.8	1539.1
122.5°	1907.4	1947.8	1998.5	2013.4	2016.1
125°	2051.2	2084.1	2132.1	2149.7	2157.2
127.5°	2182.4	2217.8	2255.8	2281.0	2283.4
130°	2306.1	2346.6	2374.1	2402.0	2399.6
132.5°	2432.2	2465.2	2492.8	2515.6	2513.2
135°	2538.3	2578.8	2601.3	2626.7	2621.7
137.5°	2649.2	2679.4	2704.9	2730.1	2722.6
140°	2757.7	2778.0	2805.6	2828.4	2815.8
142.5°	2848.7	2866.4	2899.1	2919.1	2906.6
145°	2944.6	2942.0	2984.7	3002.5	2989.8
147.5°	3027.6	3020.1	3063.0	3075.6	3065.7
150°	3108.5	3090.8	3131.3	3146.3	3133.7
152.5°	3176.5	3156.4	3194.2	3209.5	3191.8
155°	3242.1	3219.6	3249.9	3264.9	3244.9
157.5°	3295.1	3275.1	3297.9	3315.5	3295.1
160°	3340.7	3325.4	3340.7	3355.7	3338.0
162.5°	3380.9	3365.9	3378.5	3396.1	3373.4
165°	3416.2	3401.2	3408.7	3426.4	3408.7
167.5°	3444.1	3428.8	3436.6	3454.2	3431.5
170°	3466.8	3451.6	3456.7	3474.3	3451.6
172.5°	3481.8	3466.8	3472.0	3489.6	3466.8
175°	3494.4	3476.7	3481.8	3499.5	3474.3
177.5°	3499.5	3481.8	3484.6	3502.2	3479.5
180°	3487.0	3487.0	3487.0	3487.0	3487.0

TEST NUMBER: P928992

CATALOG NUMBER: DFN2DIP-HX4F0-080D120US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.67	9.45	9.71	10.49	11.90	8.24	9.02	9.28	10.06	11.47
	3H	10.33	11.02	11.37	12.08	13.50	9.85	10.55	10.90	11.60	13.03
	4H	10.91	11.57	11.97	12.63	14.06	10.44	11.10	11.50	12.15	13.59
	6H	11.31	11.92	12.38	12.98	14.42	10.83	11.44	11.90	12.50	13.94
	8H	11.41	11.99	12.48	13.06	14.50	10.93	11.51	12.01	12.59	14.03
	12H	11.46	12.01	12.53	13.08	14.54	10.97	11.52	12.05	12.59	14.06
4H	2H	9.12	9.78	10.19	10.84	12.27	8.78	9.44	9.85	10.50	11.93
	3H	10.98	11.53	12.06	12.62	14.06	10.59	11.14	11.66	12.22	13.67
	4H	11.69	12.20	12.77	13.27	14.74	11.29	11.80	12.37	12.87	14.34
	6H	12.21	12.64	13.29	13.74	15.20	11.80	12.23	12.88	13.33	14.79
	8H	12.35	12.76	13.44	13.85	15.33	11.94	12.35	13.03	13.44	14.91
	12H	12.42	12.79	13.53	13.89	15.38	12.00	12.37	13.11	13.47	14.95
8H	4H	11.89	12.29	12.97	13.38	14.86	11.52	11.93	12.61	13.02	14.50
	6H	12.51	12.85	13.63	13.98	15.45	12.15	12.49	13.26	13.62	15.09
	8H	12.74	13.03	13.85	14.14	15.64	12.37	12.66	13.48	13.77	15.27
	12H	12.86	13.12	13.99	14.23	15.76	12.48	12.74	13.60	13.85	15.38
12H	4H	11.87	12.23	12.97	13.34	14.82	11.51	11.88	12.62	12.98	14.47
	6H	12.54	12.84	13.66	13.95	15.44	12.19	12.49	13.31	13.60	15.09
	8H	12.78	13.04	13.90	14.15	15.68	12.43	12.68	13.55	13.79	15.32