

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908501

Luminaire Tested: DFN2DIP-PN3F0-060D060US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908501
REPORT IS A COMBINATION OF REPORTS P901079 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D060US840-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11997.2 lumens
Efficiency: N/A
Efficacy: 116.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 103
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908501

CATALOG NUMBER: DFN2DIP-PN3F0-060D060US840-FLLONL

Luminous Intensity Polar Plot

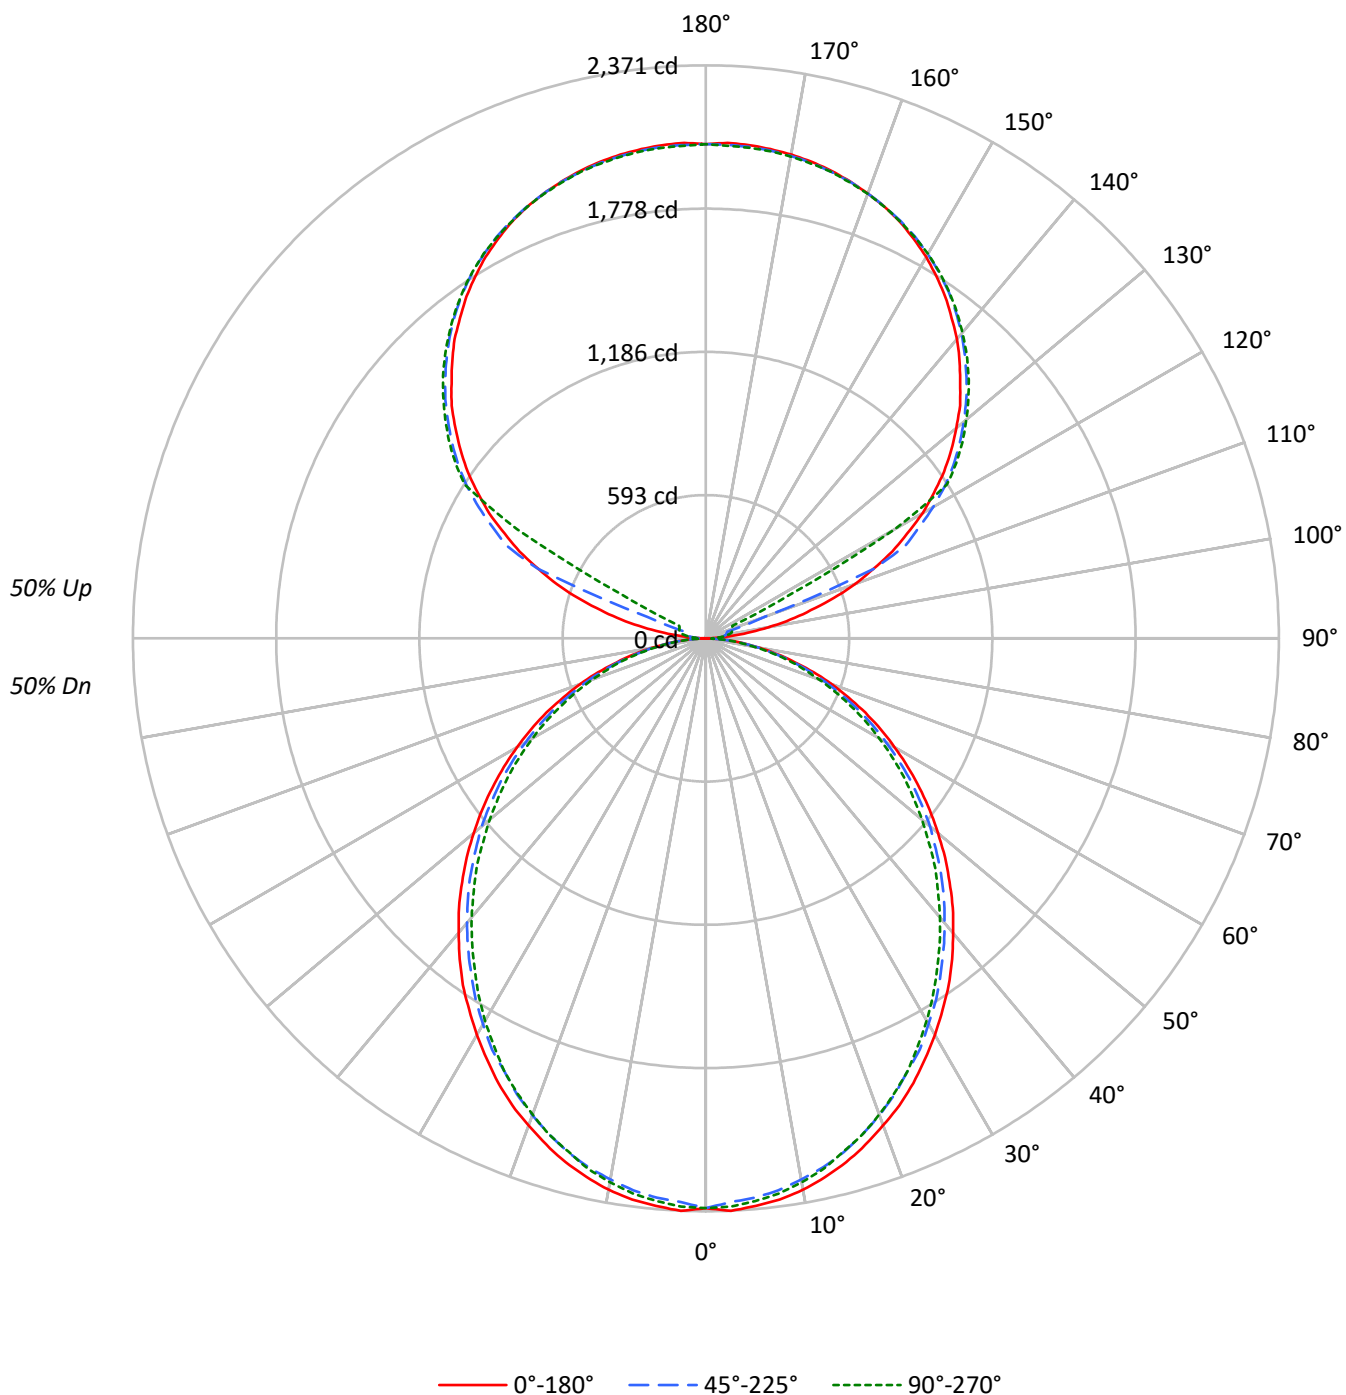

TEST NUMBER: P908501

CATALOG NUMBER: DFN2DIP-PN3F0-060D060US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2756	2756	2756
5°	2759	2716	2735
10°	2735	2677	2696
15°	2693	2631	2638
20°	2637	2568	2577
25°	2581	2493	2508
30°	2512	2423	2419
35°	2446	2340	2326
40°	2365	2257	2237
45°	2284	2173	2146
50°	2196	2086	2041
55°	2103	1984	1944
60°	1998	1864	1833
65°	1883	1739	1701
70°	1737	1586	1560
75°	1535	1404	1428
80°	1291	1170	1178
85°	910	774	768

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2284 cd/sqm

TEST NUMBER: P908501

CATALOG NUMBER: DFN2DIP-PN3F0-060D060US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.8
10°-20°	624.4	5.2
20°-30°	917.5	7.6
30°-40°	1065.7	8.9
40°-50°	1064.4	8.9
50°-60°	928.1	7.7
60°-70°	686.1	5.7
70°-80°	388.2	3.2
80°-90°	106.0	0.9
90°-100°	67.4	0.6
100°-110°	251.4	2.1
110°-120°	666.7	5.6
120°-130°	1105.7	9.2
130°-140°	1174.5	9.8
140°-150°	1091.6	9.1
150°-160°	877.6	7.3
160°-170°	565.5	4.7
170°-180°	194.6	1.6
0°-30°	1763.8	14.7
0°-40°	2829.5	23.6
0°-60°	4821.9	40.2
0°-90°	6002.2	50.0
90°-120°	985.5	8.2
90°-150°	4357.2	36.3
90°-180°	5995.0	50.0
0°-180°	11997.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	1	18	30	37	40	11
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P908501

CATALOG NUMBER: DFN2DIP-PN3F0-060D060US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P908501

CATALOG NUMBER: DFN2DIP-PN3F0-060D060US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P908501

CATALOG NUMBER: DFN2DIP-PN3F0-060D060US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.76	11.62	11.72	12.59	13.86	10.32	11.18	11.28	12.15	13.42
	3H	12.41	13.19	13.38	14.17	15.46	11.93	12.70	12.90	13.68	14.98
	4H	13.00	13.73	13.98	14.71	16.01	12.51	13.24	13.49	14.23	15.53
	6H	13.39	14.07	14.38	15.06	16.37	12.90	13.58	13.89	14.57	15.88
	8H	13.49	14.14	14.49	15.14	16.45	13.00	13.65	14.00	14.65	15.96
	12H	13.54	14.15	14.54	15.15	16.49	13.04	13.65	14.05	14.65	15.99
4H	2H	11.22	11.95	12.20	12.93	14.23	10.87	11.60	11.85	12.58	13.88
	3H	13.08	13.69	14.07	14.70	16.02	12.67	13.28	13.67	14.30	15.61
	4H	13.78	14.34	14.79	15.35	16.69	13.37	13.93	14.37	14.93	16.27
	6H	14.29	14.77	15.31	15.81	17.14	13.87	14.35	14.89	15.38	16.72
	8H	14.44	14.89	15.46	15.91	17.26	14.01	14.46	15.03	15.49	16.84
	12H	14.51	14.92	15.55	15.96	17.31	14.07	14.48	15.11	15.52	16.87
8H	4H	13.98	14.43	15.00	15.45	16.80	13.61	14.06	14.62	15.08	16.43
	6H	14.60	14.97	15.64	16.04	17.39	14.23	14.60	15.27	15.66	17.01
	8H	14.82	15.14	15.87	16.20	17.56	14.43	14.76	15.48	15.81	17.18
	12H	14.94	15.23	16.00	16.28	17.69	14.55	14.83	15.60	15.88	17.29
12H	4H	13.96	14.37	15.00	15.41	16.76	13.60	14.01	14.64	15.04	16.40
	6H	14.63	14.96	15.68	16.01	17.38	14.26	14.59	15.32	15.64	17.01
	8H	14.87	15.15	15.92	16.20	17.61	14.50	14.78	15.55	15.83	17.24

END OF REPORT