

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919365

Luminaire Tested: DFN2DIP-PN3F0-040D080US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919365
REPORT IS A COMBINATION OF REPORTS P901103 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D080US935-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10228.6 lumens
Efficiency: N/A
Efficacy: 106.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 96.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919365

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US935-FLLONL

Luminous Intensity Polar Plot

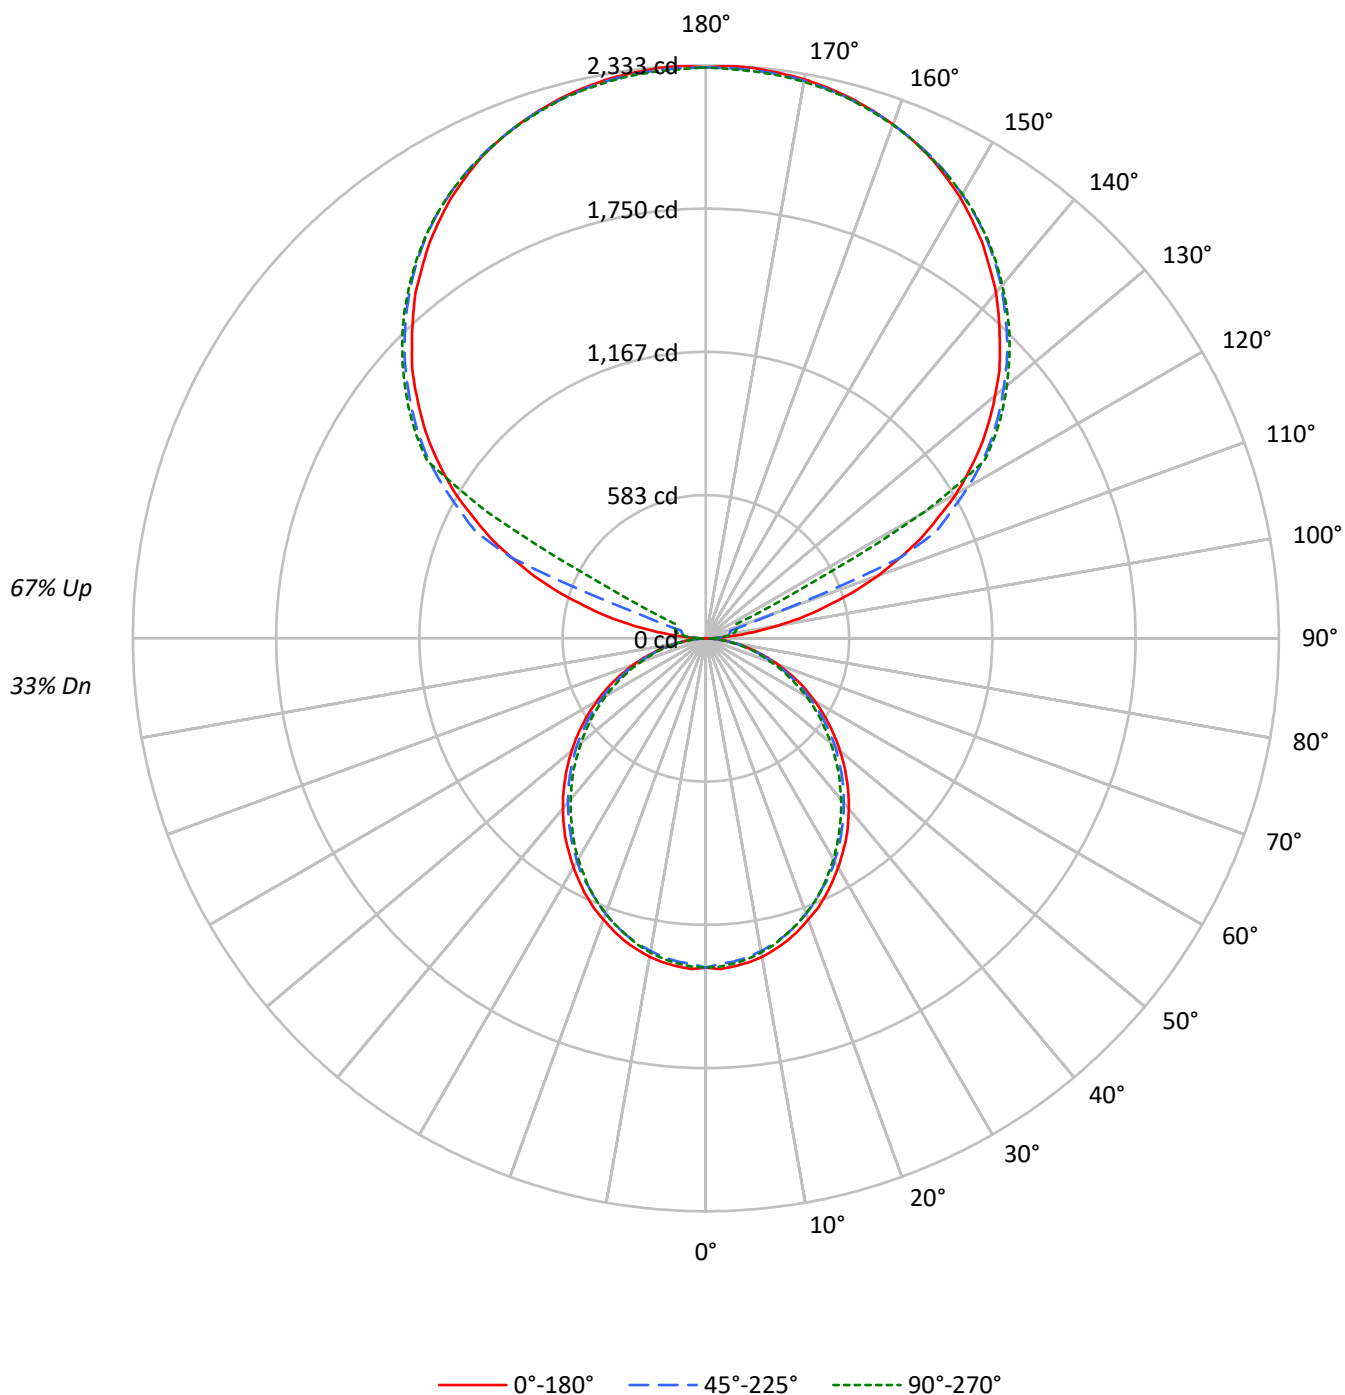

TEST NUMBER: P919365

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1567	1567	1567
5°	1568	1544	1554
10°	1554	1522	1533
15°	1531	1496	1499
20°	1499	1460	1465
25°	1467	1417	1425
30°	1428	1377	1375
35°	1390	1330	1322
40°	1344	1283	1272
45°	1298	1235	1220
50°	1248	1186	1160
55°	1195	1128	1105
60°	1136	1059	1042
65°	1071	988	967
70°	987	902	887
75°	873	798	811
80°	734	665	670
85°	518	440	436

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1570 cd/sqm

TEST NUMBER: P919365

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	126.1	1.2
10°-20°	354.9	3.5
20°-30°	521.5	5.1
30°-40°	605.7	5.9
40°-50°	605.0	5.9
50°-60°	527.5	5.2
60°-70°	389.9	3.8
70°-80°	220.6	2.2
80°-90°	62.3	0.6
90°-100°	76.7	0.7
100°-110°	285.7	2.8
110°-120°	757.9	7.4
120°-130°	1256.9	12.3
130°-140°	1335.2	13.1
140°-150°	1240.9	12.1
150°-160°	997.6	9.8
160°-170°	642.8	6.3
170°-180°	221.3	2.2
0°-30°	1002.5	9.8
0°-40°	1608.3	15.7
0°-60°	2740.7	26.8
0°-90°	3413.6	33.4
90°-120°	1120.2	11.0
90°-150°	4953.3	48.4
90°-180°	6815.0	66.6
0°-180°	10228.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1340	1340	1340	1340	1340	
5°	1340	1335	1321	1331	1329	127
15°	1276	1268	1251	1256	1250	359
25°	1154	1144	1122	1125	1122	531
35°	996	983	963	955	948	622
45°	810	802	782	768	763	626
55°	614	606	590	575	568	548
65°	414	406	393	381	375	409
75°	216	214	207	200	202	231
85°	53	52	50	46	45	59
90°	2	20	34	42	45	9
95°	109	54	66	74	72	129
105°	511	562	103	121	128	546
115°	967	996	1038	259	138	952
125°	1367	1389	1421	1433	1438	1220
135°	1692	1719	1734	1751	1748	1307
145°	1963	1961	1990	2002	1993	1228
155°	2161	2146	2167	2177	2163	996
165°	2278	2268	2272	2284	2272	643
175°	2330	2318	2321	2333	2316	222
180°	2325	2325	2325	2325	2325	

TEST NUMBER: P919365

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1340.1	1340.1	1340.1	1340.1	1340.1
2.5°	1347.9	1341.4	1327.2	1340.1	1337.6
5°	1340.1	1335.0	1320.8	1331.0	1328.6
7.5°	1331.0	1323.4	1309.1	1319.6	1317.0
10°	1317.0	1307.9	1292.5	1302.8	1298.9
12.5°	1297.5	1289.9	1274.4	1280.9	1278.2
15°	1275.7	1268.0	1251.2	1256.4	1250.0
17.5°	1248.6	1241.0	1224.2	1230.5	1224.2
20°	1218.9	1211.3	1193.3	1197.0	1192.1
22.5°	1189.4	1177.8	1161.0	1161.0	1158.4
25°	1154.5	1144.3	1122.4	1124.9	1122.4
27.5°	1115.9	1106.8	1090.2	1086.3	1079.9
30°	1077.3	1066.9	1047.7	1043.8	1038.6
32.5°	1036.0	1028.4	1007.7	1000.0	994.7
35°	996.1	983.3	962.6	954.8	948.4
37.5°	951.0	939.3	918.7	909.7	903.3
40°	904.7	894.2	873.6	862.1	857.0
42.5°	859.5	849.1	828.6	815.6	808.0
45°	810.5	801.6	782.1	768.1	762.8
47.5°	762.8	753.8	733.2	719.0	711.4
50°	712.6	706.1	688.1	670.0	663.6
52.5°	663.6	654.6	637.9	623.7	614.7
55°	613.5	605.6	590.2	574.7	568.3
57.5°	563.1	556.7	539.8	524.4	519.3
60°	512.8	507.7	489.7	475.5	471.7
62.5°	463.9	454.9	442.0	429.1	424.0
65°	413.7	405.9	393.0	381.4	375.1
67.5°	362.1	355.6	344.1	335.1	329.9
70°	314.4	309.3	297.6	288.6	283.5
72.5°	265.5	260.3	253.9	244.9	241.0
75°	216.5	214.0	207.4	199.8	202.3
77.5°	172.6	167.5	164.9	161.0	157.2
80°	128.9	127.5	124.9	121.1	118.6
82.5°	87.6	87.6	86.4	81.2	81.2
85°	52.8	51.6	50.3	46.3	45.1
87.5°	23.2	20.7	18.1	14.2	12.8
90°	1.6	20.1	33.6	42.1	45.4
92.5°	42.1	35.4	40.4	43.7	45.4
95°	109.3	53.7	65.5	74.1	72.3
97.5°	196.7	58.9	85.7	90.9	92.5
100°	297.8	67.3	95.9	109.3	112.6
102.5°	408.7	405.4	99.3	117.6	122.9
105°	511.3	561.9	102.6	121.1	127.9
107.5°	630.8	672.7	106.1	124.4	131.2
110°	745.3	780.4	294.5	126.2	132.9

TEST NUMBER: P919365

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	852.9	883.0	854.5	129.4	134.7
115°	967.2	995.7	1037.8	259.1	138.0
117.5°	1066.4	1100.0	1128.8	888.0	447.5
120°	1177.5	1202.6	1233.0	1253.2	1026.1
122.5°	1271.5	1298.6	1332.3	1342.3	1344.1
125°	1367.4	1389.4	1421.3	1433.1	1438.1
127.5°	1454.9	1478.5	1503.9	1520.6	1522.2
130°	1537.4	1564.3	1582.8	1601.4	1599.7
132.5°	1621.5	1643.5	1661.9	1677.1	1675.4
135°	1692.2	1719.2	1734.1	1751.2	1747.7
137.5°	1766.2	1786.3	1803.3	1820.1	1815.1
140°	1838.4	1852.0	1870.4	1885.6	1877.1
142.5°	1899.2	1910.9	1932.7	1946.1	1937.7
145°	1963.1	1961.3	1989.9	2001.6	1993.2
147.5°	2018.4	2013.4	2041.9	2050.4	2043.8
150°	2072.3	2060.5	2087.5	2097.5	2089.1
152.5°	2117.7	2104.3	2129.4	2139.7	2127.9
155°	2161.4	2146.5	2166.6	2176.6	2163.3
157.5°	2196.7	2183.4	2198.6	2210.4	2196.7
160°	2227.1	2217.0	2227.1	2237.1	2225.3
162.5°	2253.9	2243.9	2252.3	2264.1	2248.9
165°	2277.5	2267.5	2272.5	2284.2	2272.5
167.5°	2296.0	2285.9	2291.0	2302.8	2287.7
170°	2311.3	2301.0	2304.5	2316.3	2301.0
172.5°	2321.3	2311.3	2314.6	2326.4	2311.3
175°	2329.6	2317.8	2321.3	2333.0	2316.3
177.5°	2333.0	2321.3	2323.0	2334.8	2319.6
180°	2324.6	2324.6	2324.6	2324.6	2324.6

TEST NUMBER: P919365

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.02	7.75	8.11	8.84	10.33	6.58	7.31	7.67	8.40	9.89
	3H	8.66	9.32	9.76	10.41	11.92	8.18	8.83	9.28	9.93	11.44
	4H	9.24	9.86	10.35	10.96	12.47	8.76	9.38	9.86	10.47	11.99
	6H	9.63	10.20	10.75	11.30	12.83	9.14	9.71	10.26	10.81	12.34
	8H	9.73	10.27	10.85	11.39	12.91	9.24	9.78	10.36	10.90	12.42
	12H	9.77	10.29	10.89	11.39	12.94	9.27	9.79	10.40	10.90	12.44
4H	2H	7.46	8.08	8.58	9.18	10.69	7.11	7.73	8.22	8.83	10.34
	3H	9.31	9.83	10.43	10.95	12.47	8.91	9.42	10.03	10.55	12.07
	4H	10.01	10.49	11.14	11.60	13.15	9.60	10.07	10.72	11.18	12.73
	6H	10.51	10.92	11.65	12.06	13.59	10.09	10.50	11.22	11.63	13.17
	8H	10.66	11.04	11.79	12.16	13.72	10.23	10.61	11.36	11.74	13.29
	12H	10.72	11.07	11.87	12.21	13.76	10.28	10.63	11.43	11.77	13.33
8H	4H	10.19	10.57	11.32	11.70	13.26	9.82	10.20	10.95	11.33	12.89
	6H	10.81	11.13	11.96	12.30	13.85	10.44	10.75	11.59	11.92	13.47
	8H	11.03	11.30	12.18	12.45	14.02	10.64	10.92	11.80	12.07	13.64
	12H	11.15	11.39	12.31	12.54	14.14	10.75	10.99	11.91	12.14	13.74
12H	4H	10.17	10.52	11.32	11.66	13.22	9.81	10.15	10.96	11.29	12.85
	6H	10.84	11.11	12.00	12.26	13.83	10.47	10.75	11.63	11.90	13.47
	8H	11.07	11.31	12.23	12.46	14.06	10.70	10.94	11.86	12.09	13.69