

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916929

Luminaire Tested: DFN2DIP-PN4F0-080D040US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916929
REPORT IS A COMBINATION OF REPORTS P901137 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-080D040US930-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9685.7 lumens
Efficiency: N/A
Efficacy: 90.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 107.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916929

CATALOG NUMBER: DFN2DIP-PN4F0-080D040US930-FLLONL

Luminous Intensity Polar Plot

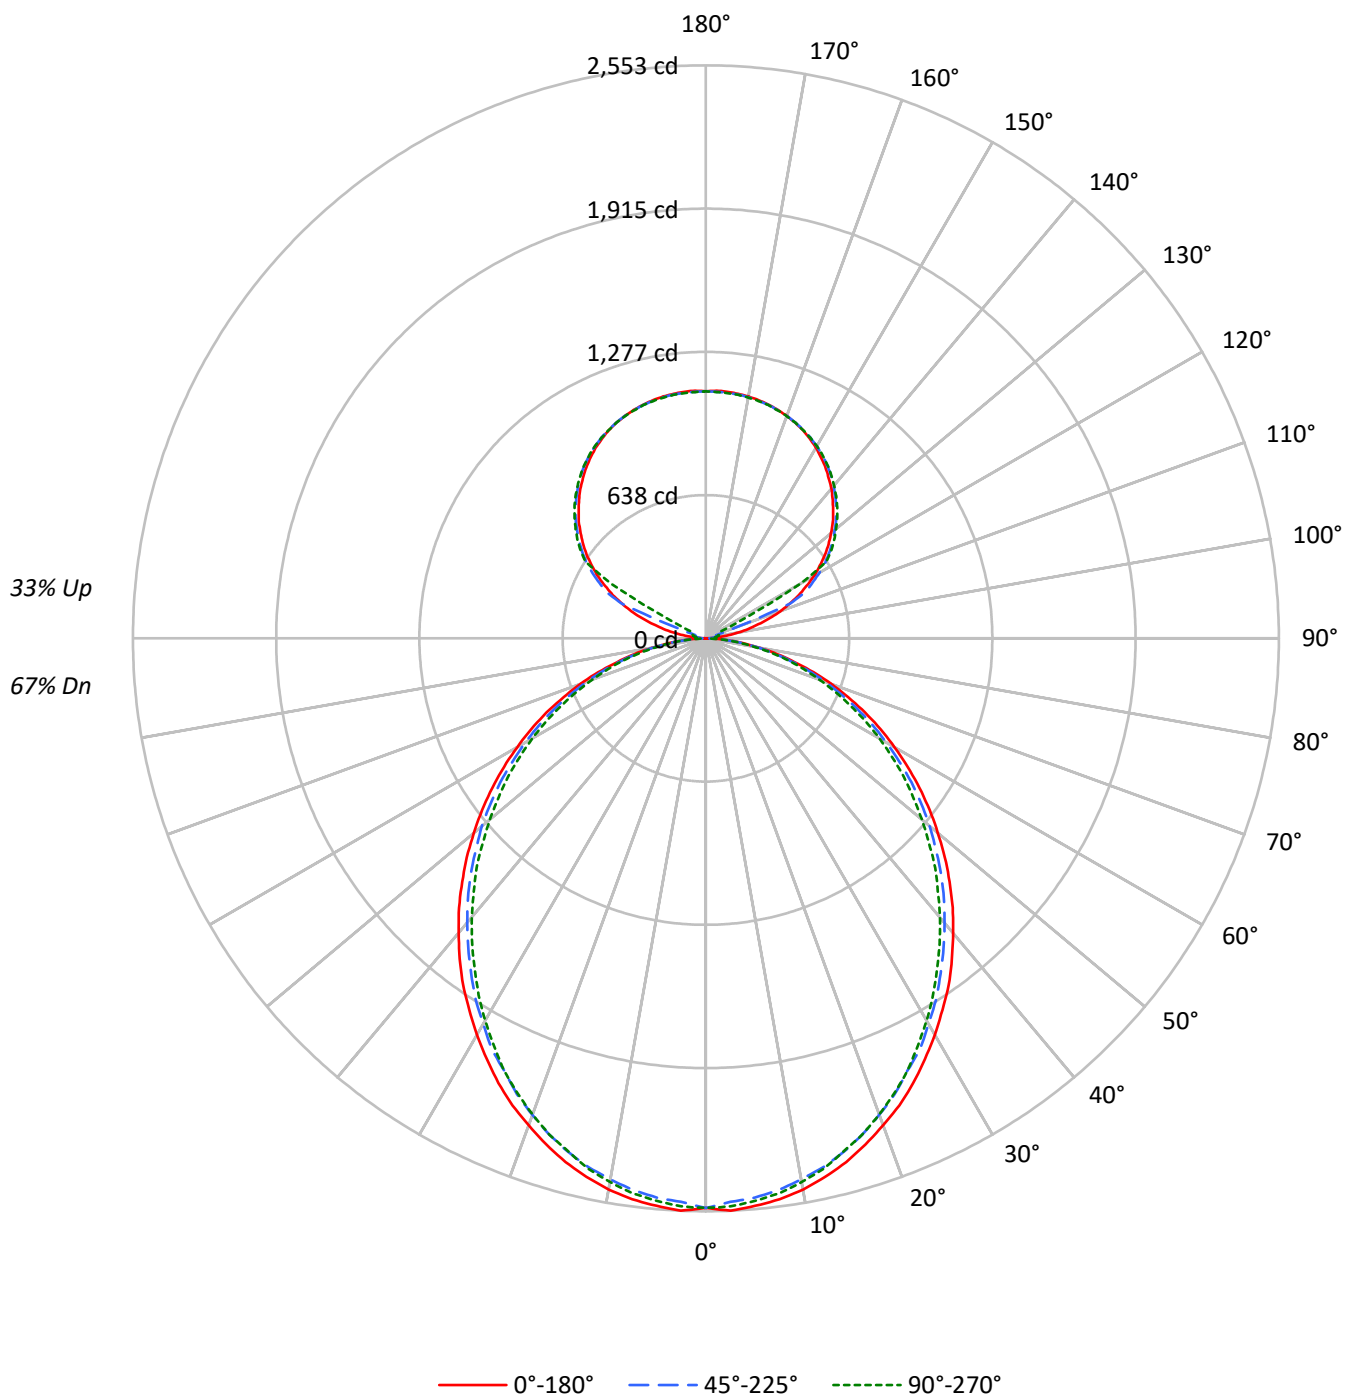

TEST NUMBER: P916929

CATALOG NUMBER: DFN2DIP-PN4F0-080D040US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93	82	82	82	71	71	71
1	102	97	93	90	95	92	88	85	81	79	76	72	70	68	63	62	60
2	92	85	79	73	87	80	75	70	71	67	63	63	60	57	56	53	51
3	84	75	67	61	79	71	64	58	63	58	53	56	52	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	33
6	66	53	45	39	62	50	43	37	45	39	34	41	35	32	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	26
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	50	38	31	26	35	29	24	31	26	23	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1853	1853	1853
5°	1856	1827	1839
10°	1841	1803	1815
15°	1813	1773	1776
20°	1777	1732	1737
25°	1740	1683	1691
30°	1695	1638	1633
35°	1652	1584	1571
40°	1599	1529	1513
45°	1545	1475	1453
50°	1487	1418	1383
55°	1427	1351	1319
60°	1358	1273	1246
65°	1283	1192	1160
70°	1188	1093	1068
75°	1056	974	983
80°	897	823	820
85°	649	562	548

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1545 cd/sqm

TEST NUMBER: P916929

CATALOG NUMBER: DFN2DIP-PN4F0-080D040US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	238.9	2.5
10°-20°	672.1	6.9
20°-30°	987.7	10.2
30°-40°	1147.1	11.8
40°-50°	1145.7	11.8
50°-60°	999.0	10.3
60°-70°	738.5	7.6
70°-80°	417.8	4.3
80°-90°	112.2	1.2
90°-100°	36.3	0.4
100°-110°	135.3	1.4
110°-120°	358.8	3.7
120°-130°	595.1	6.1
130°-140°	632.1	6.5
140°-150°	587.5	6.1
150°-160°	472.3	4.9
160°-170°	304.4	3.1
170°-180°	104.8	1.1
0°-30°	1898.6	19.6
0°-40°	3045.8	31.4
0°-60°	5190.5	53.6
0°-90°	6459.1	66.7
90°-120°	530.4	5.5
90°-150°	2345.2	24.2
90°-180°	3227.0	33.3
0°-180°	9685.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2538	2538	2538	2538	2538	
5°	2538	2528	2501	2521	2516	241
15°	2416	2402	2370	2379	2367	680
25°	2186	2167	2126	2130	2126	1006
35°	1886	1862	1823	1808	1796	1178
45°	1535	1518	1481	1455	1445	1185
55°	1162	1147	1118	1088	1076	1039
65°	784	769	744	722	710	775
75°	410	405	393	378	383	438
85°	100	98	95	88	85	112
90°	1	10	16	20	21	9
95°	52	25	31	35	34	61
105°	242	266	49	57	60	259
115°	458	471	491	123	65	451
125°	647	658	673	679	681	577
135°	801	814	821	829	828	619
145°	929	929	942	948	944	581
155°	1023	1016	1026	1030	1024	472
165°	1078	1074	1076	1082	1076	305
175°	1103	1097	1099	1105	1097	105
180°	1101	1101	1101	1101	1101	

TEST NUMBER: P916929

CATALOG NUMBER: DFN2DIP-PN4F0-080D040US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2537.9	2537.9	2537.9	2537.9	2537.9
2.5°	2552.6	2540.5	2513.6	2537.9	2533.2
5°	2537.9	2528.3	2501.4	2520.8	2516.2
7.5°	2520.8	2506.3	2479.4	2499.1	2494.2
10°	2494.2	2477.0	2447.8	2467.2	2460.0
12.5°	2457.4	2442.9	2413.6	2425.8	2420.9
15°	2416.0	2401.5	2369.6	2379.4	2367.3
17.5°	2364.7	2350.2	2318.3	2330.5	2318.3
20°	2308.5	2294.0	2259.8	2267.1	2257.5
22.5°	2252.6	2230.6	2198.7	2198.7	2193.8
25°	2186.5	2167.1	2125.7	2130.4	2125.7
27.5°	2113.3	2096.2	2064.6	2057.3	2045.2
30°	2040.3	2020.6	1984.1	1976.9	1967.0
32.5°	1962.1	1947.6	1908.5	1893.7	1883.9
35°	1886.4	1862.1	1823.0	1808.2	1796.1
37.5°	1801.0	1779.0	1739.9	1722.8	1710.7
40°	1713.3	1693.5	1654.5	1632.7	1622.9
42.5°	1627.8	1608.1	1569.3	1544.7	1530.2
45°	1535.1	1518.0	1481.2	1454.6	1444.8
47.5°	1444.8	1427.7	1388.5	1361.6	1347.1
50°	1349.5	1337.3	1303.1	1268.9	1256.8
52.5°	1256.8	1239.7	1208.1	1181.2	1164.1
55°	1161.7	1147.0	1117.8	1088.5	1076.3
57.5°	1066.5	1054.3	1022.5	993.2	983.3
60°	971.2	961.6	927.4	900.5	893.2
62.5°	878.5	861.4	837.1	812.8	802.9
65°	783.5	768.7	744.4	722.4	710.2
67.5°	685.8	673.4	651.7	634.6	624.8
70°	595.5	585.6	563.7	546.6	537.0
72.5°	502.8	493.0	480.8	463.7	456.5
75°	409.9	405.2	392.8	378.3	383.2
77.5°	327.0	317.2	312.3	305.0	297.7
80°	244.2	241.6	236.7	229.4	224.5
82.5°	166.0	166.0	163.6	153.8	153.8
85°	100.0	97.6	95.3	87.8	85.4
87.5°	44.0	39.1	34.2	26.9	24.4
90°	0.7	9.5	15.9	20.0	21.4
92.5°	20.0	16.7	19.1	20.7	21.4
95°	51.7	25.4	31.0	35.1	34.2
97.5°	93.2	27.9	40.6	43.0	43.8
100°	141.0	31.9	45.4	51.7	53.3
102.5°	193.5	192.0	47.0	55.7	58.1
105°	242.1	266.0	48.6	57.3	60.5
107.5°	298.6	318.5	50.2	58.9	62.1
110°	352.9	369.5	139.4	59.8	62.9



TEST NUMBER: P916929

CATALOG NUMBER: DFN2DIP-PN4F0-080D040US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	403.8	418.1	404.6	61.3	63.8
115°	457.9	471.4	491.4	122.6	65.4
117.5°	504.9	520.8	534.4	420.4	211.8
120°	557.5	569.4	583.8	593.4	485.8
122.5°	602.0	614.8	630.8	635.5	636.3
125°	647.4	657.9	672.9	678.6	680.9
127.5°	688.8	700.0	712.0	720.0	720.7
130°	727.9	740.7	749.3	758.1	757.4
132.5°	767.7	778.1	786.8	794.0	793.3
135°	801.2	814.0	821.1	829.1	827.5
137.5°	836.2	845.7	853.8	861.7	859.3
140°	870.4	876.9	885.6	892.8	888.8
142.5°	899.2	904.7	915.1	921.4	917.5
145°	929.4	928.6	942.1	947.7	943.7
147.5°	955.6	953.2	966.8	970.8	967.7
150°	981.1	975.6	988.4	993.1	989.1
152.5°	1002.7	996.3	1008.2	1013.0	1007.5
155°	1023.4	1016.3	1025.8	1030.5	1024.2
157.5°	1040.1	1033.7	1041.0	1046.5	1040.1
160°	1054.4	1049.6	1054.4	1059.2	1053.6
162.5°	1067.1	1062.4	1066.4	1072.0	1064.8
165°	1078.3	1073.6	1075.9	1081.5	1075.9
167.5°	1087.1	1082.2	1084.8	1090.3	1083.1
170°	1094.3	1089.5	1091.0	1096.7	1089.5
172.5°	1099.0	1094.3	1095.9	1101.5	1094.3
175°	1102.9	1097.4	1099.0	1104.6	1096.7
177.5°	1104.6	1099.0	1099.8	1105.5	1098.3
180°	1100.7	1100.7	1100.7	1100.7	1100.7

TEST NUMBER: P916929

CATALOG NUMBER: DFN2DIP-PN4F0-080D040US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.83	11.87	11.63	12.69	13.70	10.39	11.43	11.19	12.25	13.26
	3H	12.51	13.44	13.32	14.27	15.31	12.03	12.95	12.84	13.79	14.83
	4H	13.11	13.98	13.94	14.82	15.87	12.62	13.50	13.45	14.34	15.39
	6H	13.52	14.33	14.36	15.17	16.24	13.03	13.84	13.87	14.68	15.75
	8H	13.63	14.40	14.48	15.27	16.33	13.14	13.91	13.99	14.77	15.84
	12H	13.68	14.42	14.54	15.28	16.37	13.18	13.92	14.04	14.78	15.87
4H	2H	11.32	12.19	12.15	13.03	14.08	10.96	11.84	11.80	12.68	13.73
	3H	13.20	13.93	14.05	14.81	15.87	12.80	13.53	13.64	14.40	15.47
	4H	13.92	14.59	14.78	15.46	16.56	13.51	14.17	14.37	15.04	16.14
	6H	14.45	15.03	15.33	15.92	17.02	14.03	14.60	14.90	15.50	16.60
	8H	14.61	15.15	15.48	16.04	17.15	14.18	14.72	15.06	15.61	16.72
	12H	14.69	15.18	15.59	16.08	17.20	14.25	14.74	15.15	15.64	16.76
8H	4H	14.14	14.67	15.01	15.56	16.67	13.76	14.30	14.64	15.19	16.30
	6H	14.78	15.22	15.68	16.15	17.26	14.40	14.85	15.31	15.78	16.89
	8H	15.00	15.40	15.92	16.32	17.45	14.62	15.01	15.53	15.94	17.06
	12H	15.14	15.49	16.06	16.41	17.59	14.74	15.09	15.66	16.01	17.18
12H	4H	14.13	14.62	15.03	15.52	16.64	13.77	14.25	14.66	15.16	16.28
	6H	14.81	15.21	15.72	16.13	17.26	14.44	14.84	15.36	15.76	16.89
	8H	15.06	15.41	15.98	16.33	17.51	14.69	15.04	15.61	15.95	17.13

END OF REPORT