

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914731

Luminaire Tested: DFN2DIP-SQ3F0-090D100US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914731
REPORT IS A COMBINATION OF REPORTS P901500 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D100US927-RLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13902.8 lumens
Efficiency: N/A
Efficacy: 84.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 165.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914731

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US927-RLLONL

Luminous Intensity Polar Plot

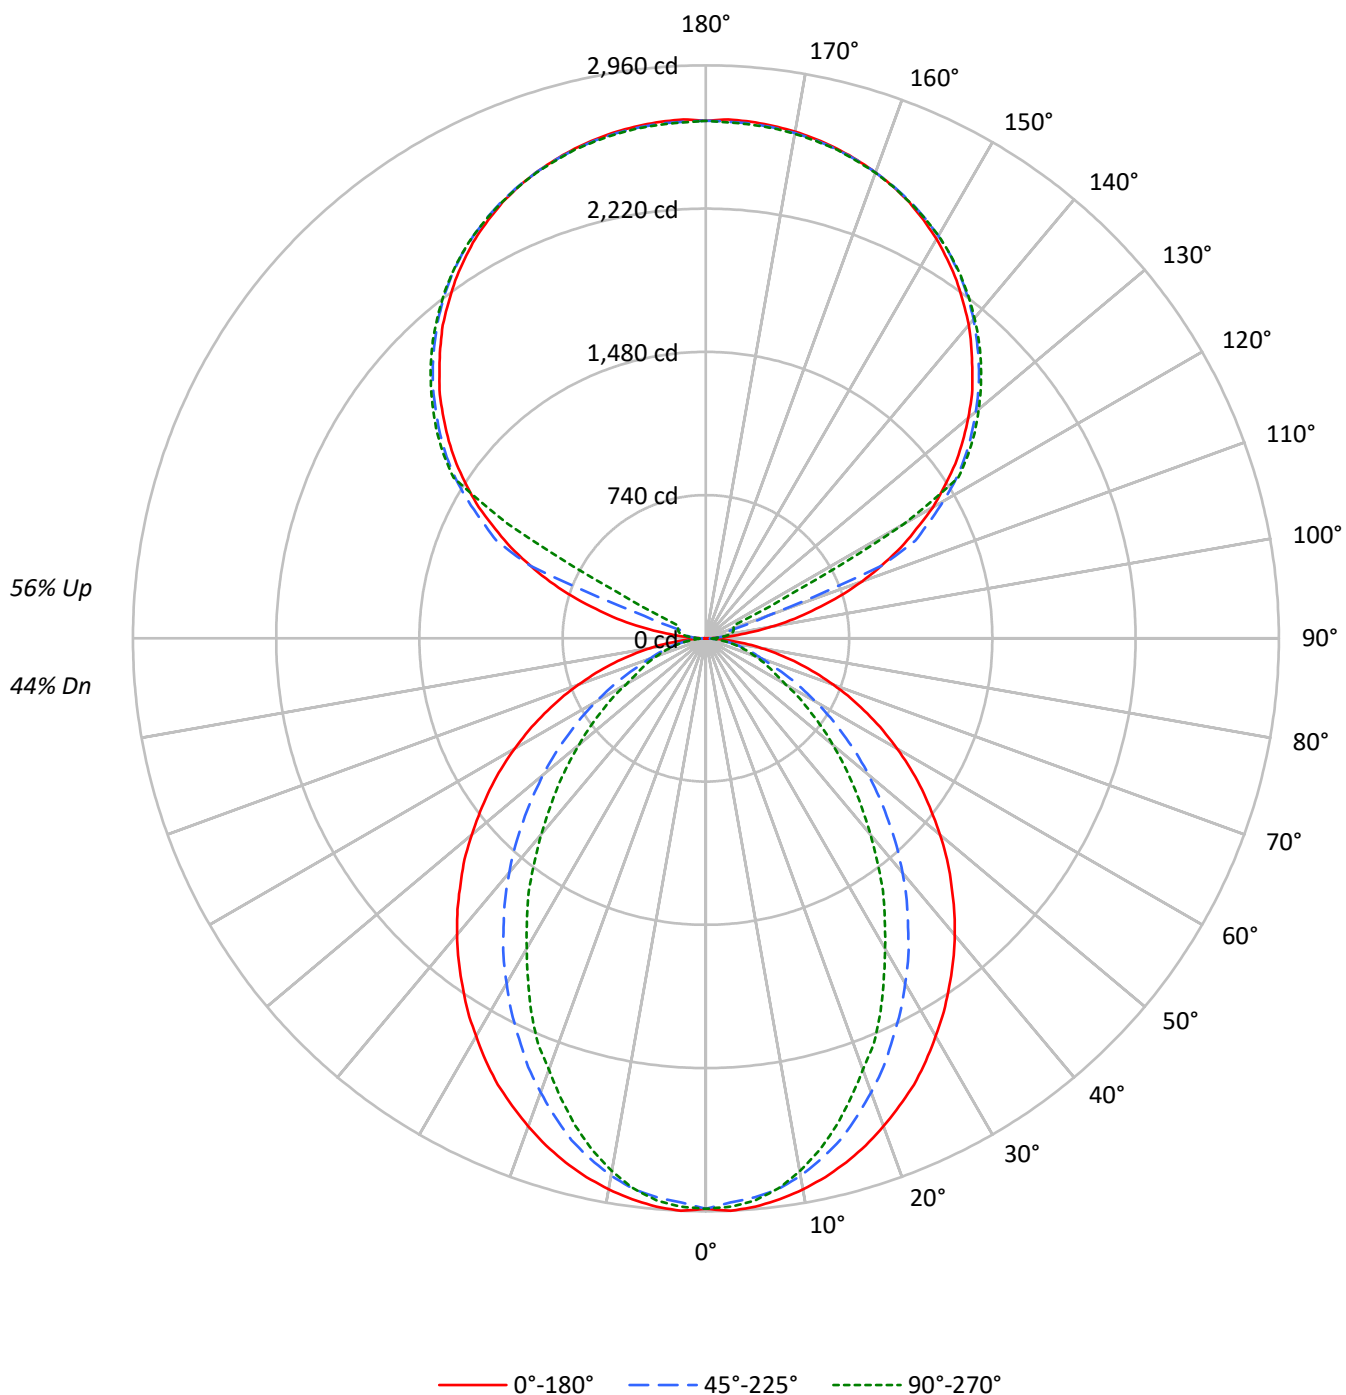

TEST NUMBER: P914731

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	71	68	66	57	56	54	45	44	43
2	88	81	76	71	81	75	70	65	62	59	56	51	48	46	40	39	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	41	41	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	37	33	30	29	27	25
6	63	51	43	38	58	47	41	36	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	25	22	20
8	54	42	35	30	50	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3376	3376	3376
5°	3380	3321	3343
10°	3344	3253	3233
15°	3296	3143	3064
20°	3233	2993	2857
25°	3168	2825	2657
30°	3082	2653	2403
35°	2998	2468	2181
40°	2912	2277	1926
45°	2812	2065	1695
50°	2709	1852	1469
55°	2601	1624	1252
60°	2476	1386	1030
65°	2331	1145	926
70°	2156	920	836
75°	1936	806	758
80°	1618	669	654
85°	1096	436	485

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2812 cd/sqm

TEST NUMBER: P914731

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.2	2.0
10°-20°	758.1	5.5
20°-30°	1064.4	7.7
30°-40°	1160.3	8.3
40°-50°	1066.4	7.7
50°-60°	837.5	6.0
60°-70°	545.1	3.9
70°-80°	280.6	2.0
80°-90°	76.3	0.5
90°-100°	88.1	0.6
100°-110°	328.6	2.4
110°-120°	871.6	6.3
120°-130°	1445.6	10.4
130°-140°	1535.6	11.0
140°-150°	1427.1	10.3
150°-160°	1147.4	8.3
160°-170°	739.3	5.3
170°-180°	254.5	1.8
0°-30°	2098.7	15.1
0°-40°	3258.9	23.4
0°-60°	5162.8	37.1
0°-90°	6064.9	43.6
90°-120°	1288.4	9.3
90°-150°	5696.7	41.0
90°-180°	7838.0	56.4
0°-180°	13902.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2947	2947	2947	2947	2947	
5°	2947	2933	2899	2923	2915	279
15°	2803	2773	2683	2632	2606	790
25°	2544	2459	2283	2173	2133	1170
35°	2192	2056	1822	1653	1595	1372
45°	1792	1613	1333	1144	1080	1384
55°	1363	1155	867	707	656	1218
65°	920	704	464	373	365	912
75°	491	304	213	195	192	519
85°	114	58	51	51	51	132
90°	2	23	39	48	52	13
95°	126	62	75	85	83	149
105°	588	646	118	139	147	628
115°	1112	1145	1194	298	159	1095
125°	1573	1598	1635	1648	1654	1403
135°	1946	1977	1994	2014	2010	1503
145°	2258	2256	2288	2302	2292	1412
155°	2486	2469	2492	2503	2488	1146
165°	2619	2608	2614	2627	2614	740
175°	2679	2666	2670	2683	2664	255
180°	2674	2674	2674	2674	2674	

TEST NUMBER: P914731

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2946.7	2946.7	2946.7	2946.7	2946.7
2.5°	2960.0	2946.7	2917.2	2944.1	2938.8
5°	2946.7	2933.4	2898.6	2922.6	2914.7
7.5°	2922.6	2906.8	2869.4	2879.9	2866.6
10°	2890.7	2872.0	2818.8	2810.6	2794.7
12.5°	2850.7	2826.7	2754.6	2738.7	2709.3
15°	2802.7	2773.3	2682.7	2632.0	2605.5
17.5°	2746.7	2704.0	2591.9	2533.3	2490.6
20°	2682.7	2629.2	2495.9	2429.5	2370.6
22.5°	2613.4	2552.0	2397.2	2306.7	2266.8
25°	2544.1	2458.6	2282.7	2173.4	2133.3
27.5°	2461.5	2370.6	2176.0	2050.6	1989.2
30°	2373.5	2271.9	2058.6	1922.8	1850.6
32.5°	2288.0	2165.2	1946.8	1786.7	1719.9
35°	2192.1	2056.0	1821.5	1653.4	1594.6
37.5°	2098.7	1951.9	1704.1	1519.9	1453.4
40°	2000.0	1840.2	1581.3	1392.0	1322.7
42.5°	1898.7	1728.1	1458.7	1261.3	1194.8
45°	1792.1	1613.3	1333.4	1143.8	1079.9
47.5°	1690.8	1501.5	1213.5	1023.9	965.4
50°	1578.7	1389.4	1096.1	911.9	856.1
52.5°	1469.3	1269.2	984.0	808.0	757.4
55°	1362.6	1154.6	866.6	706.8	656.1
57.5°	1253.4	1040.1	762.8	613.4	570.7
60°	1141.3	928.0	653.3	517.5	474.8
62.5°	1032.1	818.8	559.9	432.1	410.8
65°	920.0	703.9	464.0	373.4	365.3
67.5°	813.4	597.2	373.4	327.9	320.0
70°	701.4	493.4	309.3	282.7	271.9
72.5°	594.7	397.2	258.6	237.3	232.0
75°	490.6	303.9	213.3	194.6	192.1
77.5°	386.7	215.9	168.0	157.3	151.9
80°	290.6	154.8	127.9	117.4	117.4
82.5°	202.6	104.1	88.0	82.6	82.6
85°	114.5	58.5	50.6	50.6	50.6
87.5°	42.7	21.2	21.2	18.7	18.7
90°	1.8	23.2	38.6	48.5	52.1
92.5°	48.5	40.6	46.4	50.3	52.1
95°	125.6	61.8	75.3	85.2	83.2
97.5°	226.2	67.7	98.5	104.5	106.4
100°	342.5	77.4	110.3	125.6	129.6
102.5°	470.0	466.4	114.2	135.3	141.2
105°	588.1	646.2	118.1	139.2	147.0
107.5°	725.5	773.7	122.0	143.1	150.9
110°	857.1	897.5	338.6	145.2	152.7



TEST NUMBER: P914731

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	980.9	1015.6	982.8	148.9	154.9
115°	1112.3	1145.2	1193.7	297.9	158.8
117.5°	1226.5	1265.1	1298.1	1021.4	514.6
120°	1354.2	1383.1	1418.1	1441.3	1180.1
122.5°	1462.4	1493.4	1532.2	1543.7	1545.8
125°	1572.7	1598.0	1634.7	1648.3	1654.0
127.5°	1673.3	1700.4	1729.6	1748.9	1750.7
130°	1768.1	1799.2	1820.4	1841.7	1839.8
132.5°	1864.9	1890.1	1911.3	1928.7	1926.9
135°	1946.2	1977.2	1994.5	2014.0	2010.1
137.5°	2031.2	2054.4	2073.9	2093.3	2087.5
140°	2114.3	2130.0	2151.1	2168.6	2158.9
142.5°	2184.2	2197.7	2222.8	2238.1	2228.6
145°	2257.7	2255.7	2288.5	2302.1	2292.4
147.5°	2321.3	2315.6	2348.4	2358.1	2350.6
150°	2383.4	2369.8	2400.9	2412.4	2402.7
152.5°	2435.5	2420.1	2449.1	2460.8	2447.2
155°	2485.9	2468.6	2491.8	2503.3	2487.9
157.5°	2526.5	2511.1	2528.6	2542.1	2526.5
160°	2561.4	2549.7	2561.4	2572.9	2559.4
162.5°	2592.2	2580.7	2590.4	2603.9	2586.5
165°	2619.3	2607.8	2613.6	2627.1	2613.6
167.5°	2640.7	2628.9	2635.0	2648.5	2631.0
170°	2658.1	2646.4	2650.3	2663.9	2646.4
172.5°	2669.6	2658.1	2662.0	2675.6	2658.1
175°	2679.2	2665.7	2669.6	2683.2	2663.9
177.5°	2683.2	2669.6	2671.7	2685.3	2667.7
180°	2673.5	2673.5	2673.5	2673.5	2673.5

TEST NUMBER: P914731

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.71	11.50	11.73	12.52	13.88	6.68	7.46	7.69	8.48	9.84
	3H	12.38	13.08	13.41	14.11	15.49	7.85	8.55	8.88	9.58	10.96
	4H	12.99	13.65	14.03	14.68	16.07	8.30	8.96	9.34	9.99	11.38
	6H	13.40	14.01	14.45	15.05	16.45	8.61	9.22	9.66	10.25	11.66
	8H	13.53	14.10	14.58	15.16	16.55	8.70	9.27	9.75	10.33	11.72
	12H	13.58	14.13	14.64	15.18	16.60	8.73	9.28	9.79	10.33	11.75
4H	2H	10.73	11.39	11.77	12.42	13.81	7.26	7.92	8.31	8.96	10.35
	3H	12.54	13.09	13.60	14.15	15.56	8.60	9.15	9.65	10.21	11.61
	4H	13.23	13.73	14.29	14.79	16.21	9.14	9.64	10.20	10.70	12.12
	6H	13.74	14.17	14.81	15.25	16.67	9.55	9.98	10.62	11.06	12.48
	8H	13.91	14.31	14.98	15.38	16.82	9.67	10.08	10.74	11.15	12.58
	12H	14.00	14.36	15.09	15.45	16.89	9.73	10.10	10.82	11.18	12.62
8H	4H	13.19	13.60	14.26	14.66	16.10	9.41	9.82	10.48	10.89	12.32
	6H	13.75	14.08	14.84	15.19	16.63	9.92	10.25	11.01	11.36	12.80
	8H	13.97	14.26	15.06	15.35	16.80	10.11	10.40	11.21	11.49	12.94
	12H	14.10	14.35	15.20	15.44	16.93	10.22	10.48	11.32	11.56	13.06
12H	4H	13.14	13.51	14.23	14.59	16.03	9.42	9.78	10.50	10.86	12.30
	6H	13.73	14.02	14.83	15.11	16.56	9.97	10.26	11.07	11.35	12.81
	8H	13.94	14.20	15.04	15.29	16.78	10.17	10.43	11.27	11.52	13.01

END OF REPORT