

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909660

Luminaire Tested: DFN2DIP-SQ4F0-140D100US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909660
REPORT IS A COMBINATION OF REPORTS P900145 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D100US840-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 22934.0 lumens
Efficiency: N/A
Efficacy: 105.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 218.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909660

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US840-FLLFLL

Luminous Intensity Polar Plot

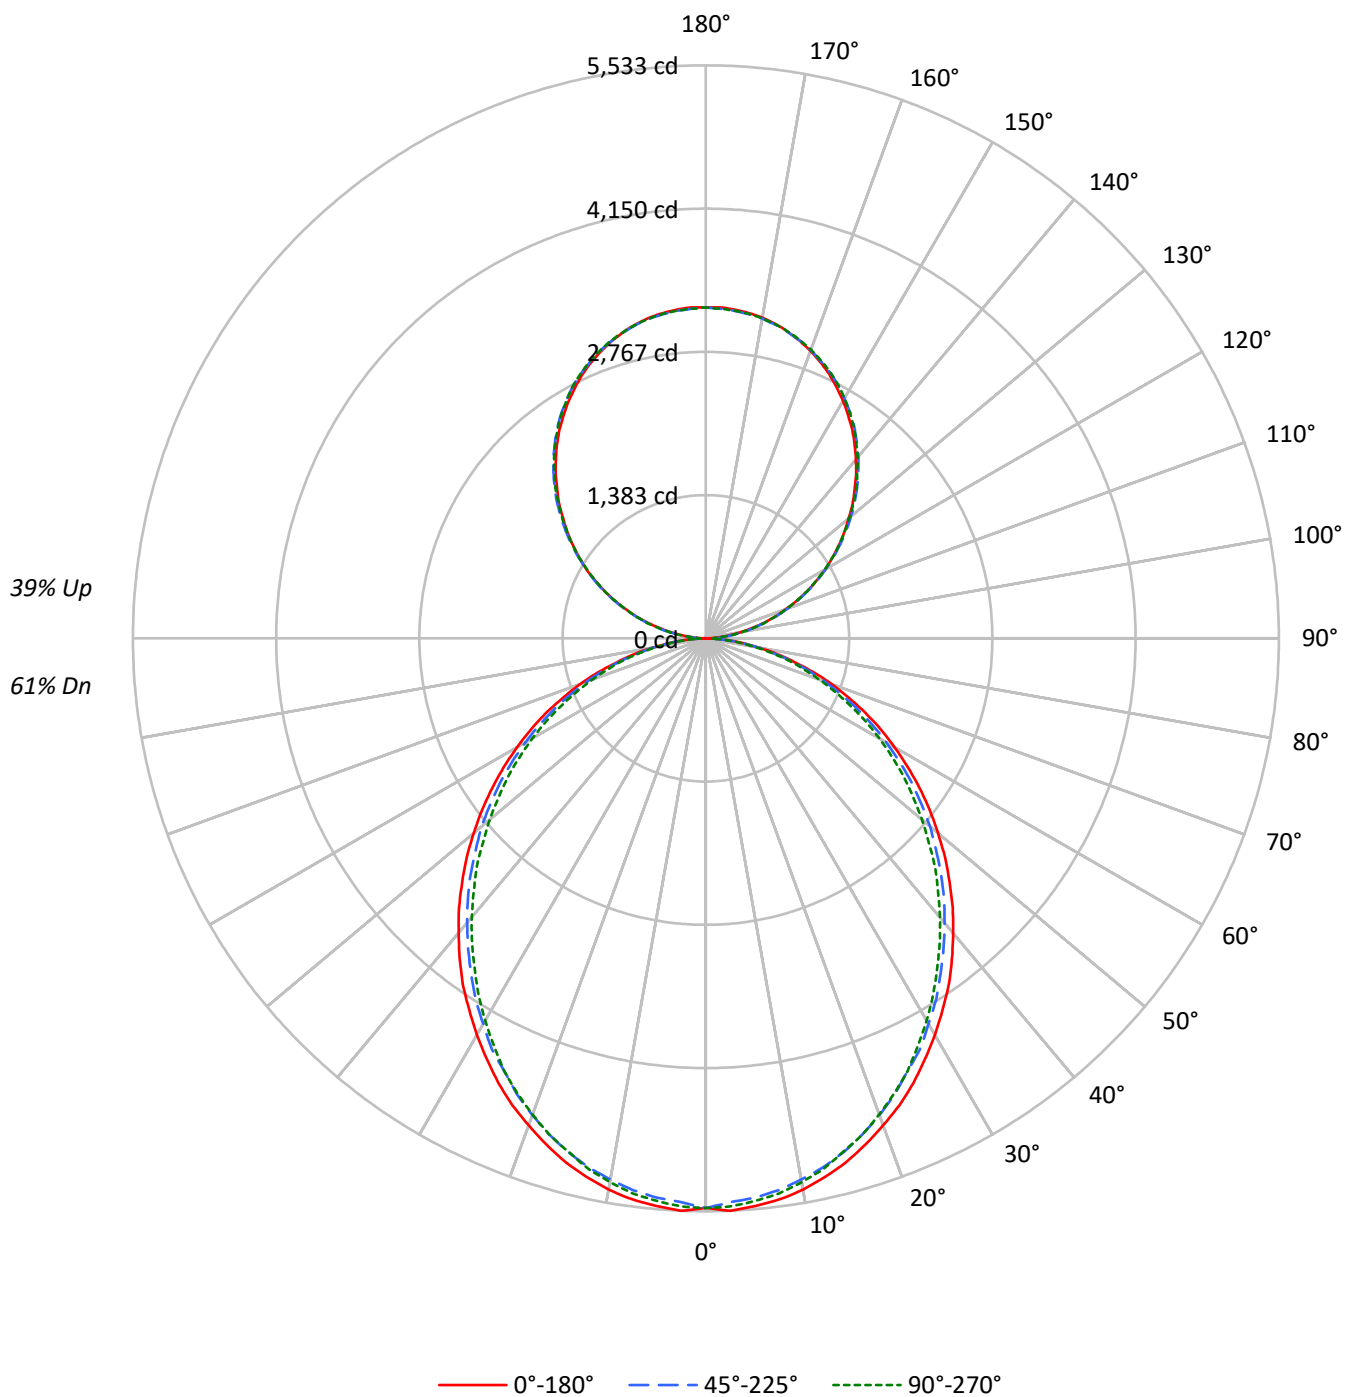

TEST NUMBER: P909660

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	100	96	92	88	94	90	86	83	79	76	74	68	66	65	59	57	56
2	91	84	77	72	85	79	73	68	69	65	61	60	57	54	52	49	47
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	40
4	76	65	57	51	71	61	54	49	54	48	44	47	43	39	41	37	35
5	70	58	50	44	65	55	47	42	48	42	38	42	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	38	34	30	33	30	27
7	60	47	39	33	56	45	37	32	40	34	29	35	30	26	31	27	24
8	56	43	35	30	52	41	33	28	36	30	26	32	27	24	28	24	21
9	52	39	32	27	48	37	30	25	33	27	23	30	25	21	26	22	19
10	48	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3860	3860	3860
5°	3866	3807	3833
10°	3835	3757	3782
15°	3778	3695	3702
20°	3702	3610	3620
25°	3626	3508	3525
30°	3531	3413	3404
35°	3441	3301	3276
40°	3330	3188	3155
45°	3220	3075	3030
50°	3099	2956	2886
55°	2972	2819	2754
60°	2829	2655	2602
65°	2673	2487	2423
70°	2475	2280	2231
75°	2199	2034	2056
80°	1868	1721	1718
85°	1350	1177	1154

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3220 cd/sqm

TEST NUMBER: P909660

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	517.8	2.3
10°-20°	1456.8	6.4
20°-30°	2141.0	9.3
30°-40°	2486.6	10.8
40°-50°	2483.5	10.8
50°-60°	2165.5	9.4
60°-70°	1600.8	7.0
70°-80°	905.7	3.9
80°-90°	248.1	1.1
90°-100°	197.6	0.9
100°-110°	627.9	2.7
110°-120°	1074.6	4.7
120°-130°	1413.3	6.2
130°-140°	1586.4	6.9
140°-150°	1555.6	6.8
150°-160°	1304.9	5.7
160°-170°	865.4	3.8
170°-180°	302.5	1.3
0°-30°	4115.6	17.9
0°-40°	6602.1	28.8
0°-60°	11251.2	49.1
0°-90°	14005.8	61.1
90°-120°	1900.2	8.3
90°-150°	6455.4	28.1
90°-180°	8928.0	38.9
0°-180°	22934.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5501	5501	5501	5501	5501	
5°	5501	5480	5422	5464	5454	522
15°	5237	5206	5136	5158	5131	1475
25°	4740	4698	4608	4618	4608	2181
35°	4089	4036	3952	3920	3893	2554
45°	3328	3290	3211	3153	3132	2568
55°	2518	2486	2423	2359	2333	2251
65°	1698	1666	1614	1566	1539	1679
75°	888	878	851	820	831	948
85°	217	212	206	190	185	242
90°	3	35	94	89	92	22
95°	141	168	172	172	168	156
105°	580	587	593	598	598	612
115°	1078	1094	1089	1086	1078	1067
125°	1568	1593	1585	1576	1573	1402
135°	2029	2059	2064	2062	2054	1568
145°	2463	2482	2498	2500	2490	1539
155°	2816	2824	2833	2846	2838	1296
165°	3064	3061	3061	3080	3067	864
175°	3188	3180	3175	3194	3177	303
180°	3194	3194	3194	3194	3194	

TEST NUMBER: P909660

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5501.2	5501.2	5501.2	5501.2	5501.2
2.5°	5533.2	5506.8	5448.4	5501.2	5491.1
5°	5501.2	5480.4	5422.1	5464.2	5454.1
7.5°	5464.2	5432.8	5374.4	5417.0	5406.3
10°	5406.3	5369.4	5305.9	5348.0	5332.3
12.5°	5326.6	5295.2	5231.8	5258.2	5247.6
15°	5236.9	5205.5	5136.4	5157.8	5131.3
17.5°	5125.8	5094.4	5025.3	5051.7	5025.3
20°	5004.0	4972.6	4898.5	4914.2	4893.4
22.5°	4882.7	4835.0	4766.0	4766.0	4755.4
25°	4739.6	4697.5	4607.7	4617.8	4607.7
27.5°	4580.8	4543.8	4475.3	4459.6	4433.2
30°	4422.5	4379.9	4300.7	4285.1	4263.7
32.5°	4253.0	4221.6	4136.8	4104.9	4083.5
35°	4089.1	4036.4	3951.6	3919.7	3893.2
37.5°	3903.9	3856.3	3771.4	3734.5	3708.0
40°	3713.7	3671.1	3586.2	3539.2	3517.8
42.5°	3528.5	3485.9	3401.6	3348.3	3316.9
45°	3327.5	3290.5	3210.9	3153.0	3131.7
47.5°	3131.7	3094.6	3009.9	2951.5	2920.1
50°	2925.2	2898.8	2824.7	2750.6	2724.2
52.5°	2724.2	2687.2	2618.7	2560.3	2523.4
55°	2518.3	2486.3	2422.9	2359.4	2333.1
57.5°	2311.7	2285.3	2216.4	2152.9	2131.5
60°	2105.2	2084.5	2010.3	1952.0	1936.2
62.5°	1904.3	1867.2	1814.4	1761.7	1740.4
65°	1698.3	1666.3	1613.6	1565.8	1539.4
67.5°	1486.7	1459.8	1412.6	1375.5	1354.2
70°	1290.8	1269.5	1221.8	1184.8	1164.0
72.5°	1089.9	1068.5	1042.2	1005.2	989.5
75°	888.5	878.4	851.4	820.0	830.6
77.5°	708.8	687.5	676.8	661.2	645.4
80°	529.3	523.6	513.0	497.3	486.6
82.5°	359.7	359.7	354.7	333.4	333.4
85°	216.6	211.6	206.5	190.3	185.2
87.5°	95.4	84.7	74.1	58.4	52.7
90°	2.9	34.6	94.3	88.6	91.5
92.5°	59.7	80.9	83.8	86.6	86.6
95°	140.6	167.5	172.4	172.4	167.5
97.5°	234.0	259.0	269.6	269.6	269.6
100°	341.8	364.0	371.6	371.6	368.8
102.5°	455.4	471.8	482.4	485.2	482.4
105°	579.7	587.3	593.1	597.9	597.9
107.5°	702.9	714.5	714.5	716.4	702.9
110°	822.3	837.7	837.7	837.7	830.0

TEST NUMBER: P909660

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	951.3	967.7	964.8	957.0	951.3
115°	1078.4	1093.8	1089.0	1086.1	1078.4
117.5°	1204.6	1225.8	1212.2	1204.6	1196.8
120°	1331.6	1352.8	1331.6	1331.6	1323.0
122.5°	1447.1	1474.1	1460.7	1453.0	1447.1
125°	1568.5	1592.6	1584.9	1576.2	1573.4
127.5°	1687.0	1716.8	1706.2	1694.7	1687.0
130°	1797.7	1832.3	1827.6	1821.7	1811.2
132.5°	1921.9	1948.8	1950.8	1937.3	1929.6
135°	2028.7	2058.6	2064.4	2061.5	2053.8
137.5°	2148.2	2172.2	2177.1	2175.1	2163.5
140°	2253.1	2277.1	2290.7	2290.7	2280.1
142.5°	2361.0	2385.0	2392.7	2395.6	2385.0
145°	2463.0	2482.2	2497.7	2500.5	2489.9
147.5°	2554.5	2578.6	2590.1	2595.0	2584.3
150°	2648.9	2665.2	2675.8	2684.4	2675.8
152.5°	2732.6	2749.0	2762.5	2773.1	2762.5
155°	2816.4	2824.1	2832.8	2846.2	2837.5
157.5°	2888.6	2894.4	2899.2	2918.4	2905.0
160°	2953.1	2958.9	2961.7	2978.1	2966.6
162.5°	3012.8	3012.8	3015.7	3033.9	3020.5
165°	3063.8	3060.9	3060.9	3080.2	3066.8
167.5°	3110.1	3101.4	3101.4	3120.7	3107.2
170°	3144.7	3137.0	3134.1	3153.4	3137.0
172.5°	3168.8	3161.1	3158.2	3177.4	3161.1
175°	3188.0	3180.4	3174.6	3193.8	3177.4
177.5°	3198.6	3191.0	3185.1	3201.5	3185.1
180°	3193.8	3193.8	3193.8	3193.8	3193.8

TEST NUMBER: P909660

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.94	13.91	13.79	14.79	15.89	12.49	13.47	13.35	14.34	15.45
	3H	14.61	15.48	15.48	16.37	17.50	14.12	14.99	14.99	15.88	17.01
	4H	15.21	16.03	16.09	16.92	18.06	14.71	15.54	15.60	16.43	17.57
	6H	15.62	16.38	16.51	17.28	18.43	15.12	15.88	16.01	16.78	17.93
	8H	15.73	16.45	16.63	17.37	18.52	15.22	15.95	16.13	16.87	18.02
	12H	15.78	16.47	16.69	17.38	18.56	15.27	15.96	16.18	16.87	18.05
4H	2H	13.41	14.24	14.30	15.13	16.27	13.06	13.88	13.95	14.78	15.92
	3H	15.29	15.98	16.19	16.91	18.06	14.89	15.57	15.79	16.50	17.65
	4H	16.02	16.64	16.93	17.56	18.75	15.59	16.22	16.50	17.14	18.32
	6H	16.54	17.08	17.47	18.03	19.21	16.11	16.65	17.04	17.60	18.78
	8H	16.70	17.20	17.62	18.14	19.34	16.26	16.77	17.19	17.70	18.90
	12H	16.78	17.23	17.72	18.19	19.39	16.33	16.78	17.28	17.74	18.94
8H	4H	16.22	16.73	17.15	17.67	18.86	15.85	16.35	16.77	17.29	18.49
	6H	16.86	17.28	17.82	18.26	19.46	16.48	16.90	17.43	17.88	19.07
	8H	17.09	17.46	18.05	18.43	19.64	16.70	17.07	17.66	18.04	19.25
	12H	17.23	17.55	18.19	18.52	19.78	16.82	17.14	17.78	18.11	19.37
12H	4H	16.21	16.67	17.16	17.63	18.83	15.85	16.30	16.79	17.26	18.46
	6H	16.89	17.27	17.86	18.24	19.45	16.52	16.89	17.49	17.86	19.08
	8H	17.14	17.47	18.11	18.43	19.70	16.76	17.09	17.73	18.05	19.32

END OF REPORT