

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907189

Luminaire Tested: DFN2DIP-TR3F0-060D080US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907189
REPORT IS A COMBINATION OF REPORTS P901868 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D080US835-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13020.0 lumens
Efficiency: N/A
Efficacy: 109.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 118.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907189

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US835-RLLONL

Luminous Intensity Polar Plot

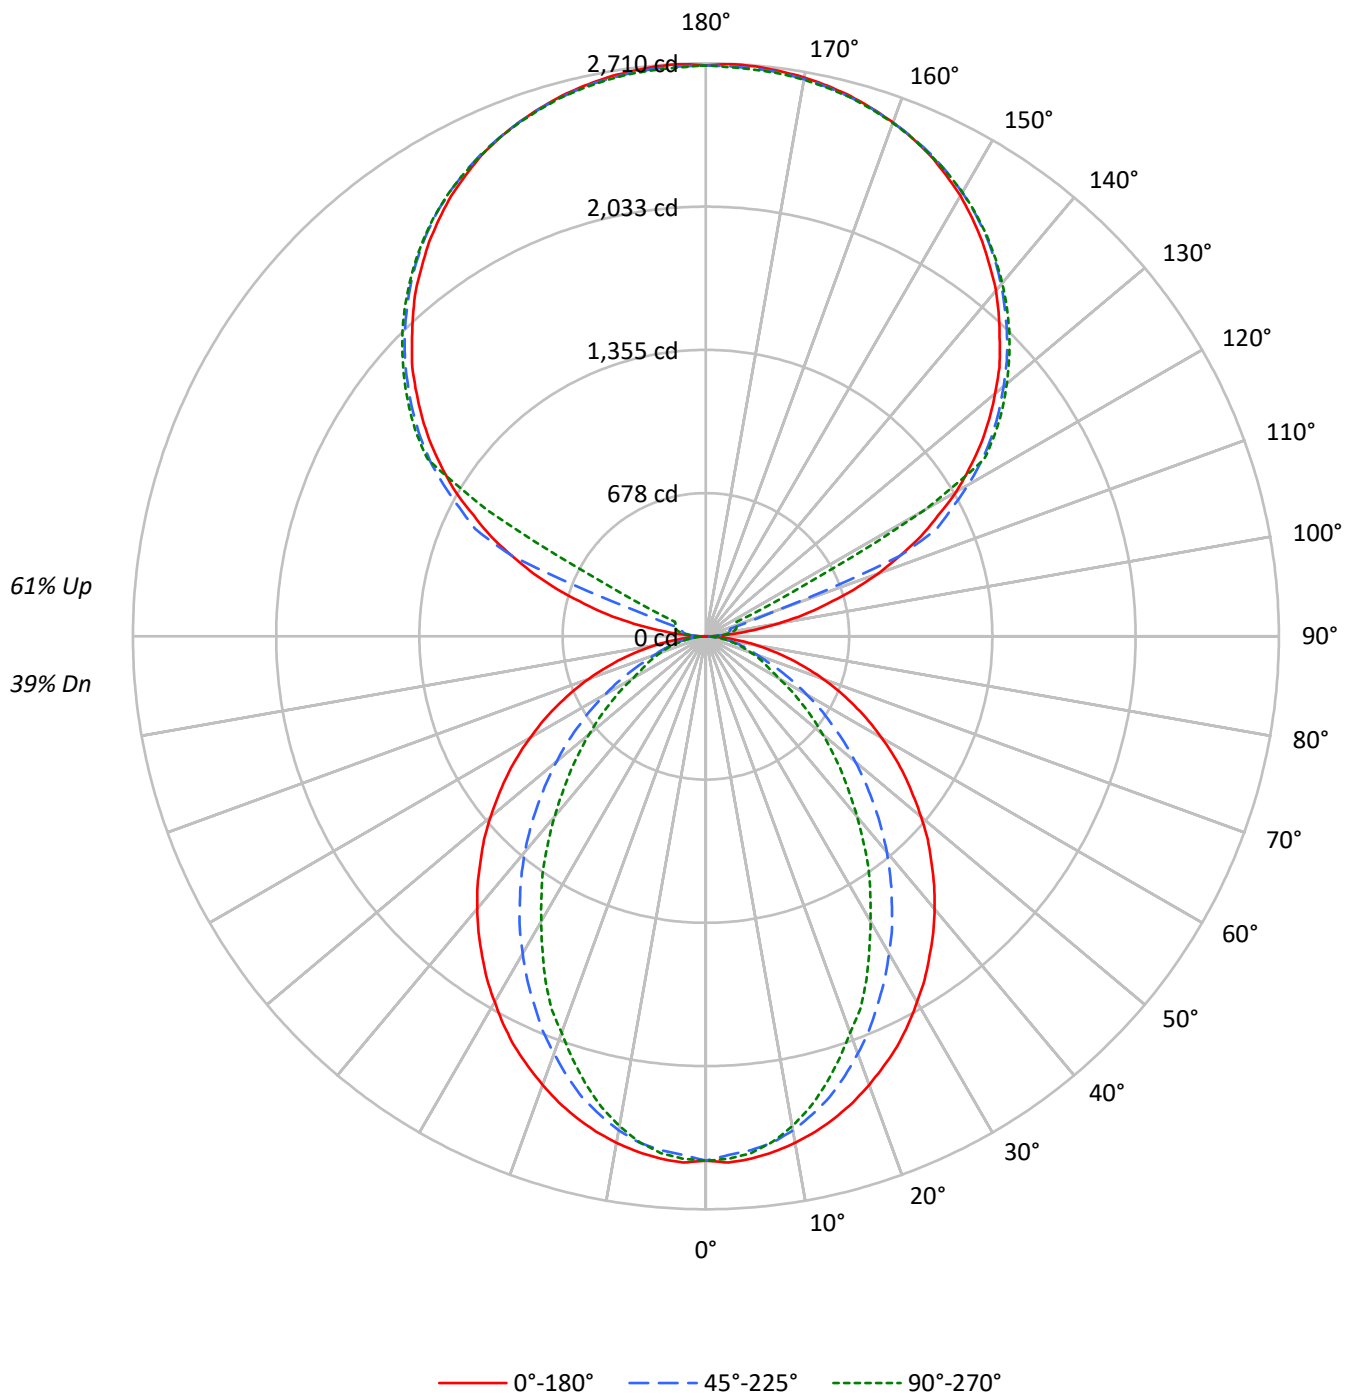

TEST NUMBER: P907189

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	52	41	41	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	67	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	25	23
6	62	51	43	37	56	46	40	35	39	34	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	31	35	30	26	29	25	22	23	20	18
8	53	42	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3090	3090	3090
5°	3093	3038	3058
10°	3061	2976	2957
15°	3017	2875	2801
20°	2960	2737	2611
25°	2901	2583	2427
30°	2822	2425	2195
35°	2745	2256	1990
40°	2667	2080	1757
45°	2576	1887	1545
50°	2482	1691	1338
55°	2383	1482	1140
60°	2269	1265	936
65°	2138	1043	840
70°	1978	837	758
75°	1778	732	685
80°	1487	606	587
85°	1012	393	430

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2576 cd/sqm

TEST NUMBER: P907189

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US835-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.4	1.8
10°-20°	638.0	4.9
20°-30°	895.7	6.9
30°-40°	976.4	7.5
40°-50°	897.4	6.9
50°-60°	704.8	5.4
60°-70°	458.8	3.5
70°-80°	236.1	1.8
80°-90°	65.0	0.5
90°-100°	89.0	0.7
100°-110°	331.9	2.5
110°-120°	880.2	6.8
120°-130°	1459.9	11.2
130°-140°	1550.7	11.9
140°-150°	1441.2	11.1
150°-160°	1158.7	8.9
160°-170°	746.6	5.7
170°-180°	257.0	2.0
0°-30°	1766.2	13.6
0°-40°	2742.6	21.1
0°-60°	4344.8	33.4
0°-90°	5104.7	39.2
90°-120°	1301.1	10.0
90°-150°	5752.9	44.2
90°-180°	7915.0	60.8
0°-180°	13020.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2480	2480	2480	2480	2480	
5°	2480	2469	2439	2460	2453	235
15°	2359	2334	2258	2215	2193	665
25°	2141	2069	1921	1829	1795	985
35°	1845	1730	1533	1391	1342	1155
45°	1508	1358	1122	963	909	1165
55°	1147	972	729	595	552	1025
65°	774	592	390	314	307	768
75°	413	256	180	164	162	437
85°	96	49	43	43	43	111
90°	2	23	39	49	53	12
95°	127	62	76	86	84	150
105°	594	653	119	141	148	635
115°	1123	1156	1205	301	160	1106
125°	1588	1614	1651	1664	1670	1416
135°	1965	1997	2014	2034	2030	1518
145°	2280	2278	2311	2325	2315	1426
155°	2510	2493	2516	2528	2512	1157
165°	2645	2634	2639	2653	2639	747
175°	2706	2692	2696	2710	2690	258
180°	2700	2700	2700	2700	2700	

TEST NUMBER: P907189

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2479.8	2479.8	2479.8	2479.8	2479.8
2.5°	2491.0	2479.8	2455.0	2477.6	2473.1
5°	2479.8	2468.6	2439.3	2459.6	2452.9
7.5°	2459.6	2446.2	2414.8	2423.6	2412.4
10°	2432.6	2416.9	2372.2	2365.3	2351.9
12.5°	2399.1	2378.8	2318.1	2304.8	2280.0
15°	2358.6	2333.8	2257.6	2215.0	2192.6
17.5°	2311.5	2275.5	2181.2	2131.9	2096.0
20°	2257.6	2212.6	2100.5	2044.5	1995.0
22.5°	2199.3	2147.6	2017.4	1941.2	1907.6
25°	2141.0	2069.1	1921.0	1829.1	1795.3
27.5°	2071.5	1995.0	1831.2	1725.7	1674.1
30°	1997.4	1911.9	1732.4	1618.1	1557.4
32.5°	1925.5	1822.2	1638.4	1503.6	1447.4
35°	1844.8	1730.3	1532.9	1391.4	1341.9
37.5°	1766.2	1642.6	1434.1	1279.1	1223.1
40°	1683.1	1548.6	1330.7	1171.4	1113.1
42.5°	1597.9	1454.3	1227.6	1061.4	1005.5
45°	1508.1	1357.6	1122.2	962.6	908.8
47.5°	1422.9	1263.6	1021.2	861.7	812.4
50°	1328.6	1169.3	922.4	767.4	720.5
52.5°	1236.4	1068.1	828.1	680.0	637.4
55°	1146.7	971.7	729.3	594.8	552.1
57.5°	1054.8	875.2	641.9	516.2	480.2
60°	960.5	781.0	549.8	435.5	399.5
62.5°	868.6	689.1	471.2	363.6	345.7
65°	774.3	592.4	390.5	314.3	307.4
67.5°	684.5	502.6	314.3	276.0	269.3
70°	590.2	415.2	260.2	237.9	228.8
72.5°	500.5	334.3	217.6	199.8	195.2
75°	412.9	255.7	179.5	163.8	161.7
77.5°	325.5	181.7	141.4	132.4	127.9
80°	244.5	130.2	107.6	98.8	98.8
82.5°	170.5	87.6	74.0	69.5	69.5
85°	96.4	49.3	42.6	42.6	42.6
87.5°	36.0	17.9	17.9	15.7	15.7
90°	1.9	23.4	39.0	48.9	52.7
92.5°	48.9	41.1	46.9	50.8	52.7
95°	126.9	62.4	76.1	86.1	84.0
97.5°	228.5	68.4	99.5	105.6	107.4
100°	345.9	78.2	111.4	126.9	130.8
102.5°	474.7	470.9	115.3	136.6	142.7
105°	593.9	652.6	119.2	140.6	148.5
107.5°	732.6	781.3	123.2	144.5	152.4
110°	865.6	906.4	342.0	146.6	154.3

TEST NUMBER: P907189

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	990.6	1025.6	992.5	150.3	156.4
115°	1123.3	1156.5	1205.4	300.9	160.3
117.5°	1238.6	1277.6	1311.0	1031.4	519.7
120°	1367.6	1396.8	1432.1	1455.5	1191.7
122.5°	1476.8	1508.2	1547.4	1559.0	1561.1
125°	1588.2	1613.7	1650.8	1664.5	1670.3
127.5°	1689.8	1717.2	1746.7	1766.1	1768.0
130°	1785.6	1816.9	1838.3	1859.9	1858.0
132.5°	1883.3	1908.8	1930.2	1947.8	1945.9
135°	1965.4	1996.7	2014.1	2033.9	2029.9
137.5°	2051.3	2074.7	2094.4	2113.9	2108.1
140°	2135.2	2151.0	2172.4	2190.0	2180.2
142.5°	2205.8	2219.4	2244.7	2260.3	2250.5
145°	2280.0	2277.9	2311.1	2324.8	2315.0
147.5°	2344.3	2338.5	2371.6	2381.4	2373.7
150°	2406.9	2393.2	2424.5	2436.1	2426.4
152.5°	2459.6	2444.0	2473.2	2485.1	2471.4
155°	2510.4	2493.0	2516.4	2528.0	2512.5
157.5°	2551.4	2535.9	2553.5	2567.2	2551.4
160°	2586.7	2574.9	2586.7	2598.3	2584.6
162.5°	2617.8	2606.2	2615.9	2629.6	2612.0
165°	2645.2	2633.6	2639.4	2653.0	2639.4
167.5°	2666.7	2654.9	2660.9	2674.6	2657.0
170°	2684.4	2672.5	2676.5	2690.2	2672.5
172.5°	2696.0	2684.4	2688.3	2702.0	2684.4
175°	2705.7	2692.0	2696.0	2709.6	2690.2
177.5°	2709.6	2696.0	2698.0	2711.7	2694.1
180°	2699.9	2699.9	2699.9	2699.9	2699.9

TEST NUMBER: P907189

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.92	10.67	10.97	11.72	13.14	5.89	6.64	6.94	7.69	9.11
	3H	11.58	12.25	12.64	13.31	14.75	7.07	7.74	8.13	8.80	10.24
	4H	12.18	12.81	13.25	13.87	15.32	7.51	8.15	8.58	9.21	10.66
	6H	12.59	13.17	13.67	14.24	15.69	7.83	8.41	8.91	9.47	10.93
	8H	12.71	13.26	13.79	14.34	15.79	7.91	8.47	9.00	9.55	11.00
	12H	12.76	13.29	13.85	14.36	15.84	7.95	8.48	9.04	9.55	11.03
4H	2H	9.92	10.56	11.00	11.62	13.07	6.47	7.11	7.55	8.17	9.62
	3H	11.73	12.26	12.82	13.35	14.81	7.81	8.34	8.90	9.43	10.88
	4H	12.42	12.90	13.51	13.98	15.46	8.35	8.83	9.44	9.91	11.39
	6H	12.92	13.33	14.02	14.44	15.91	8.76	9.17	9.86	10.28	11.75
	8H	13.09	13.47	14.18	14.57	16.06	8.88	9.27	9.98	10.36	11.85
	12H	13.17	13.52	14.29	14.63	16.12	8.94	9.29	10.06	10.40	11.89
8H	4H	12.38	12.76	13.48	13.86	15.35	8.62	9.01	9.72	10.10	11.59
	6H	12.93	13.25	14.05	14.39	15.87	9.13	9.45	10.25	10.58	12.07
	8H	13.14	13.42	14.27	14.54	16.04	9.31	9.59	10.44	10.71	12.22
	12H	13.27	13.51	14.40	14.63	16.17	9.42	9.67	10.55	10.78	12.33
12H	4H	12.32	12.67	13.44	13.78	15.28	8.62	8.97	9.73	10.08	11.57
	6H	12.90	13.18	14.03	14.30	15.81	9.17	9.45	10.30	10.57	12.08
	8H	13.11	13.36	14.24	14.47	16.02	9.37	9.62	10.50	10.73	12.28

END OF REPORT