

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915365

Luminaire Tested: DFN2DIP-TR3F0-060D060US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915365
REPORT IS A COMBINATION OF REPORTS P901840 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D060US927-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8745.6 lumens
Efficiency: N/A
Efficacy: 85.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915365

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US927-RLLONL

Luminous Intensity Polar Plot

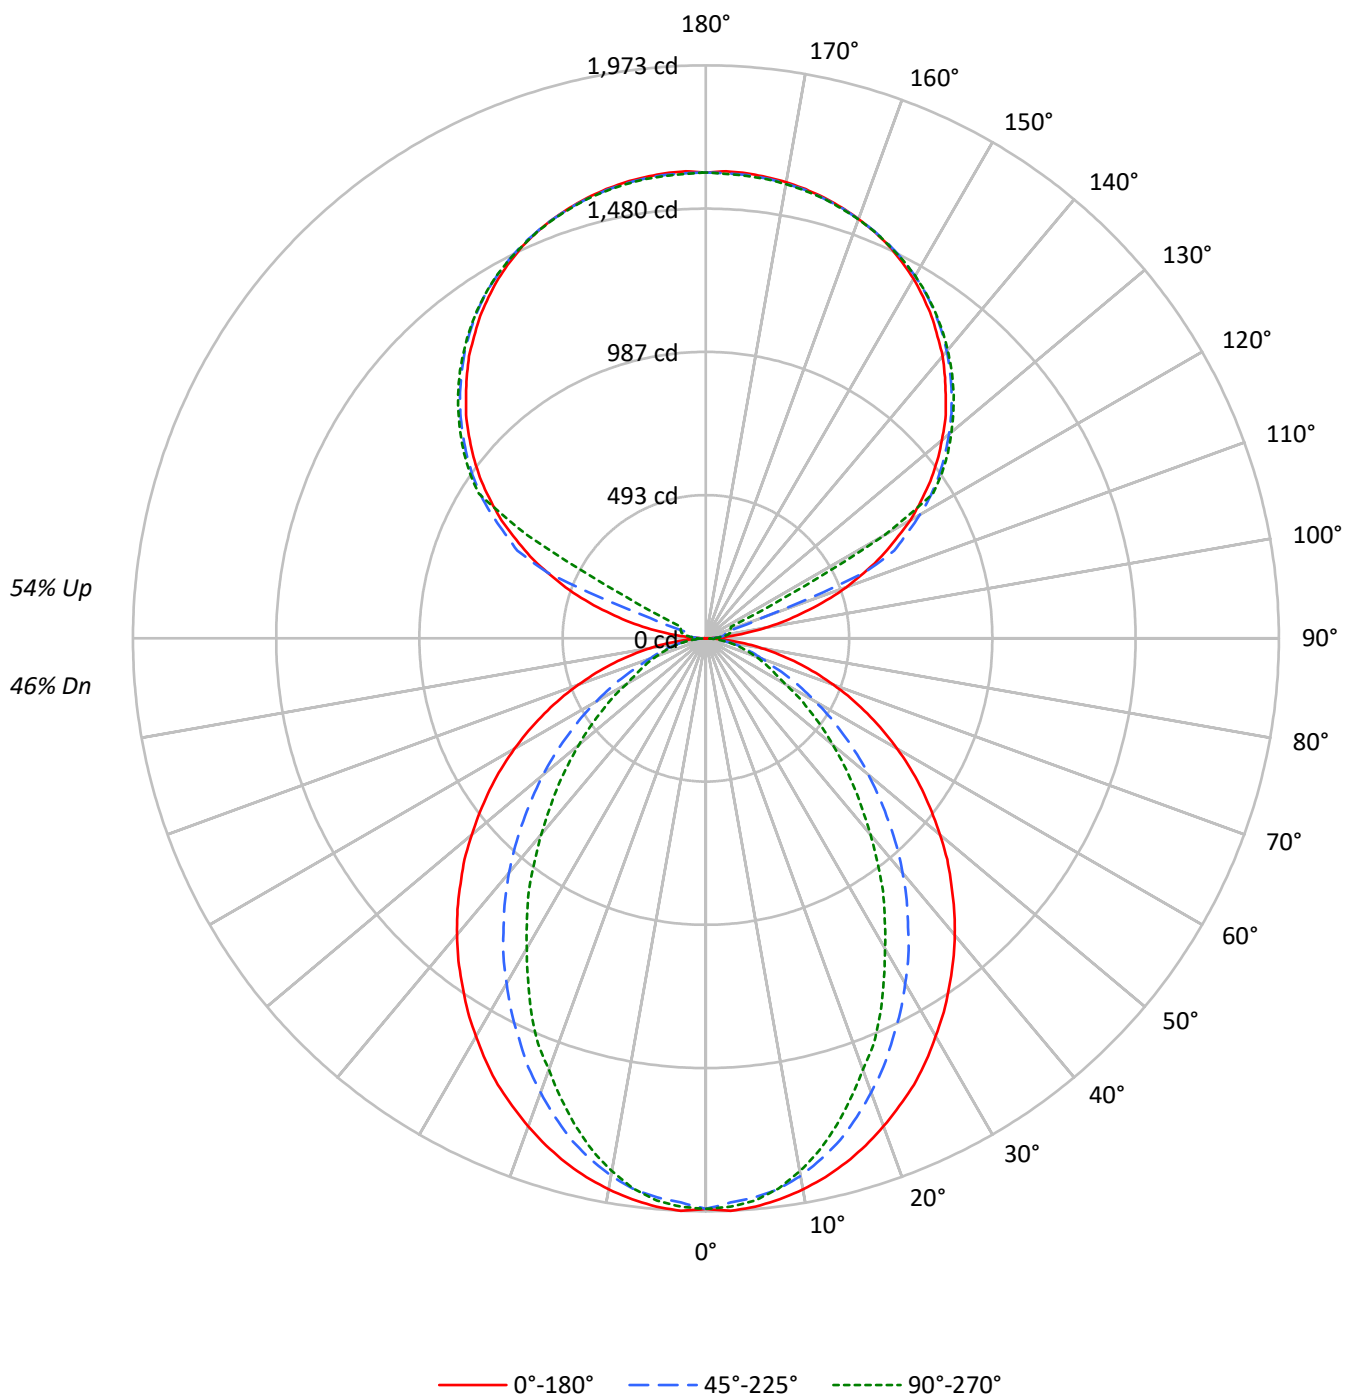

TEST NUMBER: P915365

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53			46
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45			40
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39			34
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34			29
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29			26
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26			23
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23			20
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21			18
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19			16
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17			15
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2448	2448	2448
5°	2451	2407	2423
10°	2425	2358	2342
15°	2390	2278	2219
20°	2345	2169	2068
25°	2298	2046	1923
30°	2236	1921	1738
35°	2175	1787	1577
40°	2113	1648	1392
45°	2041	1495	1224
50°	1966	1340	1060
55°	1888	1174	903
60°	1798	1002	742
65°	1694	826	666
70°	1567	663	600
75°	1408	580	543
80°	1178	480	465
85°	802	311	340

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2041 cd/sqm

TEST NUMBER: P915365

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	2.1
10°-20°	505.4	5.8
20°-30°	709.6	8.1
30°-40°	773.5	8.8
40°-50°	710.9	8.1
50°-60°	558.3	6.4
60°-70°	363.4	4.2
70°-80°	187.1	2.1
80°-90°	50.6	0.6
90°-100°	52.9	0.6
100°-110°	197.2	2.3
110°-120°	523.0	6.0
120°-130°	867.4	9.9
130°-140°	921.3	10.5
140°-150°	856.3	9.8
150°-160°	688.4	7.9
160°-170°	443.6	5.1
170°-180°	152.7	1.7
0°-30°	1399.1	16.0
0°-40°	2172.6	24.8
0°-60°	3441.9	39.4
0°-90°	4042.9	46.2
90°-120°	773.0	8.8
90°-150°	3418.0	39.1
90°-180°	4703.0	53.8
0°-180°	8745.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	1	14	23	29	31	8
95°	75	37	45	51	50	89
105°	353	388	71	84	88	377
115°	667	687	716	179	95	657
125°	944	959	981	989	992	842
135°	1168	1186	1197	1208	1206	902
145°	1355	1353	1373	1381	1376	847
155°	1492	1481	1495	1502	1493	687
165°	1572	1565	1568	1576	1568	444
175°	1608	1599	1602	1610	1598	153
180°	1604	1604	1604	1604	1604	

TEST NUMBER: P915365

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	1.1	13.9	23.1	29.1	31.3
92.5°	29.1	24.4	27.8	30.2	31.3
95°	75.4	37.1	45.2	51.2	49.9
97.5°	135.8	40.6	59.1	62.7	63.8
100°	205.5	46.4	66.1	75.4	77.7
102.5°	282.0	279.8	68.5	81.2	84.8
105°	352.8	387.7	70.8	83.5	88.2
107.5°	435.3	464.2	73.2	85.9	90.5
110°	514.3	538.5	203.2	87.1	91.7

TEST NUMBER: P915365

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.5	609.3	589.6	89.3	92.9
115°	667.4	687.1	716.2	178.8	95.2
117.5°	735.9	759.1	778.9	612.8	308.7
120°	812.5	829.9	850.9	864.7	708.1
122.5°	877.4	896.0	919.3	926.2	927.5
125°	943.6	958.8	980.8	989.0	992.4
127.5°	1004.0	1020.3	1037.8	1049.3	1050.4
130°	1060.9	1079.5	1092.2	1105.0	1103.9
132.5°	1119.0	1134.1	1146.8	1157.2	1156.1
135°	1167.8	1186.4	1196.7	1208.4	1206.0
137.5°	1218.7	1232.6	1244.4	1255.9	1252.5
140°	1268.6	1278.0	1290.7	1301.2	1295.4
142.5°	1310.5	1318.7	1333.7	1342.9	1337.1
145°	1354.6	1353.4	1373.1	1381.2	1375.5
147.5°	1392.8	1389.3	1409.1	1414.8	1410.3
150°	1430.0	1421.9	1440.5	1447.4	1441.6
152.5°	1461.3	1452.1	1469.4	1476.5	1468.3
155°	1491.5	1481.1	1495.1	1502.0	1492.7
157.5°	1515.9	1506.6	1517.1	1525.3	1515.9
160°	1536.8	1529.8	1536.8	1543.7	1535.6
162.5°	1555.3	1548.4	1554.2	1562.3	1551.9
165°	1571.6	1564.7	1568.1	1576.3	1568.1
167.5°	1584.4	1577.4	1581.0	1589.1	1578.6
170°	1594.9	1587.8	1590.2	1598.3	1587.8
172.5°	1601.8	1594.9	1597.2	1605.4	1594.9
175°	1607.6	1599.4	1601.8	1609.9	1598.3
177.5°	1609.9	1601.8	1603.0	1611.1	1600.7
180°	1604.1	1604.1	1604.1	1604.1	1604.1

TEST NUMBER: P915365

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.84	10.64	10.84	11.64	12.97	5.82	6.62	6.81	7.62	8.95
	3H	11.51	12.22	12.51	13.23	14.58	7.00	7.72	8.01	8.73	10.07
	4H	12.11	12.79	13.13	13.80	15.16	7.45	8.12	8.46	9.14	10.49
	6H	12.52	13.14	13.55	14.16	15.53	7.76	8.38	8.79	9.40	10.77
	8H	12.64	13.24	13.68	14.27	15.63	7.85	8.44	8.88	9.47	10.84
	12H	12.70	13.26	13.74	14.29	15.68	7.89	8.45	8.93	9.48	10.87
4H	2H	9.86	10.53	10.88	11.55	12.90	6.41	7.08	7.43	8.10	9.45
	3H	11.67	12.23	12.70	13.28	14.65	7.75	8.31	8.78	9.35	10.72
	4H	12.36	12.87	13.40	13.90	15.30	8.29	8.80	9.33	9.84	11.23
	6H	12.86	13.30	13.91	14.36	15.75	8.70	9.14	9.75	10.20	11.59
	8H	13.03	13.44	14.08	14.49	15.89	8.83	9.24	9.88	10.29	11.69
	12H	13.12	13.49	14.19	14.56	15.96	8.89	9.26	9.95	10.32	11.73
8H	4H	12.32	12.73	13.37	13.78	15.18	8.56	8.97	9.61	10.02	11.43
	6H	12.87	13.21	13.95	14.31	15.71	9.07	9.41	10.14	10.50	11.90
	8H	13.08	13.38	14.17	14.46	15.88	9.26	9.56	10.34	10.63	12.05
	12H	13.22	13.48	14.30	14.55	16.01	9.37	9.63	10.45	10.70	12.16
12H	4H	12.27	12.64	13.34	13.71	15.11	8.56	8.94	9.63	10.00	11.41
	6H	12.85	13.15	13.93	14.22	15.64	9.12	9.42	10.20	10.49	11.91
	8H	13.06	13.32	14.15	14.40	15.86	9.32	9.58	10.41	10.66	12.12

END OF REPORT